# Easy UPS 3S

# For Internal and External Batteries 10-40 kVA 400 V & 10-20 kVA 208 V 3:3 10-30 kVA 400 V 3:1

# **Technical Specifications**

Latest updates are available on the Schneider Electric website 11/2024





# **Legal Information**

The information provided in this document contains general descriptions, technical characteristics and/or recommendations related to products/solutions.

This document is not intended as a substitute for a detailed study or operational and site-specific development or schematic plan. It is not to be used for determining suitability or reliability of the products/solutions for specific user applications. It is the duty of any such user to perform or have any professional expert of its choice (integrator, specifier or the like) perform the appropriate and comprehensive risk analysis, evaluation and testing of the products/solutions with respect to the relevant specific application or use thereof.

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this document are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owner.

This document and its content are protected under applicable copyright laws and provided for informative use only. No part of this document may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the document or its content, except for a non-exclusive and personal license to consult it on an "as is" basis.

Schneider Electric reserves the right to make changes or updates with respect to or in the content of this document or the format thereof, at any time without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this document, as well as any non-intended use or misuse of the content thereof.



Find the manuals here: Trouvez les manuels ici: 在这里找到手册 Hier finden Sie die Handbücher: Encuentre los manuales aquí: Encontre os manuais aqui:



https://www.productinfo.schneider-electric.com/easyups3s/

# **Table of Contents**

Important Safety Instructions — SAVE THESE	
INSTRUCTIONS	7
Electromagnetic Compatibility	8
Safety Precautions	8
Electrical Safety	11
Battery Safety	12
Symbols Used in the Product	14
Model List	15
System Overview	
User Interface	
Display Interface	
Overview of Single UPS	
Overview of 1+1 Redundant Parallel System with Common Battery	
Bank	22
Overview of Parallel System	
Location of Breakers - 400 V Systems	
Location of Breakers - 208 V Systems	
Technical Data	
Technical Data for 400 V Systems	
Input Power Factor	
Efficiency – 3:3 UPSs	
Efficiency – 3:1 UPSs	
Technical Data for 208 V Systems	
Input Power Factor	
Efficiency – 3:3 UPSs	
Derating Due to Load Power Factor	
Batteries	
End of Discharge Voltage	
Battery Gassing Rates for Modular Battery Cabinets and UPSs with	50
Internal Batteries	36
Electrolyte Values for Modular Battery Cabinet and UPSs with	50
Internal Batteries	36
Compliance	
Communication and Management	
-	
Facility Planning	
Facility Planning for Easy UPS 3S 3:3 400 V	
Input Specifications – 3:3 UPSs	
Bypass Specifications – 3:3 UPSs	
Output Specifications – 3:3 UPSs with Internal Patteries	
Battery Specifications – 3:3 UPSs with Internal Batteries	
Battery Specifications – 3:3 UPSs for External Batteries	
Required Upstream Protection and Cable Sizes – 3:3 UPSs	
UPS Weights and Dimensions – 3:3 UPSs	
UPS Shipping Weights and Dimensions – 3:3 UPSs	
Facility Planning for Easy UPS 3S 3:1 400 V	
Input Specifications – 3:1 UPSs	
Bypass Specifications – 3:1 UPSs	44

990-91077K-001

Output Specifications – 3:1 UPSs	45
Battery Specifications – 3:1 UPSs with Internal Batteries	45
Battery Specifications – 3:1 UPSs for External Batteries	46
Required Upstream and Downstream Protection and Cable Sizes –	
3:1 UPSs	46
Weights and Dimensions – 3:1 UPSs	48
Shipping Weights and Dimensions – 3:1 UPSs	48
Facility Planning for Easy UPS 3S 3:3 208 V	49
Input Specifications – 3:3 UPSs	49
Bypass Specifications – 3:3 UPSs	49
Output Specifications – 3:3 UPSs	50
Battery Specifications – 3:3 UPSs with Internal Batteries	50
Battery Specifications – 3:3 UPSs for External Batteries	51
Required Upstream Protection and Cable Sizes – 3:3 UPSs	51
UPS Weights and Dimensions – 3:3 UPSs	52
UPS Shipping Weights and Dimensions – 3:3 UPSs	53
Recommended Bolts and Cable Lugs	53
Torque Specifications	53
Clearance	
Environmental	55
Heat Dissipation for 400 V Systems	55
Heat Dissipation for 208 V Systems	56
Airflow Requirement for 400 V Systems	56
Airflow Requirement for 208 V Systems	56
Drawings	57
Easy UPS 3S for External Batteries – Single Mains System	57
Easy UPS 3S for External Batteries – Dual Mains System	58
Easy UPS 3S with Internal Batteries – Single Mains System	59
Easy UPS 3S with Internal Batteries – Dual Mains System	60
Options	61
Configuration Options	61
Hardware Options	61
Weights and Dimensions for Options	63
Battery Breaker Box Shipping Weights and Dimensions	
Battery Breaker Box Weights and Dimensions	
Modular Battery Cabinet Shipping Weights and Dimensions	63
Modular Battery Cabinet Weights and Dimensions	63
Backfeed Box Shipping Weights and Dimensions	63
Backfeed Box Weights and Dimensions	64
Limited Factory Warranty	65
Annendix: Switch/Breaker Details	67

# Important Safety Instructions — SAVE THESE INSTRUCTIONS

Read these instructions carefully and look at the equipment to become familiar with it before trying to install, operate, service or maintain it. The following safety messages may appear throughout this manual or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a "Danger" or "Warning" safety message indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages with this symbol to avoid possible injury or death.

#### **▲** DANGER

**DANGER** indicates a hazardous situation which, if not avoided, **will result in** death or serious injury.

Failure to follow these instructions will result in death or serious injury.

### **AWARNING**

**WARNING** indicates a hazardous situation which, if not avoided, **could result** in death or serious injury.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

### **ACAUTION**

**CAUTION** indicates a hazardous situation which, if not avoided, **could result in** minor or moderate injury.

Failure to follow these instructions can result in injury or equipment damage.

### **NOTICE**

**NOTICE** is used to address practices not related to physical injury. The safety alert symbol shall not be used with this type of safety message.

Failure to follow these instructions can result in equipment damage.

### **Please Note**

Electrical equipment should only be installed, operated, serviced, and maintained by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction, installation, and operation of electrical equipment and has received safety training to recognize and avoid the hazards involved.

Per IEC 62040-1: "Uninterruptible power systems (UPS) -- Part 1: Safety Requirements," this equipment, including battery access, must be inspected, installed and maintained by a skilled person.

The skilled person is a person with relevant education and experience to enable him or her to perceive risks and to avoid hazards which the equipment can create (reference IEC 62040-1, section 3.102).

### **Electromagnetic Compatibility**

### **NOTICE**

#### RISK OF ELECTROMAGNETIC DISTURBANCE

This is a product Category C3 according to IEC 62040-2. This is a product for commercial and industrial applications in the second environment - installation restrictions or additional measures may be needed to prevent disturbances. The second environment includes all commercial, light industry, and industrial locations other than residential, commercial, and light industrial premises directly connected without intermediate transformer to a public low-voltage mains supply. The installation and cabling must follow the electromagnetic compatibility rules, e.g.:

- the segregation of cables,
- the use of shielded or special cables when relevant,
- the use of grounded metallic cable tray and supports.

Failure to follow these instructions can result in equipment damage.

# **Safety Precautions**

#### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

All safety instructions in this document must be read, understood and followed.

Failure to follow these instructions will result in death or serious injury.

### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Read all instructions in the Installation Manual before installing or working on this UPS system.

Failure to follow these instructions will result in death or serious injury.

### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Do not install the UPS system until all construction work has been completed and the installation room has been cleaned.

Failure to follow these instructions will result in death or serious injury.

### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- The product must be installed according to the specifications and requirements as defined by Schneider Electric. It concerns in particular the external and internal protections (upstream breakers, battery breakers, cabling, etc.) and environmental requirements. No responsibility is assumed by Schneider Electric if these requirements are not respected.
- After the UPS system has been electrically wired, do not start up the system.
  The start-up requirements depend on the installation country. For countries
  with bundled start-up service, start-up must be performed by Schneider
  Electric.

Failure to follow these instructions will result in death or serious injury.

#### **▲** DANGER

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

The UPS system must be installed according to local and national regulations. Install the UPS according to:

- IEC 60364 (including 60364–4–41- protection against electric shock, 60364–4–42 protection against thermal effect, and 60364–4–43 protection against overcurrent), or
- NEC NFPA 70, or
- Canadian Electrical Code (C22.1, Part 1)

depending on which one of the standards apply in your local area.

Failure to follow these instructions will result in death or serious injury.

#### **▲** DANGER

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Install the UPS system in a temperature controlled indoor environment free of conductive contaminants and humidity.
- Install the UPS system on a non-flammable, level and solid surface (e.g. concrete) that can support the weight of the system.

Failure to follow these instructions will result in death or serious injury.

### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

The UPS is not designed for and must therefore not be installed in the following unusual operating environments:

- · Damaging fumes
- Explosive mixtures of dust or gases, corrosive gases, or conductive or radiant heat from other sources
- · Moisture, abrasive dust, steam or in an excessively damp environment
- · Fungus, insects, vermin
- Salt-laden air or contaminated cooling refrigerant
- Pollution degree higher than 2 according to IEC 60664-1
- · Exposure to abnormal vibrations, shocks, and tilting
- · Exposure to direct sunlight, heat sources, or strong electromagnetic fields

Failure to follow these instructions will result in death or serious injury.

# **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Do not drill or cut holes for cables or conduits with the gland plates installed and do not drill or cut holes in close proximity to the UPS.

Failure to follow these instructions will result in death or serious injury.

#### **AWARNING**

#### HAZARD OF ARC FLASH

Do not make mechanical changes to the product (including removal of cabinet parts or drilling/cutting of holes) that are not described in the Installation Manual.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

### **NOTICE**

#### **RISK OF OVERHEATING**

Respect the space requirements around the UPS system and do not cover the product's ventilation openings when the UPS system is in operation.

Failure to follow these instructions can result in equipment damage.

### **NOTICE**

#### **RISK OF EQUIPMENT DAMAGE**

The UPS must use an external regenerative braking kit to dissipate energy when connected to regenerative loads including photovoltaic systems and speed drives.

Failure to follow these instructions can result in equipment damage.

### **Electrical Safety**

### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Electrical equipment must be installed, operated, serviced, and maintained only by qualified personnel.
- Apply appropriate personal protective equipment (PPE) and follow safe electrical work practices.
- Turn off all power supplying the UPS system before working on or inside the equipment.
- Before working on the UPS system, check for hazardous voltage between all terminals including the protective earth.
- The UPS contains an internal energy source. Hazardous voltage can be
  present even when disconnected from the mains supply. Before installing or
  servicing the UPS system, ensure that the units are OFF and that mains and
  batteries are disconnected. Wait five minutes before opening the UPS to
  allow the capacitors to discharge.
- A disconnection device (e.g. disconnection circuit breaker or switch) must be installed to enable isolation of the system from upstream power sources in accordance with local regulations. The disconnection device must be easily accessible and visible.
- The UPS must be properly earthed/grounded and due to a high leakage current, the earthing/grounding conductor must be connected first.

Failure to follow these instructions will result in death or serious injury.

#### **▲** DANGER

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

In systems where backfeed protection is not part of the standard design, an automatic isolation device (backfeed protection option or other device meeting the requirements of IEC/EN 62040–1 **or** UL1778 5th Edition – depending on which of the two standards apply to your local area) must be installed to prevent hazardous voltage or energy at the input terminals of the isolation device. The device must open within 15 seconds after the upstream power supply fails and must be rated according to the specifications.

Failure to follow these instructions will result in death or serious injury.

When the UPS input is connected through external isolators that, when opened, isolate the neutral or when the automatic backfeed isolation is provided external to the equipment or is connected to an IT power distribution system, a label must be fitted at the UPS input terminals, and on all primary power isolators installed remote from the UPS area and on external access points between such isolators and the UPS, by the user, displaying the following text (or equivalent in a language which is acceptable in the country in which the UPS system is installed):

### **ADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Risk of Voltage Backfeed. Before working on this circuit: Isolate the UPS and check for hazardous voltage between all terminals including the protective earth.

Failure to follow these instructions will result in death or serious injury.

#### **ACAUTION**

#### RISK OF ELECTRICAL DISTURBANCE

This product can cause a DC current in the PE conductor. Where a residual current-operated protective device (RCD) is used for protection against electrical shock, only an RCD of Type B is allowed on the supply side of this product.

Failure to follow these instructions can result in injury or equipment damage.

### **Battery Safety**

#### **AADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Battery circuit breakers must be installed according to the specifications and requirements as defined by Schneider Electric.
- Servicing of batteries must only be performed or supervised by qualified personnel knowledgeable of batteries and the required precautions. Keep unqualified personnel away from batteries.
- Disconnect charging source prior to connecting or disconnecting battery terminals.
- Do not dispose of batteries in a fire as they can explode.
- Do not open, alter, or mutilate batteries. Released electrolyte is harmful to the skin and eyes. It may be toxic.

Failure to follow these instructions will result in death or serious injury.

#### **AADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Batteries can present a risk of electric shock and high short-circuit current. The following precautions must be observed when working on batteries

- Remove watches, rings, or other metal objects.
- · Use tools with insulated handles.
- Wear protective glasses, gloves and boots.
- Do not lay tools or metal parts on top of batteries.
- Disconnect the charging source prior to connecting or disconnecting battery terminals.
- Determine if the battery is inadvertently grounded. If inadvertently grounded, remove source from ground. Contact with any part of a grounded battery can result in electric shock. The likelihood of such shock can be reduced if such grounds are removed during installation and maintenance (applicable to equipment and remote battery supplies not having a grounded supply circuit).

Failure to follow these instructions will result in death or serious injury.

### **AADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

When replacing batteries, always replace with the same type and number of batteries or battery packs.

Failure to follow these instructions will result in death or serious injury.

# **A**CAUTION

#### **RISK OF EQUIPMENT DAMAGE**

- Mount the batteries in the UPS system, but do not connect the batteries until
  the UPS system is ready to be powered up. The time duration from battery
  connection until the UPS system is powered up must not exceed 72 hours or
  3 days.
- Batteries must not be stored more than six months due to the requirement of recharging. If the UPS system remains de-energized for a long period, we recommend that you energize the UPS system for a period of 24 hours at least once every month. This charges the batteries, thus avoiding irreversible damage.

Failure to follow these instructions can result in injury or equipment damage.

# **Symbols Used in the Product**

	This is the earthing/ground symbol.
	This is the protective earth/equipment grounding conductor symbol.
	This is the direct current symbol. It is also referred to as DC.
$\sim$	This is the alternating current symbol. It is also referred to as AC.
+	This is the positive polarity symbol. It is used to identify the positive terminal(s) of equipment which is used with, or generates direct current.
_	This is the negative polarity symbol. It is used to identify the negative terminal(s) of equipment which is used with, or generates direct current.
	This is the battery symbol.
	This is the static switch symbol. It is used to indicate switches that are designed to connect or disconnect the load to or from the supply respectively without the existence of moving parts.
	This is the AC/DC converter (rectifier) symbol. It is used to identify an AC/DC converter (rectifier) and, in case of plug-in devices, to identify the relevant receptacles.
	This is the DC/AC converter (inverter) symbol. It is used to identify an DC/AC converter (inverter) and, in case of plug-in devices, to identify the relevant receptacles.
<b>→</b>	This is the input symbol. It is used to identify an input terminal when it is necessary to distinguish between inputs and outputs.
$\longrightarrow$	This is the output symbol. It is used to identify an output terminal when it is necessary to distinguish between inputs and outputs.
<b>-</b> ∕₀	This is the switch disconnector symbol. It is used to identify the disconnecting device in the form of switch.
	This is the circuit breaker symbol. It is used to identify the disconnecting device in the form of circuit breaker that protects the equipment from short circuit or heavy load current. It opens the circuits once the current flow crosses its maximum limit.

# **Model List**

#### **400 V UPSs**

#### 3:3 UPS for External Batteries

- Easy UPS 3S 10 kVA 400 V 3:3 UPS for external batteries (E3SUPS10KH)
- Easy UPS 3S 15 kVA 400 V 3:3 UPS for external batteries (E3SUPS15KH)
- Easy UPS 3S 20 kVA 400 V 3:3 UPS for external batteries (E3SUPS20KH)
- Easy UPS 3S 30 kVA 400 V 3:3 UPS for external batteries (E3SUPS30KH)
- Easy UPS 3S 40 kVA 400 V 3:3 UPS for external batteries (E3SUPS40KH)

#### 3:1 UPS for External Batteries

- Easy UPS 3S 10 kVA 400 V 3:1 UPS for external batteries (E3SUPS10K3I)
- Easy UPS 3S 15 kVA 400 V 3:1 UPS for external batteries (E3SUPS15K3I)
- Easy UPS 3S 20 kVA 400 V 3:1 UPS for external batteries (E3SUPS20K3I)
- Easy UPS 3S 30 kVA 400 V 3:1 UPS for external batteries (E3SUPS30K3I)

#### 3:3 UPS for Internal Batteries

- Easy UPS 3S 10 kVA 400 V 3:3 UPS for internal batteries (E3SUPS10KHB) <sup>1</sup>
- Easy UPS 3S 15 kVA 400 V 3:3 UPS for internal batteries (E3SUPS15KHB) 1
- Easy UPS 3S 20 kVA 400 V 3:3 UPS for internal batteries (E3SUPS20KHB) <sup>1</sup>
- Easy UPS 3S 30 kVA 400 V 3:3 UPS for internal batteries (E3SUPS30KHB)<sup>1</sup>
- Easy UPS 3S 40 kVA 400 V 3:3 UPS for internal batteries (E3SUPS40KHB) 1
- Easy UPS 3S 10 kVA 400V 3:3 UPS, 1 internal 7Ah modular battery string, expandable to 3 (E3SUPS10KHB1)<sup>1</sup>
- Easy UPS 3S 10 kVA 400V 3:3 UPS, 2 internal 7Ah modular battery strings, expandable to 3 (E3SUPS10KHB2) 1
- Easy UPS 3S 15 kVA 400V 3:3 UPS, 1 internal 7Ah modular battery string, expandable to 3 (E3SUPS15KHB1)<sup>1</sup>
- Easy UPS 3S 15 kVA 400V 3:3 UPS, 2 internal 7Ah modular battery strings, expandable to 3 (E3SUPS15KHB2)<sup>1</sup>
- Easy UPS 3S 20 kVA 400V 3:3 UPS, 2 internal 7Ah modular battery strings, expandable to 3 (E3SUPS20KHB1) <sup>1</sup>
- Easy UPS 3S 20 kVA 400V 3:3 UPS, 3 internal 7Ah modular battery strings (E3SUPS20KHB2) 1
- Easy UPS 3S 30 kVA 400V 3:3 UPS, 2 internal 7Ah modular battery strings, expandable to 4 (E3SUPS30KHB1) <sup>1</sup>
- Easy UPS 3S 30 kVA 400V 3:3 UPS, 4 internal 7Ah modular battery strings (E3SUPS30KHB2) 1
- Easy UPS 3S 40 kVA 400V 3:3 UPS, 3 internal 7Ah modular battery strings, expandable to 4 (E3SUPS40KHB1) <sup>1</sup>
- Easy UPS 3S 40 kVA 400V 3:3 UPS, 4 internal 7Ah modular battery strings (E3SUPS40KHB2) 1

#### 3:1 UPS for Internal Batteries

- Easy UPS 3S 10 kVA 400 V 3:1 UPS for internal batteries (E3SUPS10K3IB) 1
- Easy UPS 3S 15 kVA 400 V 3:1 UPS for internal batteries (E3SUPS15K3IB) <sup>1</sup>
- Easy UPS 3S 20 kVA 400 V 3:1 UPS for internal batteries (E3SUPS20K3IB) 1
- Easy UPS 3S 30 kVA 400 V 3:1 UPS for internal batteries (E3SUPS30K3IB) 1
- Easy UPS 3S 10 kVA 400V 3:1 UPS, 1 internal 7Ah modular battery string, expandable to 3 (E3SUPS10K3IB1) 1
- Easy UPS 3S 10 kVA 400V 3:1 UPS, 2 internal 7Ah modular battery strings, expandable to 3 (E3SUPS10K3IB2) 1
- Easy UPS 3S 15 kVA 400V 3:1 UPS, 1 internal 7Ah modular battery string, expandable to 3 (E3SUPS15K3IB1) <sup>1</sup>
- Easy UPS 3S 15 kVA 400V 3:1 UPS, 2 internal 7Ah modular battery strings, expandable to 3 (E3SUPS15K3IB2) 1
- Easy UPS 3S 20 kVA 400V 3:1 UPS, 2 internal 7Ah modular battery strings, expandable to 3 (E3SUPS20K3IB1) <sup>1</sup>
- Easy UPS 3S 20 kVA 400V 3:1 UPS, 3 internal 7Ah modular battery strings (E3SUPS20K3IB2) 1
- Easy UPS 3S 30 kVA 400V 3:1 UPS, 2 internal 7Ah modular battery strings, expandable to 4 (E3SUPS30K3IB1)<sup>1</sup>
- Easy UPS 3S 30 kVA 400V 3:1 UPS, 4 internal 7Ah modular battery strings (E3SUPS30K3IB2) 1

### **208 V UPSs**

#### 3:3 UPS

- Easy UPS 3S 10 kVA 208 V 3:3 UPS 15 minutes runtime (E3SUPS10KFB1)<sup>2</sup>
- Easy UPS 3S 15 kVA 208 V 3:3 UPS 9 minutes runtime (E3SUPS15KFB1)<sup>2</sup>
- Easy UPS 3S 20 kVA 208 V 3:3 UPS 10 minutes runtime (E3SUPS20KFB1)<sup>2</sup>


<sup>1.</sup> Not available in India and China

<sup>2.</sup> The product is not UL-certified.


# **System Overview**

- A. User interface
- B. Display interface
- C. Keys
- D. Status LEDs
- E. EPO button


#### **UPS for External Batteries**

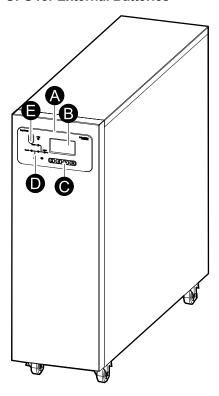


#### **UPSs with Internal Batteries**

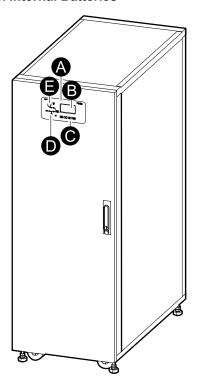

#### **User Interface**

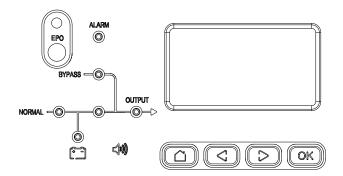

### **Keys**



#### **EPO**

Only use the EPO button in case of emergency.

It can be configured whether, when the EPO is activated, the UPS should:

- turn off the rectifier, inverter, charger, and static bypass and stop supplying the load immediately (default), or
- transfer to static bypass mode and continue supplying the load.


#### **AADANGER**

#### HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

The UPS control circuit will remain active after the EPO has been pushed if utility/mains is available.

Failure to follow these instructions will result in death or serious injury.

# **Status LEDs**

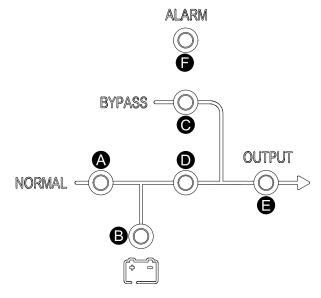


	LED	Status				
Α	Rectifier	Green : Rectifier is working correctly.				
		Flashing green : Rectifier is starting up.				
		Red : Rectifier is inoperable.				
		Flashing red : Utility/mains is unavailable.				
		OFF : Rectifier is off.				
В	Battery	Green : Battery is charging.				
		Flashing green : Battery is discharging.				
		Red : Battery is inoperable.				
		Flashing red : Battery low voltage.				
		OFF : Battery and battery charger are OK, battery is not charging or discharging.				
С	Bypass	Green : Load supplied by bypass source.				
		Red : Bypass source is unavailable or static bypass switch is inoperable.				
		Flashing red : Bypass voltage is out of tolerance.				
		OFF : Bypass source is OK.				
D	Inverter	Green : Load supplied by inverter.				
		Flashing green : Inverter on, start, synchronization or standby (ECO mode).				
		Red : Load not supplied by inverter, inverter is inoperable.				


	LED	Status
		Flashing red : Load supplied by inverter, but an inverter alarm is present.  OFF: Inverter is off.
E	Load	Green : UPS output is on.
		Red : Overload on UPS output for too long, or output has shorted, or no output power present.
		Flashing red : Overload on UPS output.
		OFF : UPS output is off.
F	Status	Green : UPS is OK.
		Red : Inoperable status.

# **Display Interface**

#### **Home Screen**

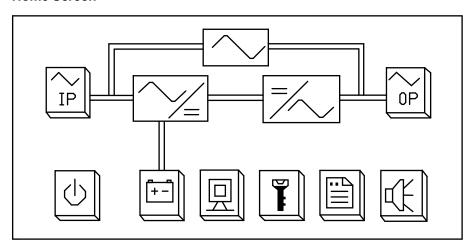


#### **Buttons**

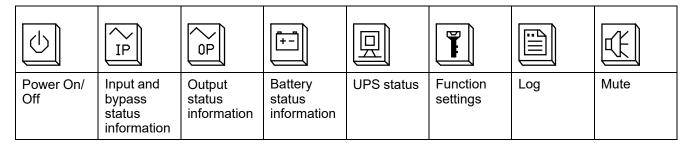

# **Overview of Single UPS**

UIB	Unit input breaker/switch
SSIB	Static switch input breaker/switch
UOB	Unit output breaker/switch
МВВ	Maintenance bypass breaker/switch
ВВ	Battery breaker/switch

**NOTE:** Refer to Appendix: Switch/Breaker Details, page 67 for the disconnecting device type.

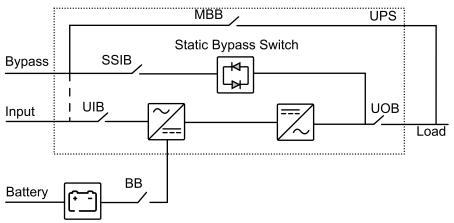


# **Overview of 1+1 Redundant Parallel System with Common Battery Bank**

MIB	Mains input breaker/switch
BIB	Bypass input breaker/switch
UIB	Unit input breaker/switch
SSIB	Static switch input breaker/switch
UOB	Unit output breaker/switch
Ext. UOB	External unit output breaker/switch
MBB	Maintenance bypass breaker/switch
Ext. MBB	External maintenance bypass breaker/switch
BB1	Battery breaker/switch 1
BB2	Battery breaker/switch 2

**NOTE:** Refer to Appendix: Switch/Breaker Details, page 67 for the disconnecting device type.

**NOTE:** For UPS with internal batteries, the batteries must be removed and the internal battery breaker (BB) must be padlocked in the open (OFF) position.

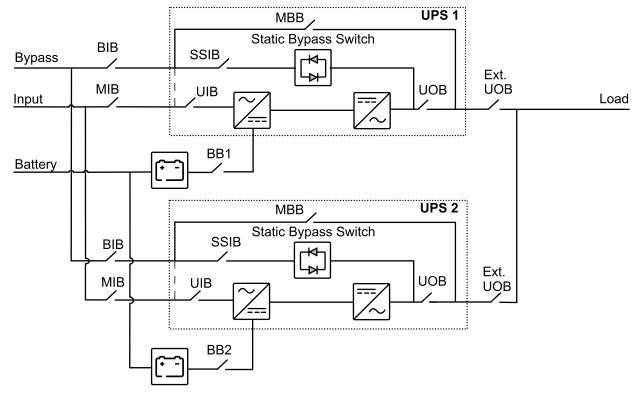


# **Overview of Parallel System**

MIB	Mains input breaker/switch
BIB	Bypass input breaker/switch
UIB	Unit input breaker/switch
SSIB	Static switch input breaker/switch
UOB	Unit output breaker/switch
Ext. UOB	External unit output breaker/switch
MBB	Maintenance bypass breaker/switch
Ext. MBB	External maintenance bypass breaker/switch
SIB	System isolation breaker/switch
ВВ	Battery breaker/switch


**NOTE:** Refer to Appendix: Switch/Breaker Details, page 67 for the disconnecting device type.

**NOTE:** In parallel systems with an external maintenance bypass breaker Ext. MBB, the maintenance bypass breakers/switches MBB must be padlocked in the open (OFF) position.

#### **UPSs for External Batteries**

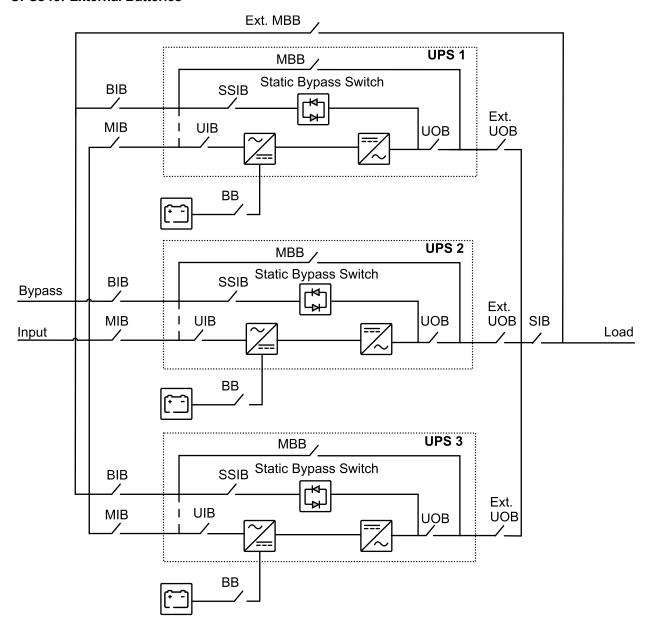

#### **UPSs for Internal Batteries**

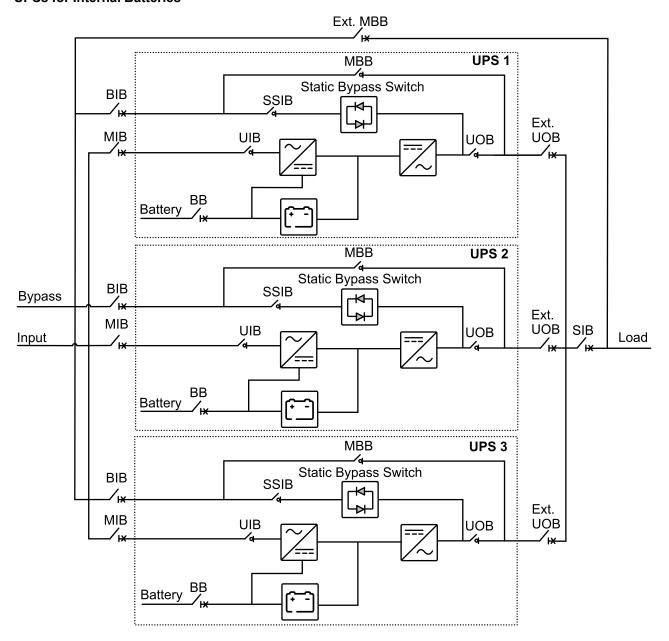

The impedance of the bypass paths need to be controlled in a parallel UPS system. When operating in bypass mode, the parallel load sharing is determined by the total impedance of the bypass path comprising cables, switchgear, static bypass switch, and cable formation.

### **NOTICE**

#### **RISK OF EQUIPMENT DAMAGE**

To ensure correct load sharing in bypass operation in a parallel system, the following recommendations apply:

- The bypass cables must be the same length for all UPSs.
- The output cables must be the same length for all UPSs.
- The input cables must be the same length for all UPSs in a single mains system.
- · Cable formation recommendations must be followed.
- The reactance of busbar layout in the bypass/input and output switchgear must be the same for all UPSs.


If the above recommendations are not followed the result can be uneven load sharing in bypass and overload of individual UPSs.

Failure to follow these instructions can result in equipment damage.


# **Location of Breakers - 400 V Systems**

#### **Location of Breakers in 3:3 UPSs**


# Rear View of the 10–15 kVA UPS for External Batteries

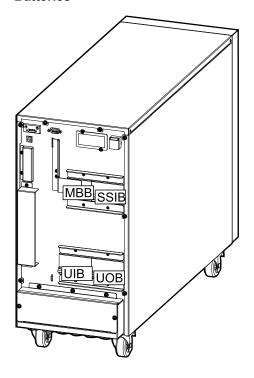


# Rear View of the 10–15 kVA UPS with Internal Batteries

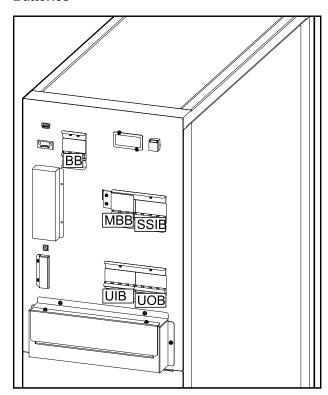


Rear View of the 20 kVA UPS for External Batteries

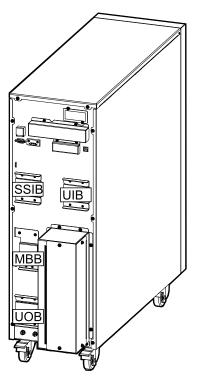


Rear View of the 20 kVA UPS with Internal Batteries

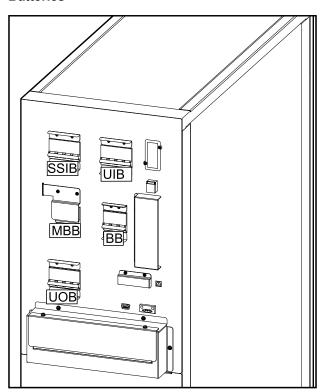


Rear View of the 30 kVA UPS for External Batteries

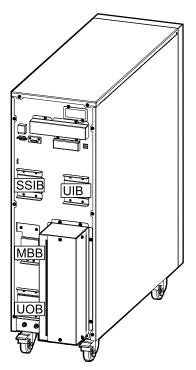


Rear View of the 30 kVA UPS with Internal Batteries

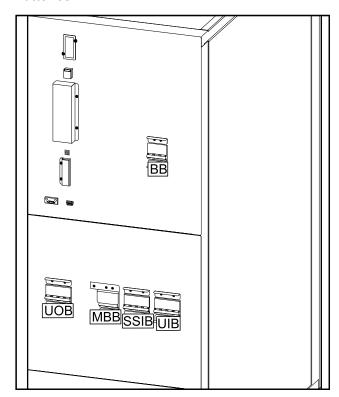

Rear View of the 40 kVA UPS for External Batteries

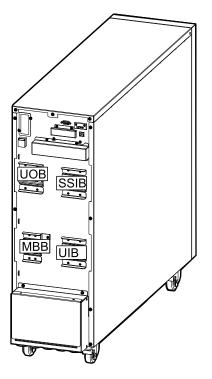


Rear View of the 40 kVA UPS with Internal Batteries

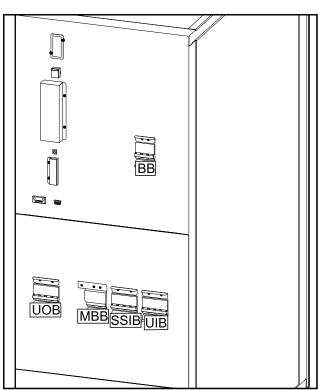


### **Location of Breakers in 3:1 UPSs**


Rear View of the 10–15 kVA UPS for External Batteries

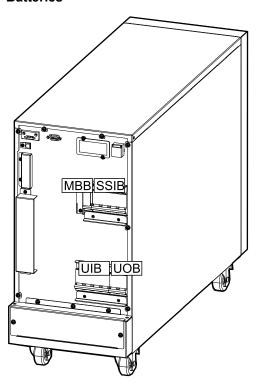


Rear View of the 10–15 kVA UPS with Internal Batteries

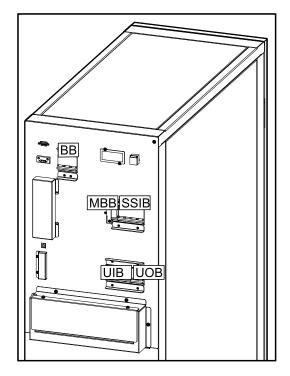


#### Rear View of the 20 kVA UPS for External Batteries

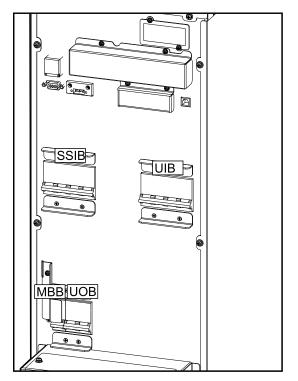


# Rear View of the 20 kVA UPS with Internal Batteries

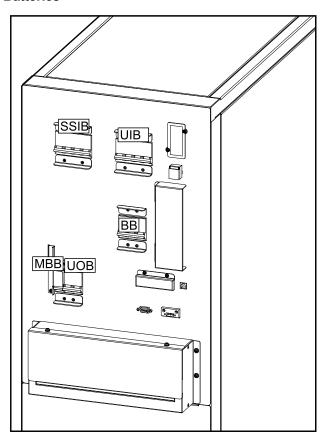

#### Rear View of the 30 kVA UPS for External Batteries

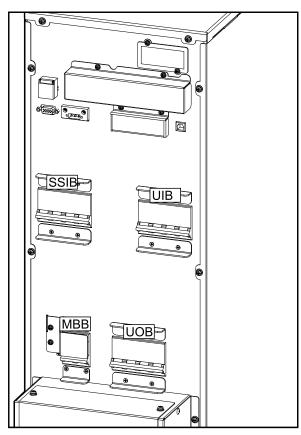


# Rear View of the 30 kVA UPS with Internal Batteries

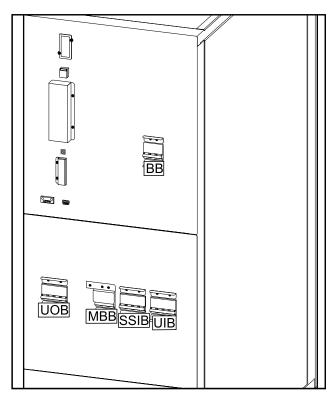


# **Location of Breakers - 208 V Systems**

### **Location of Breakers in 3:3 UPSs**


Rear View of the 10 kVA UPS for External Batteries

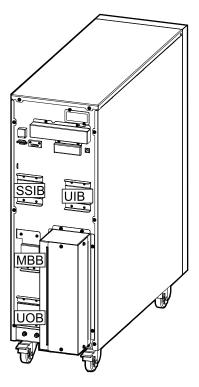


Rear View of the 10 kVA UPS with Internal Batteries

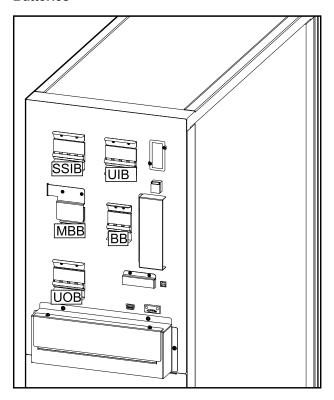


Rear View of the 15 kVA UPS for External Batteries

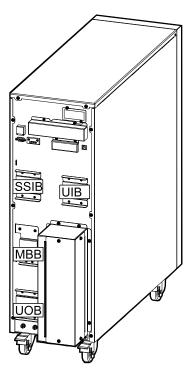


Rear View of the 15 kVA UPS with Internal Batteries

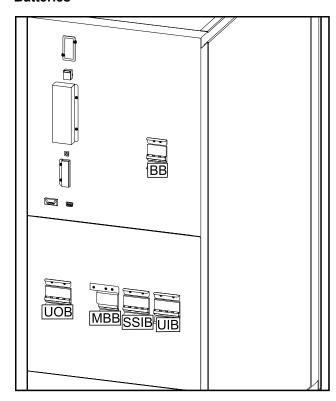

#### Rear View of the 20 kVA UPS for External Batteries

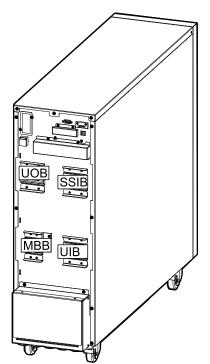

# Rear View of the 20 kVA UPS with Internal Batteries

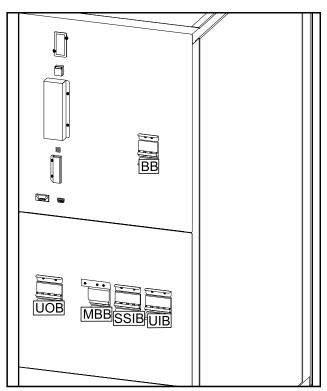

# **Technical Data**

# **Technical Data for 400 V Systems**

# **Input Power Factor**

### Input Power Factor - 3:3 UPSs

The values are at a 400 V, 50 Hz load.

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA
25% load	0.90	0.92	0.93	0.97	0.96
50% load	0.98	0.98	0.99	0.99	0.99
75% load	0.99	0.99	0.99	0.99	0.99
100% load	0.99	0.99	0.99	0.99	0.99

# Input Power Factor – 3:1 UPSs

	10 kVA	15 kVA	20 kVA	30 kVA
25% load	0.96	0.97	0.94	0.96
50% load	0.99	0.99	0.99	0.99
75% load	0.99	0.99	0.99	0.99
100% load	0.99	0.99	0.99	0.99

# Efficiency - 3:3 UPSs

## **Efficiency in Normal Mode**

The values are at a 400 V, 50 Hz load.

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA
25% load	94.4	94.0	95.0	95.3	95.2
50% load	95.3	95.1	95.8	95.9	95.8
75% load	95.3	95.0	95.8	95.8	95.7
100% load	94.9	94.7	95.5	95.3	95.3

### **Efficiency in ECO Mode**

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA
25% load	95.1	96.3	97.0	97.9	98.0
50% load	97.3	97.9	98.1	98.6	98.8
75% load	98.0	98.5	98.6	99.0	99.0
100% load	98.4	98.7	98.8	99.1	99.1

### **Efficiency in Battery Mode**

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA
25% load	94.0	93.3	94.5	94.7	94.7
50% load	94.9	94.6	95.2	95.4	95.2
75% load	94.7	94.5	95.2	95.2	95.1
100% load	94.3	94.0	94.9	94.6	94.6

# Efficiency – 3:1 UPSs

# **Efficiency in Normal Mode**

The values are at a 400 V, 50 Hz load.

	10 kVA	15 kVA	20 kVA	30 kVA
25% load	94.2	94.2	94.6	95.1
50% load	95.2	95.0	95.5	95.6
75% load	94.9	94.8	95.3	95.2
100% load	94.4	94.4	95.0	94.7

# **Efficiency in ECO Mode**

	10 kVA	15 kVA	20 kVA	30 kVA
25% load	94.0	94.9	95.2	96.4
50% load	96.2	96.7	97.4	98.0
75% load	97.3	97.6	98.0	98.5
100% load	97.8	98.1	98.4	98.7

# **Efficiency in Battery Mode**

	10 kVA	15 kVA	20 kVA	30 kVA
25% load	94.0	93.3	94.5	94.7
50% load	94.9	94.6	95.2	95.4
75% load	94.7	94.5	95.2	95.2
100% load	94.3	94.0	94.9	94.6

# **Technical Data for 208 V Systems**

# **Input Power Factor**

### Input Power Factor - 3:3 UPSs

The values are at 208 V, 60 Hz load.

	10 kVA	15 kVA	20 kVA
25% load	0.98	0.99	0.97
50% load	0.99	0.99	0.99
75% load	0.99	0.99	0.99
100% load	0.99	0.99	0.99

### Efficiency - 3:3 UPSs

# **Efficiency in Normal Mode**

The values are at a 208 V, 60 Hz load.

	10 kVA	15 kVA	20 kVA
25% load	90.7	92.8	93.1
50% load	92.1	92.9	93.5
75% load	91.9	92.0	92.7
100% load	91.6	91.1	92.1

### **Efficiency in ECO Mode**


	10 kVA	15 kVA	20 kVA
25% load	96.5	96.1	96.5
50% load	97.5	97.3	97.5
75% load	97.8	97.4	98.6
100% load	98.0	97.7	98.0

## **Efficiency in Battery Mode**

	10 kVA	15 kVA	20 kVA
25% load	90.4	92.4	92.6
50% load	91.8	93.3	93.4
75% load	92.0	92.8	93.0
100% load	91.8	91.8	92.5


# **Derating Due to Load Power Factor**

# 400 V Systems

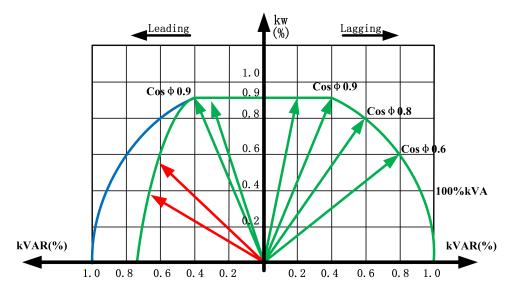

For  $0.9_{\text{lagging}} < \text{Cos}\Phi < 0.9_{\text{leading}}$ 


# 208 V Systems

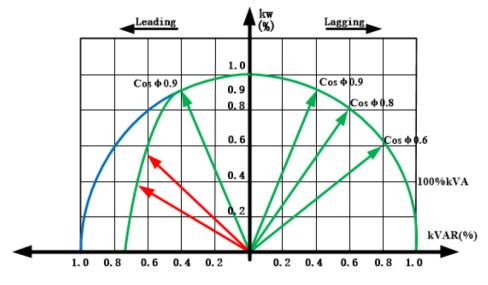

For 1  $_{\text{lagging}} < \cos \Phi < 0.9 _{\text{leading}}$ 

#### **Batteries**

# **End of Discharge Voltage**

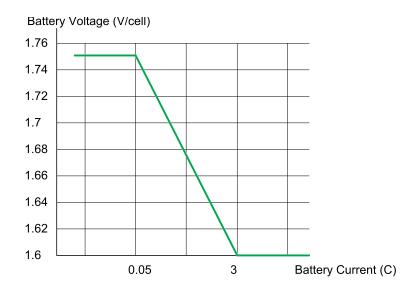

# **Battery Gassing Rates for Modular Battery Cabinets and UPSs with Internal Batteries**

The battery gassing rates are calculated based on:

- Gassing Rate at 2.4 V/cell (ft3 /hr) assuming 97% recombination efficiency
- · Six cells per battery module
- · Ten batteries per cartridge

Commercial Reference	Description	Typical cm³/hr (ml/hr)
E3SBTU	Standard battery module	10.73 (10.73)
E3SBT4	Standard battery string	42.93 (42.93)
E3SBTHU	High performance battery module	12.67 (12.67)
E3SBTH4 <sup>3</sup>	High performance battery string	50.68 (50.68)

# **Electrolyte Values for Modular Battery Cabinet and UPSs with Internal Batteries**

Commercial Reference	Description	Electrolyte Volume L (gal)	Electrolyte Weight kg (lbs)
E3SBTU	Standard battery module	3.780 (1)	5 (11.1)
E3SBT4	Standard battery string	15.120 (4)	20 (44.4)
E3SBTHU	High performance battery module	3.330 (0.9)	4.4 (9.8)
E3SBTH4	High performance battery string	13.320 (3.6)	17.6 (39.2)

<sup>3.</sup> Each battery string E3SBTH4 consists of four 9 Ah battery modules E3SBTHU.

### **Compliance**

Safety	IEC 62040-1:2017, Edition 2.0, Uninterruptible power systems (UPS) – Part 1: Safety requirements
	IEC 62040-1: 2008-6, 1st edition, Uninterruptible Power Systems (UPS) – Part 1: General and safety requirements for UPS
	IEC 62040-1:2013-01, 1st edition amendment 1
EMC/EMI/RFI	IEC 62040-2:2016, Edition 3.0, Uninterruptible power systems (UPS) – Part 2: Electromagnetic compatibility (EMC) requirements.
	IEC 62040-2:2005-10, 2nd edition, Uninterruptible Power Systems (UPS) – Part 2: Electromagnetic compatibility (EMC) requirements
Performance	IEC 62040-3: 2011-03, 2nd edition Uninterruptible Power Systems (UPS) - Part 3: Method of specifying the performance and test requirements
Markings	CE, RCM, EAC, WEEE, UKCA
Transportation	ISTA 2B
Pollution degree	2
Overvoltage category	III
Earthing system	TN, TT, or IT

### **Communication and Management**

- User interface with status LEDs and display
- RS232
- RS485
- Network management card
- Dry contacts
- USB

### **Facility Planning**

### Facility Planning for Easy UPS 3S 3:3 400 V

### Input Specifications - 3:3 UPSs

	10 kV	Ά	•	15 k\	/A		20 kV	/A		30 kV	Ά		40 kV	<b>/</b> A	
Voltage (V)	380	400	415	380	400	415	380	400	415	380	400	415	380	400	415
Connections <sup>4</sup>	L1, L2	L1, L2, L3, N, PE													
Input voltage range (V)	304–4	304–477													
Frequency range (Hz)	45–65	45–65													
Nominal input current (A)	16	15	15	24	23	22	32	31	30	48	46	44	65	61	59
Maximum input current (A)	19	18	18	29	28	26	38	37	36	58	55	53	78	73	71
Input current limitation (A)	22	20	20	33	31	30	44	42	41	65	63	60	89	83	80
Total harmonic distortion (THDI)	_		VA UPS 10 kVA				•	•						•	
Input power factor	> 0.99	)													
Maximum input shortcircuit withstand	Icc=1	0 kA													
Protection	Circui	t break	er and t	fuse						Fuse					
Ramp-in	15 se	15 seconds													

### Bypass Specifications - 3:3 UPSs

	10 kV	Α		15 kV	Ά		20 kV	Ά		30 kV	Ά		40 kV	Ά	
Voltage (V)	380	400	415	380	400	415	380	400	415	380	400	415	380	400	415
Connections	L1, L2	L1, L2, L3, N, PE													
Overload capacity	125–1 130–1	125% continuous 125–130% for 10 minutes 130–150% for 1 minute >150% for 300 milliseconds													
Minimum bypass voltage (V)	304	320	332	304	320	332	304	320	332	304	320	332	304	320	332
Maximum bypass voltage (V)	437	460	477	437	460	477	437	460	477	437	460	477	437	460	477
Frequency (Hz)	50 or	60	•					•							
Nominal bypass current (A)	15	14	14	23	22	21	30	29	28	46	43	42	61	58	56
Maximum input short circuit withstand	Icc=1	cc=10 kA													

<sup>4.</sup> It is mandatory to have the neutral line for the main input and load. If the main input or load does not have a neutral line, a △-Y transformer for main input or a Y-△ transformer for load needs to be installed. And the capacity of the transformer should be >1.2 times the rated capacity of the UPS

### Output Specifications - 3:3 UPSs

	10 kV	Α		15 kV	<b>′</b> A		20 kV	Ά		30 k\	/A		40 kV	Ά	
Voltage (V)	380	400	415	380	400	415	380	400	415	380	400	415	380	400	415
Connections 5	L1, L2	L1, L2, L3, N, PE													
Overload capacity	125% 150%	110% for 60 minutes 125% for 10 minutes 150% for 1 minute >150% for less than 200 milliseconds													
Output voltage tolerance	± 1%	± 1%													
Dynamic load response	40 mil	40 milliseconds													
Output power factor	1.0						1.06								
Nominal output current (A)	15	14	14	23	22	21	30	29	28	46	43	42	61	58	56
Output short circuit current	52 A/2	246 ms		58 A/	261 ms		82 A/255 ms 121 A/258 ms 18				181 A	181 A/253 ms			
Total harmonic distortion (THDU)			baland % non-												
Output frequency (Hz)	50 or	60													
Slew rate (Hz/sec)	Progra	ammab	le: 0.1	to 5.0. [	Default	s 2.0.									
Output performance classification (according to EN62040–3)	VFI-S	S-111													

### **Battery Specifications – 3:3 UPSs with Internal Batteries**

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA			
Charging power	Programmable from	1% to 20% of UPS ca	pacity. Default is 10%					
Maximum charging power (W)	2000	3000	4000	6000	8000			
Nominal battery voltage (VDC)	± 240	240						
Nominal float voltage (VDC)	± 270	270						
End of discharge voltage (full load) (VDC)	± 192	± 192						
End of discharge voltage (no load) (VDC)	± 210	± 210						
Battery current at full load and nominal battery voltage (A)	22	33	44	66	89			
Battery current at full load and minimum battery voltage (A)	27	40	54	81	107			
Temperature compensation (per cell)	Programmable from	Programmable from 0–5 mV. Default is 3 mV.						
Ripple current	< 5% C10							

<sup>5.</sup> It is mandatory to have the neutral line for the main input and load. If the main input or load does not have a neutral line, a △-Y transformer for main input or a Y-△ transformer for load needs to be installed. And the capacity of the transformer should be >1.2 times the rated capacity of the UPS.

<sup>6.</sup> When ambient temperature is below 30 °C. When the ambient temperature is above 30 °C, the power factor is 0.9.

#### **Battery Specifications – 3:3 UPSs for External Batteries**

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA			
Charging power	Programmable from	1% to 20% of UPS ca	pacity. Default is 10%.					
Maximum charging power (W)	2000	3000	4000	6000	8000			
Nominal battery voltage (16– 20 blocks) (VDC)	±192 to ± 240	:192 to ± 240						
Nominal float voltage (16–20 blocks) (VDC)	± 216 to ± 270	216 to ± 270						
End of discharge voltage (16–20 blocks) (full load) (VDC)	± 153 to ± 192	± 153 to ± 192						
End of discharge voltage (16–20 blocks) (no load) (VDC)	± 168 to ± 210	± 168 to ± 210						
Battery current at full load and nominal battery voltage (16–20 blocks) (A)	28–22	42–33	55–44	83–66	111–89			
Battery current at full load and minimum battery voltage (16–20 blocks) (A)	34–27	50–40	67–54	101–81	134–107			
Temperature compensation (per cell)	Programmable from	Programmable from 0–5 mV. Default is 3 mV.						
Ripple current	< 5% C10	< 5% C10						

#### Required Upstream Protection and Cable Sizes – 3:3 UPSs

**NOTE:** Overcurrent protection must be provided by others.

Cable sizes in this manual are based on table B.52.5 of IEC 60364-5-52 with the following assertions:

- 90 °C conductors
- An ambient temperature of 30 °C
- Use of copper conductors
- · Installation method C
- PE size is based on table 54.2 of IEC 60364-5-54.
- Specific to AC cables: Maximum length 70 m with a line voltage drop <3% installed on perforated cable trays, XLPE-type insulation, single layer trefoil formation, THDI between 15% and 33%, 35 °C at 400 V grouped in four touching cables</li>
- Specific to DC cables: Maximum length 15 m with a line voltage drop <1%</li>

**NOTE:** If neutral conductor is expected to carry a high current, due to lineneutral non-linear load, the circuit breaker must be rated according to expected neutral current.

**NOTE:** If the ambient temperature is greater than 30 °C, large conductors are to be used in accordance with the correction factors of the IEC.

**NOTE:** Recommended cable sizes and maximum allowable cable size may vary for the auxiliary products. Not all auxiliary products support aluminum cables. Refer to the installation manual provided with the auxiliary product.

**NOTE:** The DC cable sizes given here are recommendations – Always follow the specific instructions in the battery solution documentation for DC cable sizes and DC PE cable sizes and ensure that the DC cable sizes match the battery breaker rating.

#### 10 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-20A / C60H-C-20A iC65H-C-20A / C60H-C-20A	6	6
Bypass	iC65H-C-20A / C60H-C-20A	6	6
Output	C65N-B-4P-10A / C60N-B-4P-10A / C65N-B-4P-10A / C60N-C-4P-6A iC65N-4P-C4A	6	6
Battery	Compact NSX100F DC TM50D - 3P	8	8

#### 15 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-32A / C60H-C-32A iC65H-C-32A / C60H-C-32A	6	6
Bypass	iC65H-C-32A / C60H-C-32A	6	6
Output	C65N-B-4P-10A / C60N-B-4P-10A/ C65N-B-4P-10A / C60N-C-4P-6A iC65N-4P-C6A	6	6
Battery	Compact NSX100F DC TM63D - 3P	8	8

#### 20 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-40A / C60H-C-40A iC65H-C-40A / C60H-C-40A	10	10
Bypass	iC65H-C-40A / C60H-C-40A	10	10
Output	C65N-B-4P-10A / C60N-B-4P-10A/ C65N-B-4P-10A / C60N-C-4P-6A iC65N-4P-C6A	10	10
Battery	Compact NSX100F DC TM80D - 3P	25	16

#### 30 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-63A / C60H-C-63A / C120H-C-63A iC65H-C-63A / C60H-C-63A / C120H-C-63A	16	16
Bypass	iC65H-C-63A / C60H-C-63A / C120H-C-63A	16	16
Output	C65N-B-4P-16A / C60N-B-4P-16A / C65N-C-4P-10A / C60N-C-4P-10A iC65N-4P-C10A	16	16
Battery	Compact NSX160F DC TM125D - 3P	25	16

#### 40 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	C120H-C-80A / NSX100F TM80C 80A C120H-C-80A / NSX100F TM80C 80A	25	16
Bypass	C120H-C-80A / NSX100F TM80C 80A	25	16
Output	C65N-B-4P-20A / C60N-B-4P-20A / C65N-C-4P-10A / C60N-C-4P-10A iC65N-4P-C10A	25	16
Battery	Compact NSX160F DC TM160D - 3P	35	16

#### NOTE:

- These protection devices ensures discrimination for each of the Easy 3S output circuits. If the recommended downstream protection is not installed and a short-circuit occurs, the result may be a break longer than 50 ms on all the other output circuits.
- The recommended output branch breakers are for reference only.
   Whether to include the output branch breakers in your circuit depends on your use cases.

### **UPS Weights and Dimensions – 3:3 UPSs**

UPS	Weight kg	Height mm	Width mm	Depth mm
10 kVA UPS for external batteries	36	530	250	700
15 kVA UPS for external batteries	36	530	250	700
20 kVA UPS for external batteries	58	770	250	800
30 kVA UPS for external batteries	60	770	250	800
40 kVA UPS for external batteries	70	770	250	900
10 kVA UPS with internal batteries	1127	1400	380	928
15 kVA UPS with internal batteries	1127	1400	380	928
20 kVA UPS with internal batteries	122 <sup>7</sup>	1400	380	928
30 kVA UPS with internal batteries	152 <sup>7</sup>	1400	500	969
40 kVA UPS with internal batteries	158 <sup>7</sup>	1400	500	969
Battery	27	157	107	760

### **UPS Shipping Weights and Dimensions – 3:3 UPSs**

UPS	Weight kg	Height mm	Width mm	Depth mm
10 kVA UPS for external batteries	50	772	400	857
15 kVA UPS for external batteries	50	772	400	857
20 kVA UPS for external batteries	75	1015	400	982
30 kVA UPS for external batteries	77	1015	400	982
40 kVA UPS for external batteries	86	1015	400	1050
10 kVA UPS with internal batteries	1457	1640	563	1014
15 kVA UPS with internal batteries	1457	1640	563	1014
20 kVA UPS with internal batteries	1587	1640	563	1014
30 kVA UPS with internal batteries	1907	1640	683	1114
40 kVA UPS with internal batteries	1957	1640	683	1114
Battery	28	180	140	820

<sup>7.</sup> Weight without batteries

### Facility Planning for Easy UPS 3S 3:1 400 V

### Input Specifications – 3:1 UPSs

	10 kV	10 kVA 15 kVA		20 kV	<b>'</b> A		30 kV	<b>′</b> A				
Voltage (V)	380	400	415	380	400	415	380	400	415	380	400	415
Connections	L1, L2	2, L3, N	, PE		•	•						
Input voltage range (V)	304-4	304–477										
Frequency range (Hz)	45–6	5										
Nominal input current (A)	16	15	15	24	23	22	32	31	30	48	46	44
Maximum input current (A)	19	18	18	29	28	26	38	37	36	58	55	53
Input current limitation (A)	22	20	20	33	31	30	44	42	41	65	63	60
Total harmonic distortion (THDI)		for 10 k for 15–3			•	•	•					
Input power factor	> 0.99	9										
Maximum input shortcircuit withstand	Icc=10 kA											
Protection	Circuit breaker and fuse Fuse											
Ramp-in	15 se	15 seconds										

### Bypass Specifications – 3:1 UPSs

	10 kV	Ά		15 kV	Α		20 kV	Α		30 kV	Ά	
Voltage (V)	220	230	240	220	230	240	220	230	240	220	230	240
Connections	L, N, PE											
Overload capacity	125% continuous 125–130% for 10 minutes 130–150% for 1 minute >150% for 300 milliseconds											
Minimum bypass voltage (V)	176	184	192	176	184	192	176	184	192	176	184	192
Maximum bypass voltage (V)	253	264	276	253	264	276	253	264	276	253	264	276
Frequency (Hz)	50 or	60									•	
Nominal bypass current (A)	46	43	42	69	66	63	91	87	84	137	131	125
Maximum input short circuit withstand	Icc=10 kA											

### **Output Specifications – 3:1 UPSs**

	10 kV	10 kVA 15 kVA		20 kVA		30 kVA						
Voltage (V)	220	230	240	220	230	240	220	230	240	220	230	240
Connections	L, N, PE											
Overload capacity	125% 150%	110% for 60 minutes 125% for 10 minutes 150% for 1 minute >150% for less than 200 milliseconds										
Output voltage tolerance	± 1%	± 1%										
Dynamic load response	40 milliseconds											
Output power factor	1.0						1.08					
Nominal output current (A)	46	43	42	69	66	63	91	87	84	137	131	125
Output short circuit current	154 A	/242 m	s	168 A	/242 m	s	236 A	/247 m	s	339 A	/239 m	s
Total harmonic distortion (THDU)				ced line						•		
Output frequency (Hz)	50 or 60											
Slew rate (Hz/sec)	Programmable: 0.1 to 5.0. Default is 2.0.											
Output performance classification (according to EN62040–3)	VFI-S	S-111										

### Battery Specifications – 3:1 UPSs with Internal Batteries

	10 kVA	15 kVA	20 kVA	30 kVA		
Charging power	Programmable from	1% to 20% of UPS ca	pacity. Default is 10%			
Maximum charging power (W)	2000 3000 4000 6000					
Nominal battery voltage (VDC)	± 240					
Nominal float voltage (VDC)	± 270					
End of discharge voltage (full load) (VDC)	± 198					
End of discharge voltage (no load) (VDC)	± 210					
Battery current at full load and nominal battery voltage (A)	22	33	44	66		
Battery current at full load and minimum battery voltage (A)	27	40	54	81		
Temperature compensation (per cell)	Programmable from 0–5 mV. Default is 3 mV.					
Ripple current	< 5% C10					

<sup>8.</sup> When ambient temperature is below 30 °C. When the ambient temperature is above 30 °C, the power factor is 0.9.

#### **Battery Specifications – 3:1 UPSs for External Batteries**

	10 kVA	15 kVA	20 kVA	30 kVA		
Charging power	Programmable from	1% to 20% of UPS c	apacity. Default is 10%	).		
Maximum charging power (W)	2000 3000 4000 6000					
Nominal battery voltage (16–20 blocks) (VDC)	± 192 to ± 240					
Nominal float voltage (16–20 blocks) (VDC)	± 216 to ± 270					
End of discharge voltage (16–20 blocks) (full load) (VDC)	± 158 to ± 198					
End of discharge voltage (16–20 blocks) (no load) (VDC)	± 168 to ± 210					
Battery current at full load and nominal battery voltage (16–20 blocks) (A)	28–22	42–33	55–44	83–66		
Battery current at full load and minimum battery voltage (16–20 blocks) (A)	34–27 50–40 67–54 101–81		101–81			
Temperature compensation (per cell)	Programmable from 0–5 mV. Default is 3 mV.					
Ripple current	< 5% C10					

# Required Upstream and Downstream Protection and Cable Sizes – 3:1 UPSs

**NOTE:** Overcurrent protection must be provided by others.

Cable sizes in this manual are based on table B.52.5 of IEC 60364-5-52 with the following assertions:

- 90 °C conductors
- · An ambient temperature of 30 °C
- Use of copper conductors
- · Installation method C
- PE size is based on table 54.2 of IEC 60364-5-54
- Specific to AC cables: Maximum length 70 m with a line voltage drop <3% installed on perforated cable trays, XLPE-type insulation, single layer trefoil formation, THDI between 15% and 33%, 35 °C at 400 V grouped in four touching cables</li>
- Specific to DC cables: Maximum length 15 m with a line voltage drop <1%</li>

**NOTE:** If neutral conductor is expected to carry a high current, due to lineneutral non-linear load, the circuit breaker must be rated according to expected neutral current.

**NOTE:** If the ambient temperature is greater than 30 °C, large conductors are to be used in accordance with the correction factors of the IEC.

**NOTE:** Recommended cable sizes and maximum allowable cable size may vary for the auxiliary products. Not all auxiliary products support aluminum cables. Refer to the installation manual provided with the auxiliary product.

**NOTE:** The DC cable sizes given here are recommendations – Always follow the specific instructions in the battery solution documentation for DC cable sizes and DC PE cable sizes and ensure that the DC cable sizes match the battery breaker rating.

#### 10 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-50A / C60H-C-50A iC65H-C-20A / C60H-C-20A	16 6	16 6
Bypass	iC65H-C-50A / C60H-C-50A	16	16
Output	C65N-B-2P-25A/ C60N-B-2P-25A	16	16
Battery	Compact NSX100F DC TM50D - 3P	8	8

#### 15 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	C120H-C-80A / NSX100F TM80C 80A iC65H-C-32A / C60H-C-32A	25 6	16 6
Bypass	C120H-C-80A / NSX100F TM80C 80A	25	16
Output	C65N-B-2P-25A/ C60N-B-2P-25A	25	16
Battery	Compact NSX100F DC TM63D - 3P	8	8

#### 20 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	C120H-C-100A / NSX100F TM100C 100A iC65H-C-40A / C60H-C-40A	35 10	16 10
Bypass	C120H-C-100A / NSX100F TM100C 100A	35	16
Output	C65N-B-2P-32A/ C60N-B-2P-32A	35	16
Battery	Compact NSX100F DC TM80D - 3P	16	16

#### 30 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	Compact NSX160F TM160C 160A iC65H-C-63A / C60H-C-63A / C120H-C-63A	50 16	25 16
Bypass	Compact NSX160F TM160C 160A	50	25
Output	C65N-B-2P-50A/ C60N-B-2P-50A	50	25
Battery	Compact NSX160F DC TM125D - 3P	25	16

#### NOTE:

- These protection device ensures discrimination for each of the Easy 3S output circuits.
- If the recommended downstream protection is not installed and a shortcircuit occurs, the result may be a break longer than 50 ms on all the other output circuits.
- The recommended output branch breakers are for reference only.
   Whether to include the output branch breakers in your circuit depends on your use cases.

### Weights and Dimensions – 3:1 UPSs

UPS	Weight kg	Height mm	Width mm	Depth mm
10 kVA 3:1 UPS for external batteries	36	530	250	700
15 kVA 3:1 UPS for external batteries	36	530	250	700
20 kVA 3:1 UPS for external batteries	58	770	250	800
30 kVA 3:1 UPS for external batteries	60	770	250	800
10 kVA 3:1 UPS with internal batteries	130 <sup>9</sup>	1400	380	907
15 kVA 3:1 UPS with internal batteries	130 <sup>9</sup>	1400	380	907
20 kVA 3:1 UPS with internal batteries	150 <sup>9</sup>	1400	380	907
30 kVA 3:1 UPS with internal batteries	185 <sup>9</sup>	1400	500	996
Battery	27	157	107	760

### **Shipping Weights and Dimensions – 3:1 UPSs**

UPS	Weight kg	Height mm	Width mm	Depth mm
10 kVA 3:1 UPS for external batteries	50	772	400	857
15 kVA 3:1UPS for external batteries	50	772	400	857
20 kVA 3:1 UPS for external batteries	75	1015	400	982
30 kVA 3:1 UPS for external batteries	77	1015	400	982
10 kVA 3:1 UPS with internal batteries	145 <sup>9</sup>	1640	563	1014
15 kVA 3:1 UPS with internal batteries	145 <sup>9</sup>	1640	563	1014
20 kVA 3:1 UPS with internal batteries	158 <sup>9</sup>	1640	563	1014
30 kVA 3:1 UPS with internal batteries	185 <sup>9</sup>	1640	683	1114
Battery	28	180	140	820

<sup>9.</sup> Weight without batteries.

### Facility Planning for Easy UPS 3S 3:3 208 V

### Input Specifications - 3:3 UPSs

	10 kV	Ά		15 k	VA		20 kV	Ά	
Voltage (V)	200	208	220	200	208	220	200	208	220
Connections <sup>10</sup>	L1, L2	2, L3, N	, PE					•	
Input voltage range (V)	180-2	:53							
Frequency range (Hz)	45–65	5							
Nominal input current (A)	32	31	29	48	46	43	63	61	58
Maximum input current (A)	36	34	32	53	51	49	70	68	65
Input current limitation (A)	42	40	38	63	60	57	83	80	76
Total harmonic distortion (THDI)	<4%				,		•	•	
Input power factor	> 0.99	9							
Maximum input shortcircuit withstand	Icc=1	0 kA							
Protection	Circui	Circuit breaker and fuse Fuse							
Ramp-in	15 se	15 seconds							

### Bypass Specifications - 3:3 UPSs

	10 kVA			15 kVA		20 kVA		Α	
Voltage (V)	200	208	220	200	208	220	200	208	220
Connections	L1, L2, L3, N, PE								
Overload capacity	110% continuous 110–120% for 10 minutes 120–135% for 1 minute >135% for 300 milliseconds								
Minimum bypass voltage (V)	180	187	198	180	187	198	180	187	198
Maximum bypass voltage (V)	230	240	253	230	240	253	230	240	253
Frequency (Hz)	50 or 60								
Nominal bypass current (A)	29 28 27 44 42 40 58 56 53		53						
Maximum input short circuit withstand	Icc=10 kA				•				

<sup>10.</sup> It is mandatory to have the neutral line for the main input and load. If the main input or load does not have a neutral line, a △-Y transformer for main input or a Y-△ transformer for load needs to be installed. And the capacity of the transformer should be >1.2 times the rated capacity of the UPS.

### **Output Specifications – 3:3 UPSs**

	10 kVA 15 kVA			20 kV	Ά				
Voltage (V)	200	208	220	200	208	220	200	208	220
Connections <sup>11</sup>	L1, L2	2, L3, N	, PE					•	
Overload capacity	125% 150%	110% for 60 minutes 125% for 10 minutes 150% for 1 minute >150% for less than 200 milliseconds							
Output voltage tolerance	± 1%	± 1%							
Dynamic load response	40 mi	llisecon	ds						
Output power factor	1.0								
Nominal output current (A)	29	28	27	44	42	40	58	56	53
Output short circuit current	77 A/2	223 ms		111 A	/248 ms	3	177 A	/252 m	s
Total harmonic distortion (THDU)			linear load non-linear load						
Output frequency (Hz)	50 or 60								
Slew rate (Hz/sec)	Programmable: 0.1 to 5.0. Default is 2.0.								
Output performance classification (according to EN62040–3)	VFI-S	S-111							

### **Battery Specifications – 3:3 UPSs with Internal Batteries**

	10 kVA	15 kVA	20 kVA	
Charging power	Programmable from 1% to 20% of UPS capacity. Default is 10%.			
Maximum charging power (W)	2000 3000 4000			
Nominal battery voltage (VDC)	± 120			
Nominal float voltage (VDC)	± 135			
End of discharge voltage (full load) (VDC)	± 96			
End of discharge voltage (no load) (VDC)	± 105			
Battery current at full load and nominal battery voltage (A)	46	68	92	
Battery current at full load and minimum battery voltage (A)	56	83	111	
Temperature compensation (per cell)	Programmable from 0-5 mV. Default is 3 mV.			
Ripple current	< 5% C10			

<sup>11.</sup> It is mandatory to have the neutral line for the main input and load. If the main input or load does not have a neutral line, a △-Y transformer for main input or a Y-△ transformer for load needs to be installed. And the capacity of the transformer should be >1.2 times the rated capacity of the UPS.

#### **Battery Specifications – 3:3 UPSs for External Batteries**

	10 kVA	15 kVA	20 kVA
Charging power	Programmable from 1% to 20% of UPS capacity. Default is 10%.		
Maximum charging power (W)	2000 3000 4000		
Nominal battery voltage (10 blocks) (VDC)	±120		
Nominal float voltage (10 blocks) (VDC)	± 135		
End of discharge voltage (10 blocks) (full load) (VDC)	± 96		
End of discharge voltage (10 blocks) (no load) (VDC)	± 105		
Battery current at full load and nominal battery voltage (10 blocks) (A)	46	68	92
Battery current at full load and minimum battery voltage (10 blocks) (A)	56	83	111
Temperature compensation (per cell)	Programmable from 0–5 mV. Default is 3 mV.		
Ripple current	< 5% C10		

#### Required Upstream Protection and Cable Sizes – 3:3 UPSs

**NOTE:** Overcurrent protection must be provided by others.

Cable sizes in this manual are based on table B.52.5 of IEC 60364-5-52 with the following assertions:

- 90 °C conductors
- Ambient temperature of 30 °C
- Use of copper conductors
- · Installation method C
- PE size is based on table 54.2 of IEC 60364-5-54.
- Specific to AC cables: Maximum length 70 m with a line voltage drop <3% installed on perforated cable trays, XLPE-type insulation, single layer trefoil formation, THDI between 15% and 33%, 35 °C at 208 V grouped in four touching cables</li>
- Specific to DC cables: Maximum length 15 m with a line voltage drop <1%</li>

**NOTE:** If neutral conductor is expected to carry a high current, due to lineneutral non-linear load, the circuit breaker must be rated according to expected neutral current.

**NOTE:** If the ambient temperature is greater than 30 °C, large conductors are to be used in accordance with the correction factors of the IEC.

**NOTE:** Recommended cable sizes and maximum allowable cable size may vary for the auxiliary products. Not all auxiliary products support aluminum cables. Refer to the installation manual provided with the auxiliary product.

**NOTE:** The DC cable sizes given here are recommendations – Always follow the specific instructions in the battery solution documentation for DC cable sizes and DC PE cable sizes and ensure that the DC cable sizes match the battery breaker rating.

#### 10 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-40A / C60H-C-40A iC65H-C-40A / C60H-C-40A	10	10
Bypass	iC65H-C-40A / C60H-C-40A	10	10

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Output	C65N-B-4P-10A / C60N-B-4P-10A / C65N-B-4P-10A / C60N-C-4P-6A	10	10
Battery	Compact NSX100F DC TM80D - 3P	25	16

#### 15 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	iC65H-C-63A / C60H-C-63A / C120H-C-63A iC65H-C-63A / C60H-C-63A / C120H-C-63A	16	16
Bypass	iC65H-C-63A / C60H-C-63A / C120H-C-63A	16	16
Output	C65N-B-4P-16A / C60N-B-4P-16A / C65N-C-4P-10A / C60N-C-4P-10A	16	16
Battery	Compact NSX160F DC TM125D - 3P	25	16

#### 20 kVA UPS

	Breaker type	Cable size per phase (mm²)	PE cable size (mm²))
Input – single mains Input – dual mains	C120H-C-80A / NSX100F TM80C 80A C120H-C-80A / NSX100F TM80C 80A	25	16
Bypass	C120H-C-80A / NSX100F TM80C 80A	25	16
Output	C65N-B-4P-20A / C60N-B-4P-20A / C65N-C-4P-10A / C60N-C-4P-10A	25	16
Battery	Compact NSX160F DC TM160D - 3P	35	16

#### NOTE:

- These protection devices ensures discrimination for each of the Easy 3S output circuits. If the recommended downstream protection is not installed and a short-circuit occurs, the result may be a break longer than 50 ms on all the other output circuits.
- The recommended output branch breakers are for reference only.
   Whether to include the output branch breakers in your circuit depends on your use cases.

### **UPS Weights and Dimensions – 3:3 UPSs**

UPS	Weight kg	Height mm	Width mm	Depth mm
10 kVA UPS for external batteries	58	770	250	800
15 kVA UPS for external batteries	60	770	250	800
20 kVA UPS for external batteries	70	770	250	900
10 kVA UPS with internal batteries	12212	1400	380	928
15 kVA UPS with internal batteries	152 <sup>12</sup>	1400	500	969

<sup>12.</sup> Weight without batteries

UPS	Weight kg	Height mm	Width mm	Depth mm
20 kVA UPS with internal batteries	158 <sup>13</sup>	1400	500	969
Battery	27	157	107	760

### **UPS Shipping Weights and Dimensions – 3:3 UPSs**

UPS	Weight kg	Height mm	Width mm	Depth mm
10 kVA UPS for external batteries	75	1015	400	982
15 kVA UPS for external batteries	77	1015	400	982
20 kVA UPS for external batteries	86	1015	400	1050
10 kVA UPS with internal batteries	158 <sup>13</sup>	1640	563	1014
15 kVA UPS with internal batteries	190 <sup>13</sup>	1640	683	1114
20 kVA UPS with internal batteries	195 <sup>13</sup>	1640	683	1114
Battery	28	180	140	820

### **Recommended Bolts and Cable Lugs**

Cable Size (mm²)	Bolt Size	Cable Lug Type	Note
6	M5	KST TLK6-5	If the recommended lug type is not available, use a local M5 lug
8	M5	KST RNBS8-5	type as a substitute.
10	M6	KST TLK10-6	If the recommended lug type is not available, use a local M6 lug
16	M6	KST TLK16-6	type as a substitute.
25	M6	KST DRNB6-25	
35	M6	KST TLK35-6	
50	M8	KST TLK50-8	If the recommended lug type is not available, use a local M8 lug type as a substitute.

### **Torque Specifications**

Bolt Size	Torque
M5	4 Nm
M6	5 Nm
M8	12 Nm


13. Weight without batteries

#### **Clearance**

**NOTE:** Clearance dimensions are published for airflow and service access only. Consult with the local safety codes and standards for additional requirements in your local area.


**NOTE:** If the UPS is installed without side access (Option A\*), the length of the cables connected to the UPS must allow for rolling out the UPS.

#### **Clearance for UPS for External Batteries**

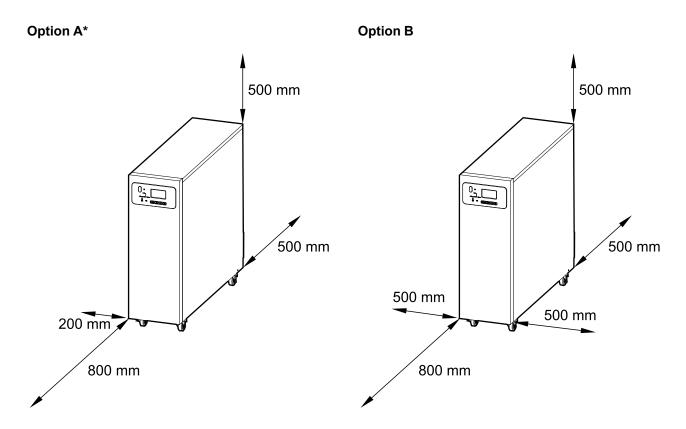

**NOTE:** 200 mm left side clearance is required when the UPS is placed next to a wall to allow the front door to open properly.

#### **Clearance for UPS with Internal Batteries**

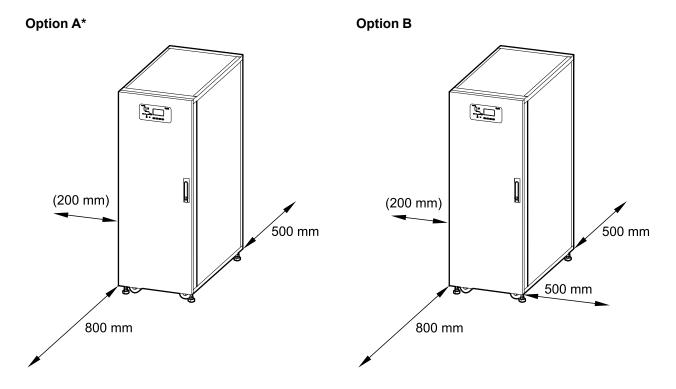

**NOTE:** 200 mm left side clearance is required when the UPS is placed next to a wall to allow the front door to open properly.

### **Environmental**

	Operation	Storage		
Temperature	0 °C to 40 °C 20 °C to 25 °C (optimal operation temperature for batteries)	-15 °C to 40 °C for systems with batteries -25 °C to 55 °C for systems without batteries		
Relative humidity	0-95% non-condensing			
Elevation derating according to IEC 62040–3	1000 m: 1.000 1500 m: 0.975 2000 m: 0.950	< 15000 m above sea level (or in an environment with equivalent air pressure)		
Audible noise	10–20 kVA 400 V: <60 dBA at full load 30–40 kVA 400 V: <63 dBA at full load 10–20 kVA 208 V: <63 dBA at full load			
Protection class	IP20 (dust filter as standard)			
Color	RAL 9003	RAL 9003		

### **Heat Dissipation for 400 V Systems**

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA
Normal mode (W)	516	852	870	1410	1810
Battery mode (W)	600	950	1080	1700	2270
ECO mode (W)	135	223	240	370	480

### **Heat Dissipation for 208 V Systems**

	10 kVA	15 kVA	20 kVA
Normal mode (W)	920	1469	1701
Battery mode (W)	948	1247	1861
ECO mode (W)	245	358	415

### **Airflow Requirement for 400 V Systems**

**NOTE:** The UPS requires a sufficient amount of fresh air in the installation room.

	10 kVA	15 kVA	20 kVA	30 kVA	40 kVA
Fan air throughput (m³/min)	6.20	8.25	10.85	15.57	16.38

### **Airflow Requirement for 208 V Systems**

**NOTE:** The UPS requires a sufficient amount of fresh air in the installation room.


	10 kVA	15 kVA	20 kVA
Fan air throughput (m³/min)	10.85	15.57	16.38

### **Drawings**


**NOTE:** A comprehensive set of drawings is available on www.se.com.

**NOTE:** These drawings are for reference ONLY – subject to change without notice.


### Easy UPS 3S for External Batteries - Single Mains System

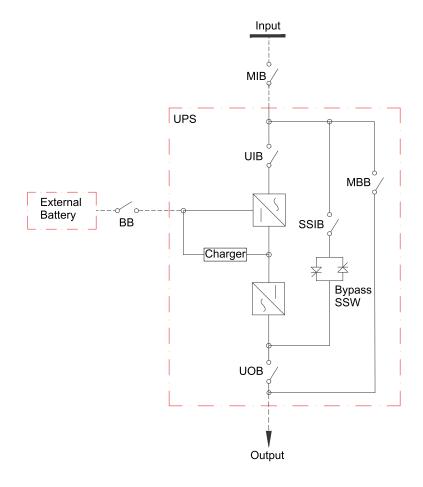


### **Easy UPS 3S for External Batteries – Dual Mains System**

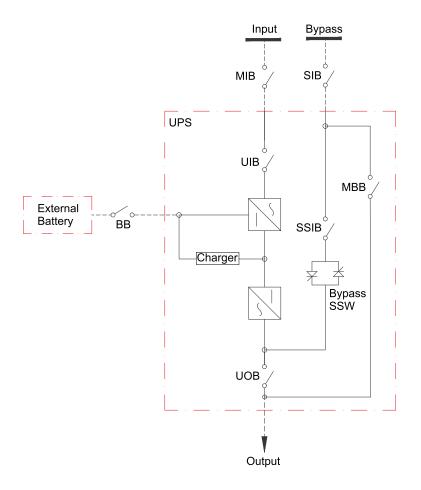

# Easy UPS 3S with Internal Batteries – Single Mains System

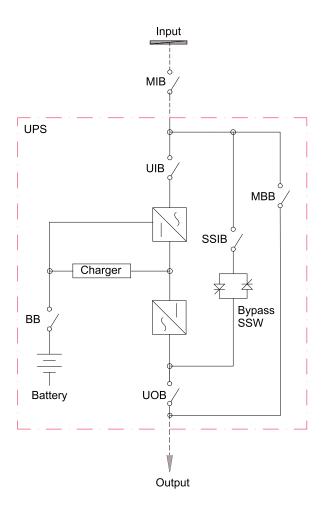

### **Easy UPS 3S with Internal Batteries – Dual Mains System**

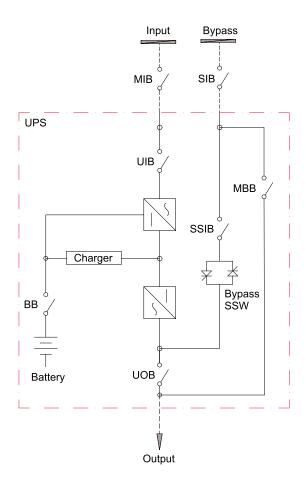

### **Options**

### **Configuration Options**

- Single or dual mains
- · Bottom cable entry
- Up to four UPSs in parallel
- ECO mode

### **Hardware Options**

#### **Modular Battery Cabinet**

Easy UPS 3S modular battery cabinet (E3SXR6)

#### **Battery Breaker Box**

• Easy UPS 3S battery breaker box (E3SOPT007)

#### **Battery Breaker Kit**

Easy UPS 3S battery breaker kit (E3SOPT008)

#### **Empty Battery Cabinets**

- Empty battery cabinet, 700 mm wide (GVEBC7)
- Empty battery cabinet, 1100 mm wide (GVEBC11)

#### **Batteries**

- Easy UPS 3S standard battery module (E3SBTU)
- Easy UPS 3S high performance battery module (E3SBTHU)
- Easy UPS 3S standard battery string (E3SBT4)
- Easy UPS 3S high performance battery string (E3SBTH4)

#### **Maintenance Bypass Panels**

- Easy UPS 3S parallel maintenance bypass panel for up to 2 units 10-40 kVA (E3SOPT006)
- Maintenance Bypass Panel, single unit, 10-400kVA 400V wallmount, for Easy UPS 3-Phase (E3MBP60K400H)
- Parallel Maintenance Bypass Panel, 10-200kVA 400V wallmount, for Easy UPS 3S/3M (E3MBPAR60K200H)
- Parallel Maintenance Bypass Panel for 2 UPSs, 40-50kW 400V wallmount, for Galaxy VS and Easy UPS 3S (GVSBPAR40K50H)

- Parallel Maintenance Bypass Panel for 2 UPSs, 60-120kW 400V wallmount for Galaxy VS & Easy UPS 3S/3M (GVSBPAR60K120H)
- Maintenance Bypass Panel, single unit, 10-20kW 400V wallmount, for Galaxy VS and Easy UPS 3S (GVSBPSU10K20H)
- Maintenance Bypass Panel, single unit, 20-60kW 400V wallmount, for Galaxy VS and Easy UPS 3S (GVSBPSU20K60H)
- Maintenance Bypass Panel, single unit, 80-120kW 400V wallmount, for Galaxy VS and Easy UPS 3S/3M (GVSBPSU80K120H)

#### **Backfeed Box**

 Wall-mount box with 95A power contactor and connections that delivers backfeed protection for 400V Easy UPS 3S 10-40 kVA 3:1 and 3:3 (SP3OPT008)

#### **Options**

- Easy UPS 3S parallel kit (E3SOPT002)
- Easy UPS 3S temperature sensor kit for external battery system (E3SOPT003)
- Easy UPS 3S cold start kit (E3SOPT004) 14
- · Easy UPS battery connector kit (E3SOPT009)
- Easy UPS 3S parallel kit with 15m cable (E3SOPT016)
- Wall-mount cabinet with 95 A power contactor and connections that delivers backfeed protection for Easy UPS 3S 10-40 kVA 400 V (SP3OPT008)

**NOTE:** Cold start function must be used together with the MX trip coil, recommended Schneider Electric MX trip coil LV429390.

<sup>14.</sup> 

### **Weights and Dimensions for Options**

**NOTE:** Not all options listed here are available for all UPS models. Refer to the hardware options list for the relevant UPS model.

### **Battery Breaker Box Shipping Weights and Dimensions**

	Weight kg	Height mm	Width mm	Depth mm
Battery breaker box (E3SOPT007)	46.5	1220	850	510

### **Battery Breaker Box Weights and Dimensions**

	Weight kg	Height mm	Width mm	Depth mm
Battery breaker box (E3SOPT007)	25	650	500	280

# **Modular Battery Cabinet Shipping Weights and Dimensions**

Commercial reference	Weight kg (lbs)	Height mm (in)	Width mm (in)	Depth mm (in)
E3SXR6	140	1620	650	1020

### **Modular Battery Cabinet Weights and Dimensions**

Commercial reference	Weight kg (lbs)	Height mm (in)	Width mm (in)	Depth mm (in)
E3SXR6	125	1400	500	851

### **Backfeed Box Shipping Weights and Dimensions**

Commercial reference	Weight kg (lbs)	Height mm (in)	Width mm (in)	Depth mm (in)
SP3OPT008	30	530	780	460
SP3OPT009	48	835	835	510
SP3OPT010	76	940	1050	660

**NOTE:** Shipping weights and dimensions are for one unit on a wooden pallet.

### **Backfeed Box Weights and Dimensions**

Commercial reference	Weight kg (lbs)	Height mm (in)	Width mm (in)	Depth mm (in)
SP3OPT008	20	300	550	200
SP3OPT009	33	600	600	250
SP3OPT010	58	800	700	400

### **Limited Factory Warranty**

### **One-Year Factory Warranty**

The limited warranty provided by Schneider Electric in this Statement of Limited Factory Warranty applies only to products you purchase for your commercial or industrial use in the ordinary course of your business.

### **Terms of Warranty**

Schneider Electric warrants that the product shall be free from defects in materials and workmanship for a period of one year from the date of product start-up, when start-up is performed by Schneider Electric-authorized service personnel, or within 18 months from the shipment date from Schneider Electric, whichever occurs first. This warranty covers repairing or replacing any defective parts including on-site labor and travel. In the event that the product fails to meet the foregoing warranty criteria, the warranty covers repairing or replacing defective parts at the sole discretion of Schneider Electric for a period of one year from the shipment date.

### Non-transferable Warranty

This warranty is extended to the first person, firm, association or corporation (herein referred to by "You" or "Your") for whom the Schneider Electric product specified herein has been purchased. This warranty is not transferable or assignable without the prior written permission of Schneider Electric.

### **Assignment of Warranties**

Schneider Electric will assign you any warranties which are made by manufacturers and suppliers of components of the Schneider Electric product and which are assignable. Any such warranties are assigned "AS IS" and Schneider Electric makes no representation as to the effectiveness or extent of such warranties, assumes no responsibility for any matters which may be warranted by such manufacturers or suppliers and extends no coverage under this Warranty to such components.

### **Drawings, Descriptions**

Schneider Electric warrants for the warranty period and on the terms of the warranty set forth herein that the Schneider Electric product will substantially conform to the descriptions contained in the Schneider Electric Official Published Specifications or any of the drawings certified and agreed to by contract with Schneider Electric if applicable thereto ("Specifications"). It is understood that the Specifications are not warranties of performance and not warranties of fitness for a particular purpose.

#### **Exclusions**

Schneider Electric shall not be liable under the warranty if its testing and examination disclose that the alleged defect in the product does not exist or was

caused by end user or any third person misuse, negligence, improper installation or testing. Further, Schneider Electric shall not be liable under the warranty for unauthorized attempts to repair or modify wrong or inadequate electrical voltage or connection, inappropriate on-site operation conditions, corrosive atmosphere, repair, installation, start-up by non-Schneider Electric designated personnel, a change in location or operating use, exposure to the elements, Acts of God, fire, theft, or installation contrary to Schneider Electric recommendations or specifications or in any event if the Schneider Electric serial number has been altered, defaced, or removed, or any other cause beyond the range of the intended use.

THERE ARE NO WARRANTIES, EXPRESS OR IMPLIED, BY OPERATION OF LAW OR OTHERWISE, OF PRODUCTS SOLD, SERVICED OR FURNISHED UNDER THIS AGREEMENT OR IN CONNECTION HEREWITH. SCHNEIDER ELECTRIC DISCLAIMS ALL IMPLIED WARRANTIES OF MERCHANTABILITY, SATISFACTION AND FITNESS FOR A PARTICULAR PURPOSE. SCHNEIDER ELECTRIC EXPRESS WARRANTIES WILL NOT BE ENLARGED, DIMINISHED, OR AFFECTED BY AND NO OBLIGATION OR LIABILITY WILL ARISE OUT OF, SCHNEIDER ELECTRIC RENDERING OF TECHNICAL OR OTHER ADVICE OR SERVICE IN CONNECTION WITH THE PRODUCTS. THE FOREGOING WARRANTIES AND REMEDIES ARE EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES AND REMEDIES. THE WARRANTIES SET FORTH ABOVE CONSTITUTE SCHNEIDER ELECTRIC SOLE LIABILITY AND PURCHASER'S EXCLUSIVE REMEDY FOR ANY BREACH OF SUCH WARRANTIES. SCHNEIDER ELECTRIC WARRANTIES RUN ONLY TO PURCHASER AND ARE NOT EXTENDED TO ANY THIRD PARTIES.

IN NO EVENT SHALL SCHNEIDER ELECTRIC, ITS OFFICERS, DIRECTORS, AFFILIATES OR EMPLOYEES BE LIABLE FOR ANY FORM OF INDIRECT, SPECIAL, CONSEQUENTIAL OR PUNITIVE DAMAGES, ARISING OUT OF THE USE, SERVICE OR INSTALLATION, OF THE PRODUCTS, WHETHER SUCH DAMAGES ARISE IN CONTRACT OR TORT, IRRESPECTIVE OF FAULT, NEGLIGENCE OR STRICT LIABILITY OR WHETHER SCHNEIDER ELECTRIC HAS BEEN ADVISED IN ADVANCE OF THE POSSIBILITY OF SUCH DAMAGES, SPECIFICALLY, SCHNEIDER ELECTRIC IS NOT LIABLE FOR ANY COSTS, SUCH AS LOST PROFITS OR REVENUE, LOSS OF EQUIPMENT, LOSS OF USE OF EQUIPMENT, LOSS OF SOFTWARE, LOSS OF DATA, COSTS OF SUBSTITUANTS, CLAIMS BY THIRD PARTIES, OR OTHERWISE.

NO SALESMAN, EMPLOYEE OR AGENT OF SCHNEIDER ELECTRIC IS AUTHORIZED TO ADD TO OR VARY THE TERMS OF THIS WARRANTY. WARRANTY TERMS MAY BE MODIFIED, IF AT ALL, ONLY IN WRITING SIGNED BY AN SCHNEIDER ELECTRIC OFFICER AND LEGAL DEPARTMENT.

### **Warranty Claims**

Customers with warranty claims issues may access the SCHNEIDER ELECTRIC worldwide customer support network through the SCHNEIDER ELECTRIC web site: http://www.schneider-electric.com. Select your country from the country selection pull-down menu. Open the Support tab at the top of the web page to obtain contact information for customer support in your region.

## **Appendix: Switch/Breaker Details**

### 3:1 **UPS**

	Model	Switch/Breaker	Description	Switch or Breaker
10 kVA	UIB	OSMC65H4C32	32A 4P	Breaker
	SIB	OSMC65H4C32	32A 4P	Breaker
	UOB	A9S68263	63A 2P	Switch
	MBB	A9S68163	63A 1P	Switch
	ВВ	A9S68332	32A 3P	Switch (for UPSs with internal batteries)
15 kVA	UIB	OSMC65H4C40	40A 4P	Breaker
	SIB	OSMC65H4C40	40A 4P	Breaker
	UOB	A9S68280	80A 2P	Switch
	MBB	A9S68180	80A 1P	Switch
	ВВ	A9S68363	63A 3P	Switch (for UPSs with internal batteries)
20 kVA	UIB	OSMC65H4C63	63A 4P	Breaker
	SIB	OSMC65H4C63	63A 4P	Breaker
	UOB	A9S68292	125A 2P	Switch
	MBB	A9S68192	125A 1P	Switch
	ВВ	A9S68363	63A 3P	Switch (for UPSs with internal batteries)
30 kVA	UIB	A9S68480	500VAC 80A 4P	Switch
_	SIB	A9S68491	100A 4P	Switch
	UOB	A9S68491	100A 4P	Switch
	MBB	A9S68280	80A 2P	Switch
	ВВ	A9S68391	100A 3P	Switch (for UPSs with internal batteries)

### 3:3 **UPS**

	Model	Switch/Breaker	Description	Switch or Breaker
10 kVA	UIB	OSMC65H4C32	32A 4P	Breaker
	SIB	OSMC65H4C32	32A 4P	Breaker
	UOB	A9S68432	32A 4P	Switch
	MBB	OSMC65H3C32	32A 3P	Breaker
	ВВ	A9S68332	32A 3P	Switch (for UPSs with internal batteries)
15 kVA	UIB	OSMC65H4C40	40A 4P	Breaker
	SIB	OSMC65H4C40	40A 4P	Breaker
	UOB	A9S68440	40A 4P	Switch
	MBB	OSMC65H3C40	40A 3P	Breaker
	ВВ	A9S68363	63A 3P	Switch (for UPSs with internal batteries)
20 kVA	UIB	OSMC65H4C63	63A 4P	Breaker
	SIB	OSMC65H4C63	63A 4P	Breaker
	UOB	A9S68463	63A 4P	Switch
	MBB	OSMC65H3C50	50A 3P	Breaker
	ВВ	A9S68363	63A 3P	Switch (for UPSs with internal batteries)

30 kVA	UIB	A9S68480	500VAC 80A 4P	Switch
	SIB	A9S68480	500VAC 80A 4P	Switch
	UOB	A9S68480	500VAV 80A 4P	Switch
	MBB	A9S68363	500VAC 63A 3P	Switch
	ВВ	A9S68391	100A 3P	Switch (for UPSs with internal batteries)
40 kVA	UIB	A9S68492	125A 4P	Switch
	SIB	A9S68492	125A 4P	Switch
	UOB	A9S68492	125A 4P	Switch
	MBB	A9S68380	80A 3P	Switch
	ВВ	A9S68392	125A 3P	Switch (for UPSs with internal batteries)

Schneider Electric 35 rue Joseph Monier 92500 Rueil Malmaison France

+ 33 (0) 1 41 29 70 00



As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2017 – 2024 Schneider Electric. All rights reserved.

990-91077K-001