

Energy Monitoring (IEC)

Identify Quick-Win Opportunities for Energy Savings

EcoStruxure Power Digital Application

ESXP2GE002EN-05
11/2023

EcoStruxure™ Power



Legal Information

The information provided in this document contains general descriptions, technical characteristics and/or recommendations related to products/solutions.

This document is not intended as a substitute for a detailed study or operational and site-specific development or schematic plan. It is not to be used for determining suitability or reliability of the products/solutions for specific user applications. It is the duty of any such user to perform or have any professional expert of its choice (integrator, specifier or the like) perform the appropriate and comprehensive risk analysis, evaluation and testing of the products/solutions with respect to the relevant specific application or use thereof.

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this document are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owner.

This document and its content are protected under applicable copyright laws and provided for informative use only. No part of this document may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the document or its content, except for a non-exclusive and personal license to consult it on an "as is" basis.

Schneider Electric reserves the right to make changes or updates with respect to or in the content of this document or the format thereof, at any time without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this document, as well as any non-intended use or misuse of the content thereof.

AccuSine™, Acti 9™, Altivar™, ASCO™, BlokSeT™, ComPacT™, EcoStruxure™, EnerLin'X™, ETAP™, EVlink™, EvoPacT™, Galaxy™, Harmony™, Iso-Gard™, Masterclad™, MasterPacT™, MicroLogic™, Modicon™, Okken™, PowerLink™, PowerLogic™, PowerPacT™, Power-Zone™, PremSeT™, PrismaSeT™, Schneider Electric™, SM AirSeT™, Square D™, SureSeT™, TeSys™, TransferPacT™, Trihal™, and Vigilohm™ are trademarks and the property of Schneider Electric SE, its subsidiaries, and affiliated companies. All other trademarks (Cyber Sciences™, Hirschmann™) are the property of their respective owners.

Table of Contents

Overview	5
Context of Application	5
Application Outcomes	5
Electrical Architecture	8
Digital Architecture.....	9
System Description.....	10
Data Flow	10
Inputs	10
Data Recording and Timestamping	11
Time Synchronization	12
Data Processing	12
Outputs.....	13

Overview

Context of Application

There are numerous opportunities for saving energy in a building or critical facility. However, not all lead to profitable return on investment. In order to choose quick-win conservation measures, energy in the facility must be monitored to understand where and how it is consumed, and to understand which factors contribute the most to energy consumption and cost.

Problem to Solve

The facility/energy manager needs to:

- Raise awareness of where, when, and how energy is used.
- Find and prioritize opportunities for energy conservation.

Purpose of the Application

Become aware of energy usage

- By turning data into information and representing energy usage and consumption within easy-to-interpret graphical dashboards and reports to raise awareness of key stakeholders.

Identify quick-win opportunities for energy savings

- By comparing and visualizing hourly, daily, weekly, monthly, and yearly energy usage, and associated costs for different utilities.
- By identifying and prioritizing which load types, equipment, processes, areas, or buildings lend themselves to a better return on investment for energy conservation initiatives.

Application Outcomes

Live Data Display

Real-time energy data displayed in configurable diagrams or real-time data tables

Events and Alarms

Configure and visualize energy overconsumption events to display in a historical event log.

Trends


Monitor consumption (WAGES)¹ for the whole facility, specific areas, or loads in real-time charts.

1. Water, Air, Gas, Electricity, Steam


Dashboards

- Historical trends
- Energy consumption ranking
- Energy heat map
- Pareto charts
- Sankey diagram


NOTE: Any of the dashboards shown can be included as part of a slideshow ("Energy Kiosk").

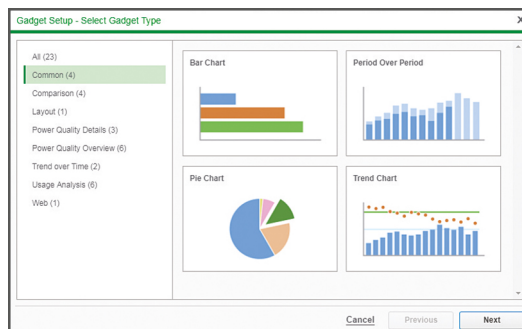

Configurable Dashboard Gadget Library for Analyzing Energy Usage

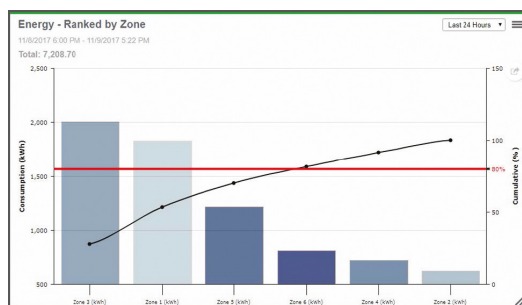


Pareto Chart

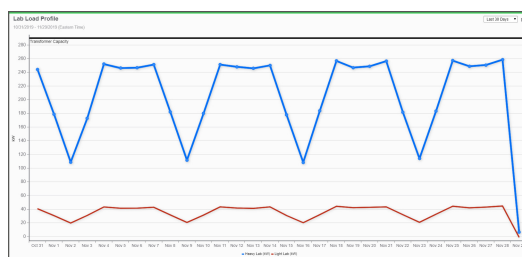

Simple Load Profile Chart

Reports

- Calendar Trend Report
- Energy Cost Report
- Energy Comparison Report
- Consumption Ranking Report
- Hourly Usage Report
- Load Profile Report
- Energy Usage Report
- Energy Period Overperiod Report

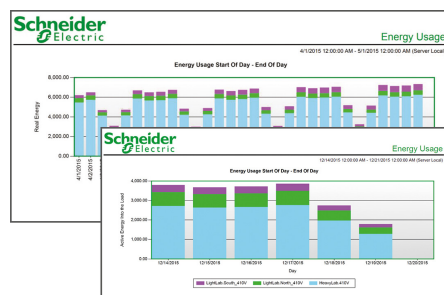

Energy Usage Report

Notifications

SMS or email notifications are sent on pre-alarm and alarm conditions described above to enable fast action.

Cloud-Based Analytics and Services


As an option, EcoStruxure Service Plan powered by EcoStruxure Power Advisor provides data quality analytics with recommendations from our Schneider Electric service experts.



EcoStruxure Power Advisor Data Quality Report

Electrical Architecture

The following diagram details the areas of the architecture where the connected products should be installed in order to implement the Energy Monitoring application:

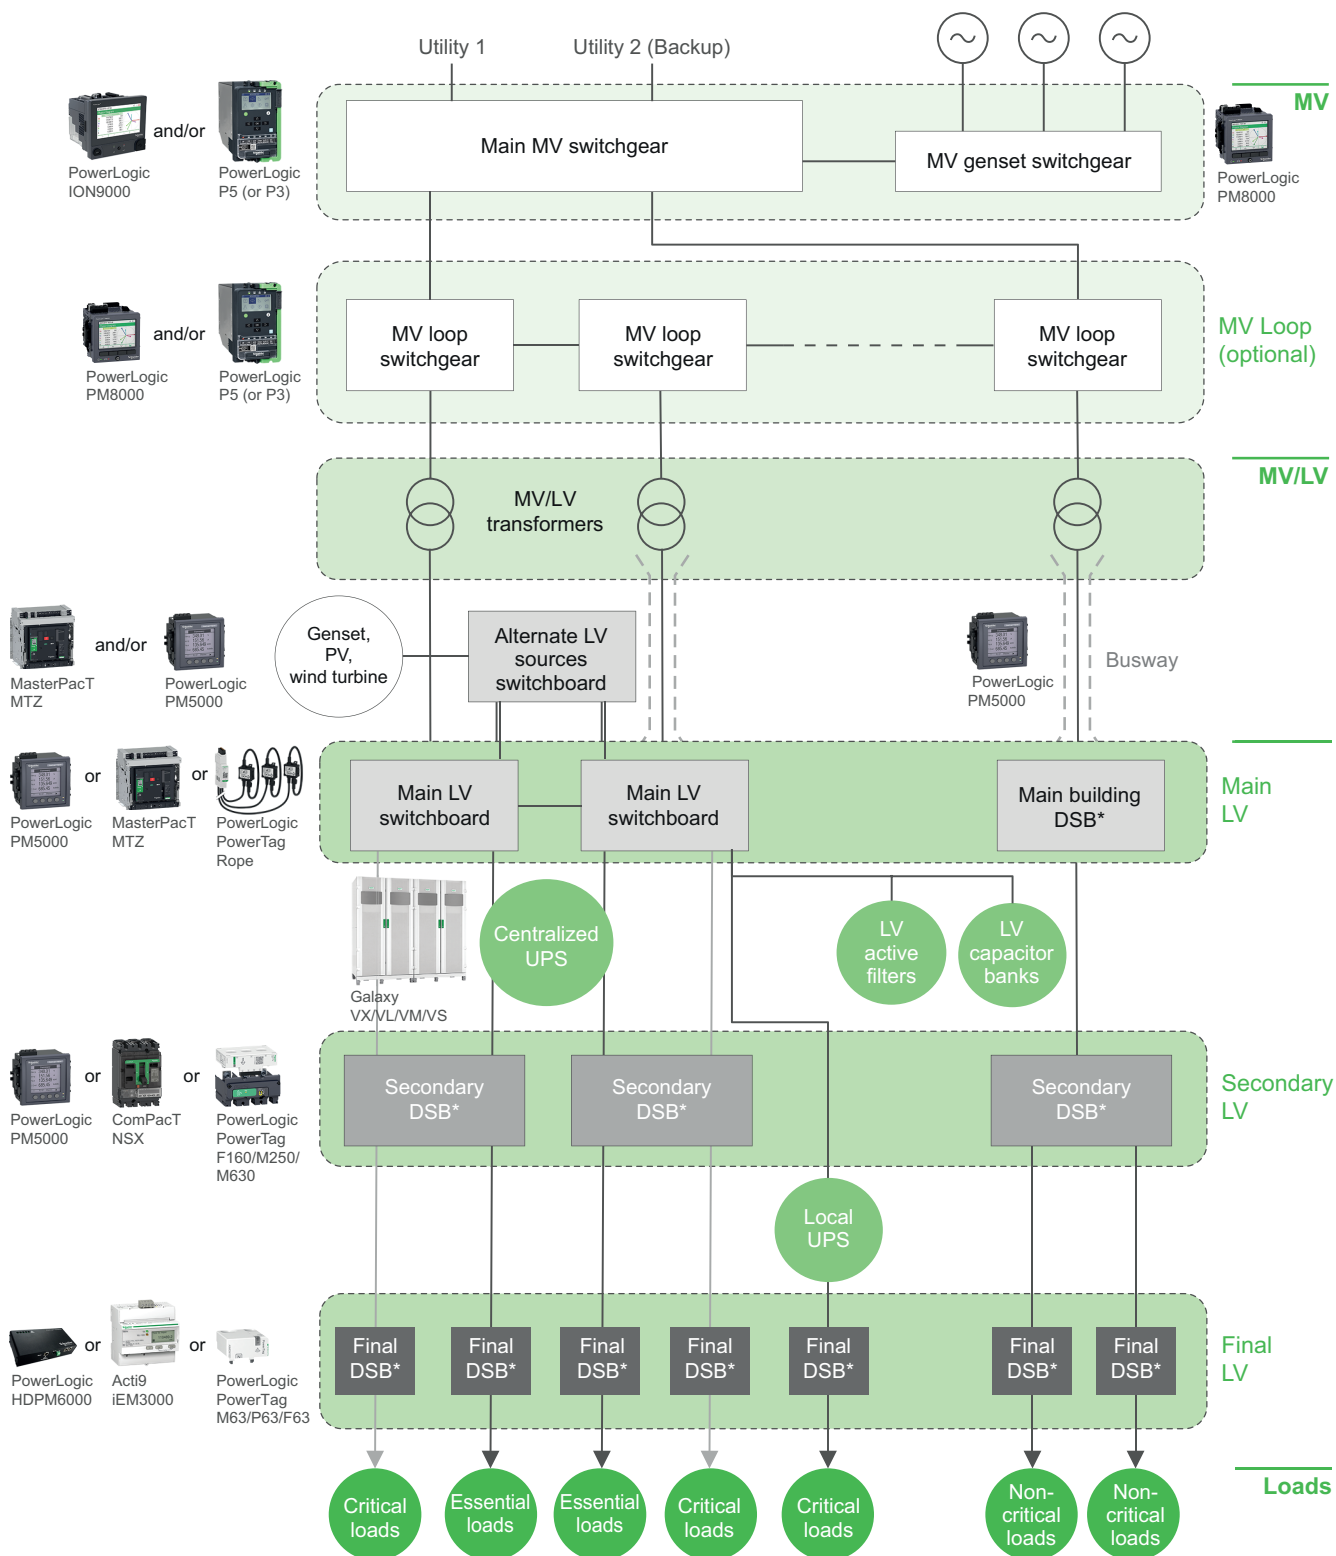

Digital Architecture


In this architecture, the data is collected from connected products either directly over Ethernet or via gateways (such as the EcoStruxure Panel Server). This data is then recorded and processed by the Edge Control software (EcoStruxure Power Monitoring Expert or Power Operation) for on-premise visualization, analysis, and reporting.

Other utility consumption inputs (WAGES) and equipment states can also be directly acquired via Ethernet, via serial communication, or through hardwired signals from basic meters and sensors.

To include other process or equipment related data in the analyses, OPC or ETL can be used to acquire data from external process or building management software.

As an option, data from EcoStruxure Power Monitoring Expert or Power Operation can be passed on to the EcoStruxure Power Advisor platform and analyzed by experts as part of the EcoStruxure Service Plan.


The recommended digital architecture for the application is shown below:

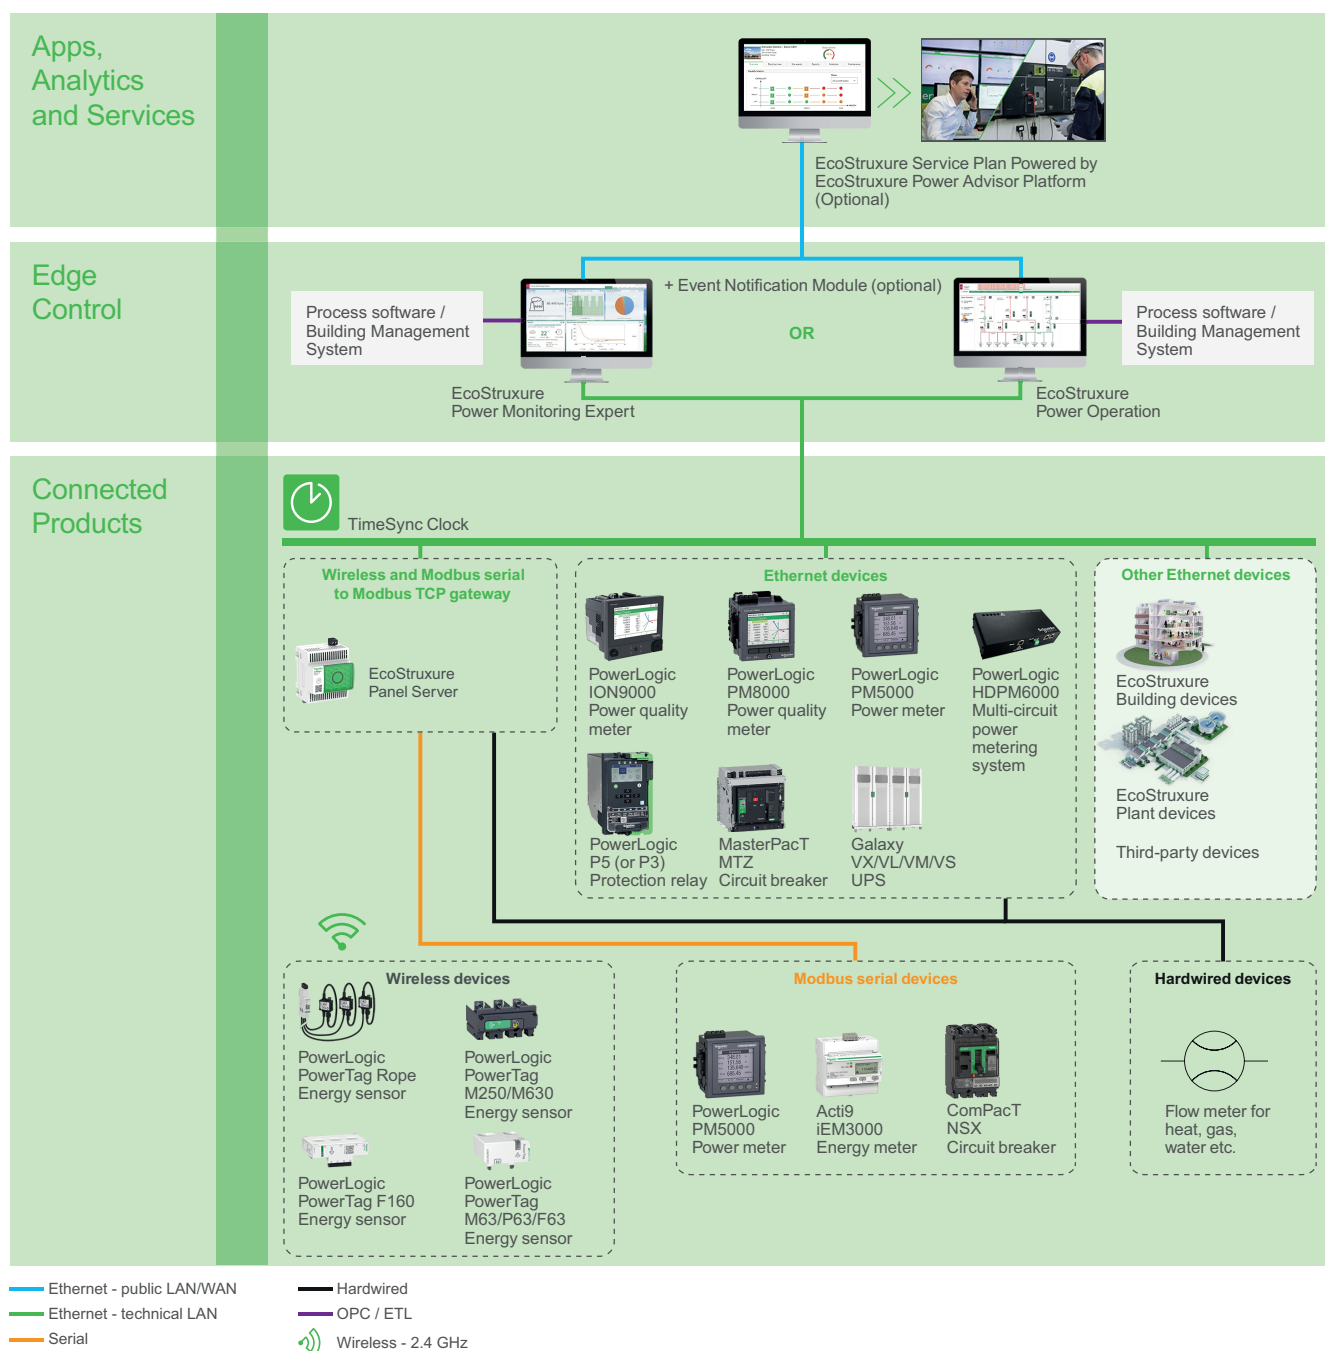

System Description

Data Flow

The Energy Monitoring application can be broken down as follows:

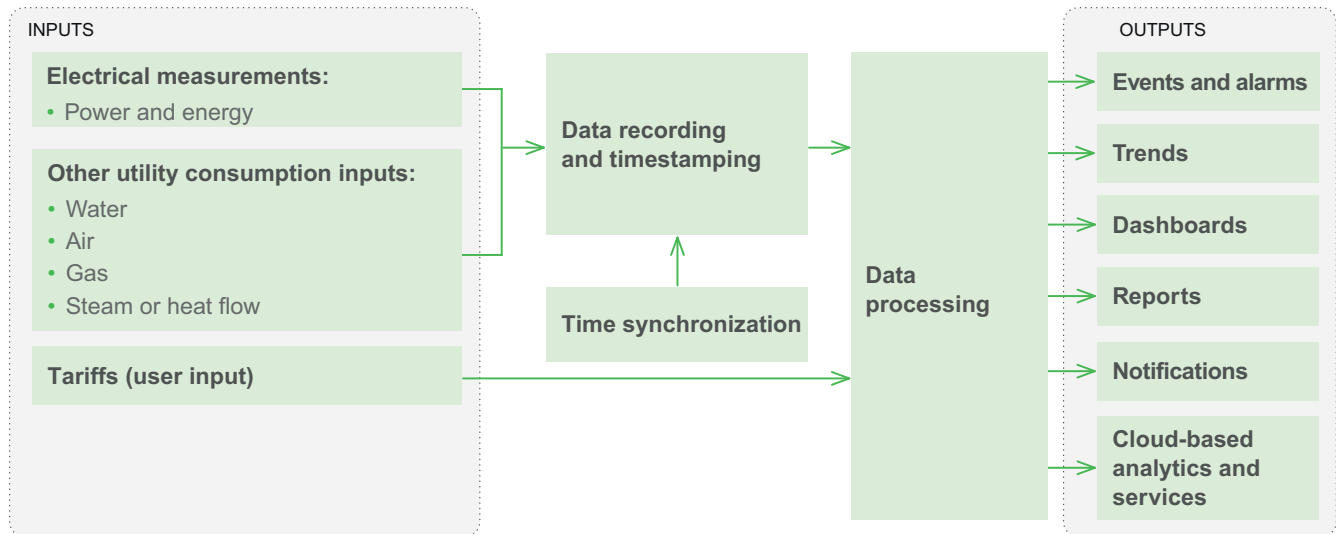

Inputs

The following data are required to implement the Energy Monitoring application.

Electrical Measurements

The following electrical measurements are collected at each point of interest in the electrical distribution, from Medium Voltage, to Low Voltage, down to Final Distribution.

- Power values (kW, kVAR, kVA)
- Energy values (kWh, kVARh, kVAh)

These data may be acquired from:

- Power/energy meters** such as PowerLogic ION9000, PM8000, PM5000, HDPM6000, PowerTag, Acti9 iEM3000



PowerLogic
ION9000



PowerLogic
PM8000



PowerLogic
PM5000



PowerLogic
HDPM6000



Acti9
iEM3000



PowerLogic
PowerTag

- **Devices with embedded metering** such as PowerLogic P5/P3, MasterPacT MTZ, and ComPacT NSX protection devices, or Galaxy VX/VL/VM/VS UPS

PowerLogic
P5PowerLogic
P3MasterPacT
MTZComPacT
NSXGalaxy
VX/VL/VM/VS

- **Third-party devices (via Modbus)**

Other Utility Consumption Inputs

The following utilities can be monitored:

- Water
- Air
- Gas
- Steam or heat flow

They can be acquired via digital/analog inputs on meters or directly via Modbus from third-party devices.

Tariffs (User Input)

To convert energy consumption into cost, it is necessary to apply the relevant tariffs to the power/energy consumption values.

Data Recording and Timestamping

For the Energy Monitoring application, a timestamp accuracy of ± 1 second is sufficient.

Advanced power meters such as the PowerLogic ION9000, PM8000, HDPM6000, and some PowerLogic PM5000 models (PM53xx and PM55xx) can timestamp and record onboard energy measurements. EcoStruxure Power Monitoring Expert or Power Operation can then retrieve the records with their original timestamp.

PowerLogic
ION9000PowerLogic
PM8000PowerLogic
HDPM6000PowerLogic
PM5000

For other devices (PowerLogic P5/P3, MasterPacT MTZ, Galaxy VX/VL/VM/VS, entry-level PowerLogic PM5000 models, Acti9 iEM3000, PowerLogic PowerTag, etc.) energy measurements are acquired by the connected products and then recorded and timestamped by EcoStruxure Power Monitoring Expert or Power Operation.

PowerLogic
P5PowerLogic
P3MasterPacT
MTZGalaxy
VX/VL/VM/VSPowerLogic
PM5000Acti9
iEM3000PowerLogic
PowerTagEcoStruxure
Power Monitoring ExpertEcoStruxure
Power Operation

When acquiring data from other customer systems, timestamps can also be imported through OPC² or ETL³.

For a comprehensive overview of device recording and timestamping capabilities, refer to Time Synchronization Capabilities of EcoStruxure Power Connected Products.

Time Synchronization

For consistent timestamping of all the data, the date and time should be accurately distributed to connected products and data loggers.

Time synchronization can be performed through various technologies (PTP, NTP, SNTP, etc.). An external master clock may be required and can be connected to a GPS antenna to reach the expected time precision.



TimeSync Clock

Data Processing

Specialized dashboards and a dedicated reporting engine analyze data to:

- Provide highlights on energy consumption according to the most relevant criteria (time of day, day of week, month, etc.).
- Visualize consumption data in an easy to interpret format (heat map, calendar trend report, consumption ranking report, etc.).

Energy data processing is embedded in the reporting engine and in the dashboards. EcoStruxure Power Monitoring Expert or Power Operation.

2. OPC = Open Platform Communications

3. ETL = The EcoStruxure Extract Transform Load (ETL) engine is a companion application for EcoStruxure Power Monitoring Expert and Power Operation. It is used to extract historical data from one application (Schneider Electric or third-party), then transform that data so it can be loaded into another application.

EcoStruxure
Power Monitoring ExpertEcoStruxure
Power Operation

Outputs

Outputs are displayed remotely via EcoStruxure Power Monitoring Expert or Power Operation except in specific cases.

The following outputs, when used as part of an energy management plan, can help meet relevant requirements for energy efficiency compliance standards such as ISO 50001, ISO 50002 and ISO 50006.

EcoStruxure
Power Monitoring ExpertEcoStruxure
Power Operation


See the Energy Efficiency Compliance application for detailed information.

Events and Alarms

In EcoStruxure Power Monitoring Expert, smart setpoints provide threshold-based alarming of historical energy usage.

Trends

- Energy Usage trending
- All input data detailed above can be displayed as trends.

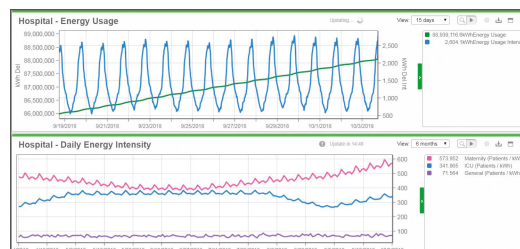

Energy Usage Trending

Dashboards

All dashboards can be configured to run automatically in slide show mode to perform the function of an Energy Kiosk.

Generic data display dashboards can be used:

- To analyze energy consumption parameters by day of the week, hour of the day, season, etc
- To compare different energy consumption parameters between buildings, areas or departments, and load types
- To detect increasing energy consumption caused by deteriorating equipment




Dashboard

Energy usage gadgets ⁴

The following gadgets make it easier to display and interpret energy consumption data:

- Heat map gadget


Creates a graphical representation of data where the individual values are represented as colors in a matrix format. This gadget can be used with consumption data to identify usage patterns and anomalies.

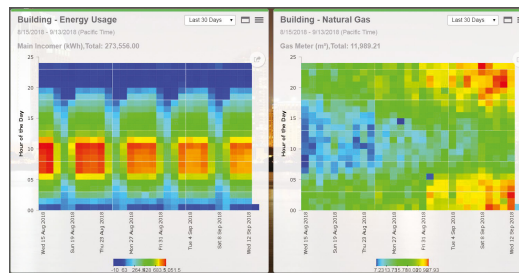

Heat Map Gadget

- Consumption / aggregated consumption ranking gadget


Compares the consumption of loads during specific time intervals, for example by hour, by day of week, or by day.

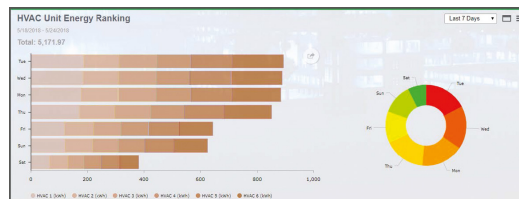

Consumption/Aggregated Consumption Ranking Gadget


4. The Energy Analysis Dashboards Module of EcoStruxure Power Monitoring Expert must be deployed to benefit from these features.

- Sankey gadget
 - Shows a flow diagram in which the width of the arrows is proportional to the data values. The diagram starts as a combined flow for all the selected loads and then breaks out into individual flows for each consumer.
 - Used to show WAGES consumption broken down by load type or to visualize consumption costs by load. It can also be used to show power losses.

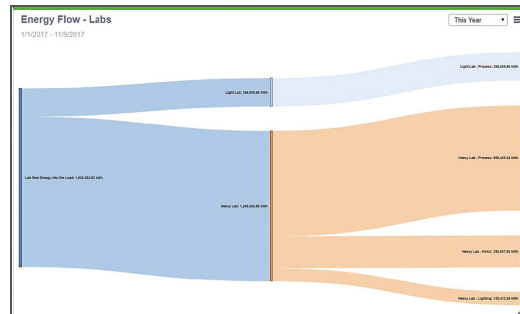

Sankey Gadget

- Pareto / aggregated pareto chart gadget
 - Used to perform an 80/20 analysis, identifying the loads that together make up the largest portion, or 80% of the overall consumption
 - Shows consumption data by load for multiple loads, over a selected time period. The information is shown in a combined column and line chart, grouped by aggregation period. The columns are arranged from highest consumption to lowest consumption with a target threshold.
 - Includes a cumulative curve based on the aggregation period consumption values.

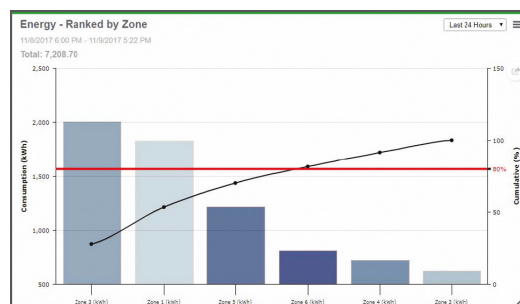

Pareto / Aggregated Pareto Chart Gadget


Reports

The following reports can be displayed or automatically sent by email:

Energy Management Reports:

- Energy Usage Report


Highlights discrepancies and provides a visual interpretation of energy consumption data.

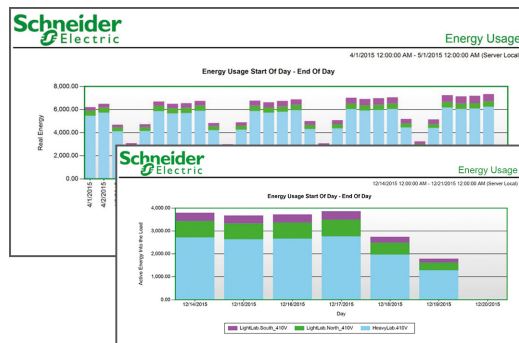

Energy Usage Report

- Energy Usage by Time of Use Report


Compares consumption for different time of use periods (on-peak vs off-peak vs partial-peak).

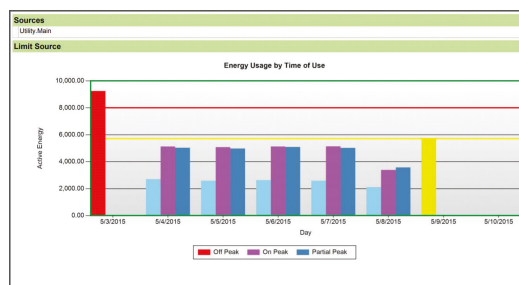

Energy Usage by Time of Use Report

- Calendar Trend Report

Provides a monthly or weekly interpretation of hourly usage data, benchmarks performance targets, and identifies peak and off-peak usage patterns

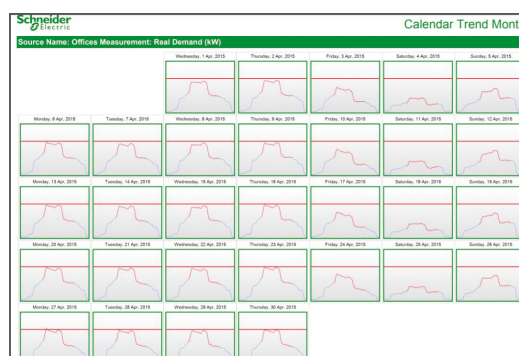


Calendar Trend Report

- Load Profile Report

Creates a graphical representation of demand or load levels over a period of time. The profile shows peak loads as points on the graph where peak electricity demand is high. A load trend report can be used to analyze the electrical loads at the time of maximum demand.


This information can show opportunities for developing strategies to improve energy management.

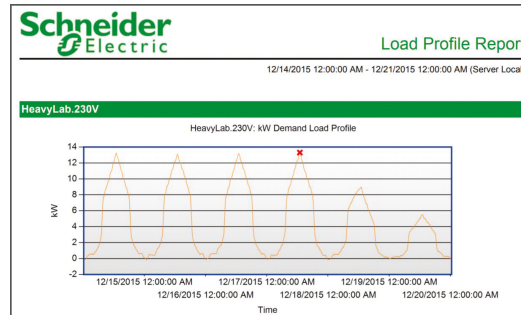

Load Profile Report

- Energy Usage by Shift Report


Compares a measurement from multiple devices for specified time periods (or shifts). This enables energy consumption comparison between shifts (for example, 6:00-1:00 vs. 1:00 to 8:00).

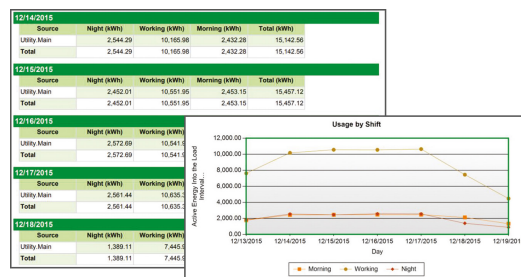

Energy Usage by Shift Report


- Consumption Ranking Report

Highlights the relative ranking of energy consumption for several loads or areas. Consumption data can be normalized to facilitate the comparison. This report is intended to assist in building energy awareness through relative visualization.

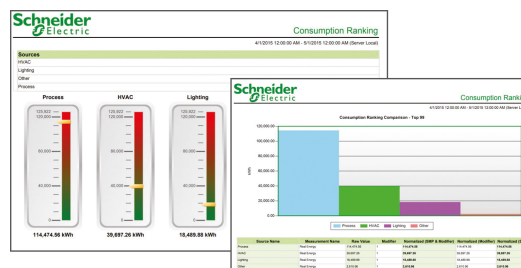


Consumption Ranking Report

- **Energy Comparison Report**
Compares energy consumption by process, equipment, or area.

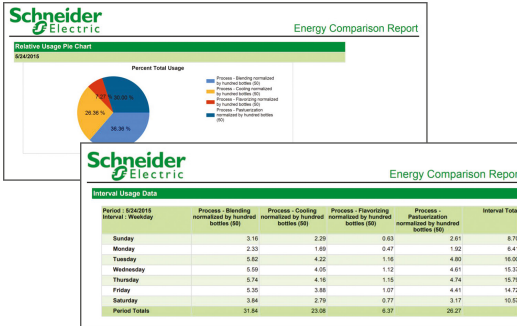


Energy Comparison Report

- **Energy Cost Report**
Converts energy consumption into cost by applying the relevant tariffs.

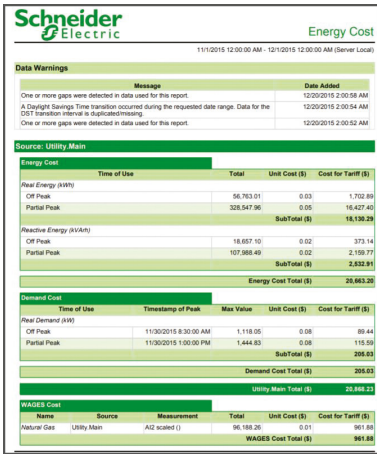

Energy Cost Report

- **Energy Period Over Period Report**
Shows consumption data for the same measurement for two different viewing periods side-by-side.

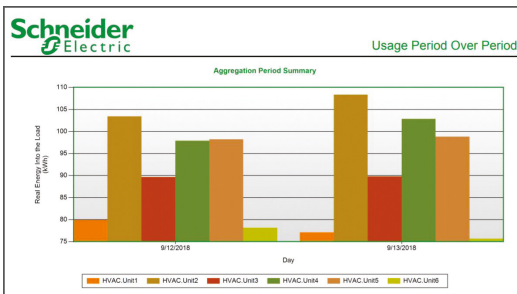

Energy Period Over Period Report

Notifications⁵

SMS or email notifications are sent on pre-alarm and alarm conditions described above to enable fast action.

5. For notifications in EcoStruxure Power Monitoring Expert and Power Operation, the Event Notification Module is required.


Cloud-Based Analytics and Services

As an option, EcoStruxure Service Plan powered by EcoStruxure Power Advisor provides data quality analytics with recommendations from our Schneider Electric service experts.


For further information, refer to Data Quality Management.



EcoStruxure Service Plan powered by EcoStruxure Power Advisor Platform

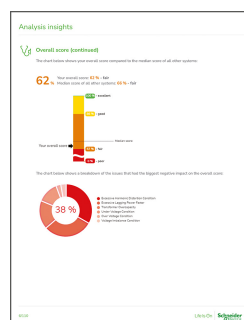

EcoStruxure Power Advisor Data Quality Report - Overall Score

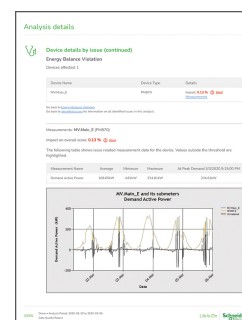

EcoStruxure Power Advisor Data Quality Report - Device Details by Issue

Schneider Electric
35 rue Joseph Monier
92500 Rueil Malmaison
France

+ 33 (0) 1 41 29 70 00

www.se.com

As standards, specifications, and design change from time to time,
please ask for confirmation of the information given in this publication.

© 2023 Schneider Electric. All rights reserved.

ESXP2GE002EN-05