

# PacT Series

## MasterPacT MTZ IEC Circuit Breakers With MicroLogic Active Control Unit

### Maintenance Guide

PacT Series offers world-class breakers and switches

DOCA0305EN-01  
03/2026



# Legal Information

The information provided in this document contains general descriptions, technical characteristics and/or recommendations related to products/solutions.

This document is not intended as a substitute for a detailed study or operational and site-specific development or schematic plan. It is not to be used for determining suitability or reliability of the products/solutions for specific user applications. It is the duty of any such user to perform or have any professional expert of its choice (integrator, specifier or the like) perform the appropriate and comprehensive risk analysis, evaluation and testing of the products/solutions with respect to the relevant specific application or use thereof.

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this document are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owner.

This document and its content are protected under applicable copyright laws and provided for informative use only. No part of this document may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the document or its content, except for a non-exclusive and personal license to consult it on an "as is" basis.

Schneider Electric reserves the right to make changes or updates with respect to or in the content of this document or the format thereof, at any time without notice.

**To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this document, as well as any non-intended use or misuse of the content thereof.**

# Table of Contents

Safety Information.....	5
About the Document.....	6
PacT Series Master Range .....	9
Maintenance Plan .....	10
Maintenance Practices.....	11
Preventive Maintenance Frequency .....	15
Maintenance After Prolonged Storage.....	19
Maintenance Schedule .....	20
Parts to be Maintained and Why.....	21
How to Maintain the Case .....	22
How to Maintain the Arc Chutes .....	24
How to Maintain the Main Contacts .....	25
How to Maintain Power Connections .....	26
How to Maintain the Chassis .....	27
How to Maintain the Charging Mechanism.....	29
How to Maintain MicroLogic Active Control Unit .....	30
How to Maintain the Communication System .....	32
How to Maintain Auxiliary Circuits .....	34
How to Maintain Mechanical Interlocking Systems .....	37
Preventive Maintenance Programs.....	39
General Safety Instructions .....	40
Routine End-User Preventive Maintenance Program.....	41
Intermediate End-User Preventive Maintenance Program.....	43
Manufacturer Preventive Maintenance Program.....	45
Schneider Electric Expert Diagnostics Program .....	46
Device Aging.....	49
Causes of Aging .....	50
Influence of Temperature on Aging.....	51
Influence of Load on Aging .....	52
Influence of Relative Humidity on Aging.....	53
Influence of Salt Environment on Aging .....	54
Influence of Harmonics on Aging .....	55
Influence of Dust on Aging.....	56
Influence of Corrosive Atmosphere on Aging .....	57
Influence of Vibration on Aging .....	59
Influence of Operating Cycles on Aging .....	60
Influence of Interrupted Currents on Aging.....	61
Appendices .....	62
Operating Limits for MasterPacT MTZ IEC Devices With MicroLogic Active Control Unit.....	63
Related Documents for MasterPacT MTZ IEC Devices With MicroLogic Active Control Unit.....	65



# Safety Information

## Important Information

Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, service, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a “Danger” or “Warning” safety label indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

### **DANGER**

**DANGER** indicates a hazardous situation which, if not avoided, **will result in** death or serious injury.

### **WARNING**

**WARNING** indicates a hazardous situation which, if not avoided, **could result in** death or serious injury.

### **CAUTION**

**CAUTION** indicates a hazardous situation which, if not avoided, **could result in** minor or moderate injury.

### **NOTICE**

**NOTICE** is used to address practices not related to physical injury.

## Please Note

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction and operation of electrical equipment and its installation, and has received safety training to recognize and avoid the hazards involved.

# About the Document

## Document Scope

Schneider Electric recommends a preventive maintenance program to ensure that devices retain their operating and technical characteristics during their service life. Maintenance must be carried out by trained and qualified personnel, in accordance with instructions specified in this maintenance guide for MasterPacT™ MTZ IEC circuit breaker with MicroLogic™ Active control unit.

This guide contains information on:

- Maintenance frequency depending on the environmental and operating conditions and criticality of the user application.
- Maintenance required after prolonged storage.
- Schneider Electric tools for maintenance assistance.
- The parts of the MasterPacT MTZ IEC circuit breaker with MicroLogic Active control unit that must be maintained:
  - Elements of the breaking unit: case, arc chutes, and main contacts
  - Power connections
  - Chassis
  - Charging Mechanism
  - MicroLogic Active control unit
  - Communication system
  - Auxiliary circuits
  - Mechanical interlocking systems
- The risks involved when a part is not fully operational.
- The preventive maintenance program to be carried out, and the competence level required for each program.
- Environmental and operating conditions that cause accelerated aging of a device.
- Limits governing the use of mechanical and electrical accessories and subassemblies.
- Links to device guides and related documents that can help to maintain the MasterPacT MTZ IEC circuit breaker with MicroLogic Active control unit in proper operating order.

## Validity Note

This guide applies to MasterPacT MTZ circuit breakers with MicroLogic Active control unit.

## Online Information

The characteristics of the products described in this document are intended to match the characteristics that are available on [www.se.com](http://www.se.com). As part of our corporate strategy for constant improvement, we may revise the content over time to enhance clarity and accuracy. If you see a difference between the characteristics in this document and the characteristics on [www.se.com](http://www.se.com), consider [www.se.com](http://www.se.com) to contain the latest information.

## General Cybersecurity Information

In recent years, the growing number of networked machines and production plants has seen a corresponding increase in the potential for cyber threats, such as unauthorized access, data breaches, and operational disruptions. You must, therefore, consider all possible cybersecurity measures to help protect assets and systems against such threats.

To help keep your Schneider Electric products secure and protected, it is in your best interest to implement the cybersecurity best practices as described in the [Cybersecurity Best Practices](#) document.

Schneider Electric provides additional information and assistance:

- Subscribe to the Schneider Electric security newsletter.
- Visit the [Cybersecurity Support Portal](#) web page to:
  - Find Security Notifications.
  - Report vulnerabilities and incidents.
- Visit the [Schneider Electric Cybersecurity and Data Protection Posture](#) web page to:
  - Access the cybersecurity posture.
  - Learn more about cybersecurity in the cybersecurity academy.
  - Explore the cybersecurity services from Schneider Electric.

## Environmental Data

For product compliance and environmental information, refer to the Schneider Electric Environmental Data Program.

## Available Languages of the Document

The document is available in these languages:

- English (DOCA0305EN), original language
- Spanish (DOCA0305ES)
- Chinese (DOCA0305ZH)

## Related Documents

Title of Documentation	Reference Number
<i>MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures</i>	DOCA0306EN DOCA0306ES DOCA0306ZH
<i>MasterPacT MTZ - MicroLogic Active Control Unit - User Guide</i>	DOCA0265EN DOCA0265ES DOCA0265ZH
<i>MasterPacT MTZ - MicroLogic Active Control Unit - Firmware Release Notes</i>	DOCA0267EN
<i>Breaker Communication and Isolation Module (BCIM) for MicroLogic Active Control Unit - Firmware Release Notes</i>	DOCA0395EN

You can download these technical publications and other technical information from our website at [www.se.com/ww/en/download/](http://www.se.com/ww/en/download/).

## Information on Non-Inclusive or Insensitive Terminology

As a responsible, inclusive company, Schneider Electric is constantly updating its communications and products that contain non-inclusive or insensitive terminology. However, despite these efforts, our content may still contain terms that are deemed inappropriate by some customers.

## Trademarks

*QR Code* is a registered trademark of DENSO WAVE INCORPORATED in Japan and other countries.

## PacT Series Master Range

Future-proof your installation with Schneider Electric's low-voltage and medium-voltage PacT Series. Built on legendary Schneider Electric innovation, the PacT Series comprises world-class circuit breakers, switches, residual current devices and fuses, for all standard and specific applications. Experience robust performance with PacT Series within the EcoStruxure-ready switchgear, from 16 to 6300 A in low-voltage and up to 40.5 kV in medium-voltage.

## Convention

In this guide, the term *MasterPacT MTZ device* covers MasterPacT MTZ circuit breakers with MicroLogic Active control unit.

# Maintenance Plan

## What's in This Part


Maintenance Practices .....	11
Preventive Maintenance Frequency .....	15
Maintenance After Prolonged Storage .....	19
Maintenance Schedule .....	20

# Maintenance Practices

## Maintenance Strategy

You can define the optimal maintenance strategy according to the criticality of your application, by combining four maintenance practices:

- Corrective maintenance
- Preventive maintenance
- Enhanced preventive maintenance
- Predictive maintenance (condition-based maintenance)

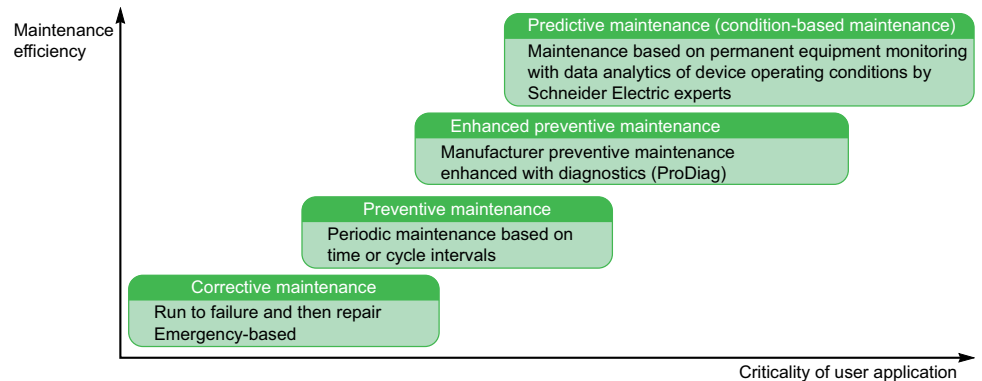

## Corrective Maintenance

Corrective maintenance:

- Is carried out after fault recognition.
- Is intended to put an item into a state in which it can perform a required function.

Corrective maintenance is recommended only for non-critical applications that have minimal impact in business operations.

## Preventive Maintenance

Preventive maintenance:

- Is carried out in either of the following cases:
  - At predetermined frequency in accordance with established time intervals or number of units of use but without previous condition investigation.
 

**NOTE:** The time intervals or number of units of use may be established from knowledge of the failure mechanisms of the item.
  - According to prescribed criteria.
- Is intended to reduce the probability of failure or the degradation of the functioning of an item.

Preventive maintenance is recommended for user applications with low to high criticality.

Preventive maintenance includes three programs:

- Maintenance program that can be performed by the end user:
  - Routine end-user maintenance program
  - Intermediate end-user maintenance program

- Maintenance program that can be performed by Schneider Electric Services:
  - Manufacturer maintenance program

Each preventive maintenance program is conducted during a scheduled outage as per maintenance frequency or cycles of use in accordance with the recommendations defined in this guide, page 15.

## Enhanced Preventive Maintenance

Enhanced preventive maintenance comprises the Manufacturer preventive maintenance program included in the following Schneider Electric offers:

- The Complete Manufacturer Maintenance program is recommended for devices in a user application with moderate criticality. It includes ProDiag Trip Unit diagnostic.
- The Advanced Manufacturer Maintenance program is recommended for devices in a user application with high criticality. It includes the following diagnostics:
  - ProDiag Trip Unit
  - ProDiag Breaker
  - ProDiag Clusters for drawout MasterPacT MTZ devices

Contact your Schneider Electric Services representative for more information.

## Predictive Maintenance (Condition-Based Maintenance)

Predictive maintenance is condition-based maintenance carried out following a forecast derived from repeated analysis or known characteristics and evaluation of the significant parameters of the degradation of the item.

A Schneider Electric Connected Service Hub (CSH) assesses data on behalf of the end user to validate and trigger maintenance work orders, and schedule ensuing on-site maintenance.

Contact your Schneider Electric Services representative for more information.

Predictive maintenance is also supported by the EcoCare Service Plan.

## EcoCare Service Plan

EcoCare combines AI-powered condition-based maintenance, 24/7 remote monitoring and alarming, and expert insights to help maximize uptime and streamline operational efficiency.

For more information, refer to [EcoCare](#).

## Defining Your Maintenance Plan

Low voltage circuit breakers, for example MasterPacT MTZ circuit breakers, in a power distribution infrastructure play a critical role in helping to protect the equipment and activity against cable overloads, short-circuits, and insulation faults, helping to ensure safety, reliability, security, and sustainability.

If you are a plant manager, maintenance manager, facility manager, or safety manager, you are responsible for helping to ensure your power distribution infrastructure with MasterPacT MTZ devices works in optimum conditions throughout its life cycle.

To achieve the necessary level of protection you need to have a maintenance plan to maintain each MasterPacT MTZ device (system and parts) in a satisfactory operational state for its useful service life, and you must ensure that the plan is carried out.

This guide provides you with the insights necessary to build your own MasterPacT MTZ maintenance plan, tailored to your device operating conditions (determined by the level of external stress of your device), and the environmental conditions impacting the aging and performance of your MasterPacT MTZ device, and the criticality of the application.

Schneider Electric recommends that you build your MasterPacT MTZ maintenance plan according to:

- The required preventive maintenance programs, page 15:
  - Routine end-user maintenance program
  - Intermediate end-user maintenance program
  - Manufacturer maintenance program
- The frequency of each maintenance program, defined by:
  - The environmental conditions and device operating conditions:
    - Favorable, page 15
    - Normal, page 16
    - Severe, page 16
  - The criticality of the user application, page 17:
    - Low
    - Moderate
    - High

## Example of Maintenance Plan

The following example is a preventive maintenance plan for three MasterPacT MTZ devices operating under different conditions in the facility.

The maintenance plan is based on the following parameters:

- Number and types of maintenance programs: apply the three preventive maintenance programs recommended by Schneider Electric:
  - Routine end-user maintenance program
  - Intermediate end-user maintenance program
  - Manufacturer maintenance program
- Frequency for each maintenance program: determined according to the following:
  - Environmental and operating conditions
  - Criticality of the user application

Criteria	MasterPacT MTZ device no. 1	MasterPacT MTZ device no. 2	MasterPacT MTZ device no. 3
Temperature	30 °C (86 °F)	25 °C (77 °F)	30 °C (86 °F)
Percent load (I/In)	67%	48%	85%
Relative humidity	75%	85%	70%
Corrosivity	Urban zones, scattered industrial activity, and heavy traffic		
Salt environment	No salt mist	No salt mist	No salt mist
Dust	Moderate level	High level	Low level
Vibration	None	None	None
<b>Environmental and operating conditions</b>	<b>Normal</b>	<b>Severe</b>	<b>Severe</b>

Criteria	MasterPacT MTZ device no. 1	MasterPacT MTZ device no. 2	MasterPacT MTZ device no. 3
<b>Criticality of the user application</b>	Low	Moderate	High
<b>Maintenance program frequency</b>			
Routine end-user maintenance program	Every year	Every year	Every year
Intermediate end-user maintenance program	Every 2 years	Every 2 years	Every 2 years
Manufacturer maintenance program	Every 5 years	Every 3 years	Every 2 years
Diagnostic services (ProDiag programs)	Contact your Schneider Electric Services representative to plan maintenance operations.		

Based on the data above, the recommended maintenance plan for the three MasterPacT MTZ devices is as follows:

- Maintenance plan for MasterPacT MTZ no. 1 device, operating in normal operating conditions and with user application with low criticality:

Maintenance plan	Year 1	Year 2	Year 3	Year 4	Year 5	Year 6	Year 7	Year 8	Year 9	Year 10	Year 11	Year 12
Routine end-user maintenance program	✓	–	✓	–	–	✓	–	✓	–	–	✓	–
Intermediate end-user maintenance program	–	✓	–	✓	–	–	✓	–	✓	–	–	✓
Manufacturer maintenance program	–	–	–	–	✓	–	–	–	–	✓	–	–
Diagnostic services (ProDiag programs)	Contact your Schneider Electric Services representative to plan maintenance operations.											

- Maintenance plan for MasterPacT MTZ no. 2 device, operating in severe operating conditions and with user application with moderate criticality:

Maintenance plan	Year 1	Year 2	Year 3	Year 4	Year 5	Year 6	Year 7	Year 8	Year 9	Year 10	Year 11	Year 12
Routine end-user maintenance program	✓	–	–	✓	–	–	✓	–	–	✓	–	–
Intermediate end-user maintenance program	–	✓	–	–	✓	–	–	✓	–	–	✓	–
Manufacturer maintenance program	–	–	✓	–	–	✓	–	–	✓	–	–	✓
Diagnostic services (ProDiag programs)	Contact your Schneider Electric Services representative to plan maintenance operations.											

- Maintenance plan for MasterPacT MTZ no. 3 device, operating in severe operating conditions and with user application with high criticality:

Maintenance plan	Year 1	Year 2	Year 3	Year 4	Year 5	Year 6	Year 7	Year 8	Year 9	Year 10	Year 11	Year 12
Routine end-user maintenance program	✓	–	✓	–	✓	–	✓	–	✓	–	✓	–
Intermediate end-user maintenance program	–	–	–	–	–	–	–	–	–	–	–	–
Manufacturer maintenance program	–	✓	–	✓	–	✓	–	✓	–	✓	–	✓
Diagnostic services (ProDiag programs)	Contact your Schneider Electric Services representative to plan maintenance operations.											

# Preventive Maintenance Frequency

## Preventive Maintenance Safety Instructions

Maintenance recommendations for each device are intended to maintain the equipment or subassemblies in a satisfactory operational state for their useful service life.

Preventive maintenance schedule is calculated by the MicroLogic Active control unit from:

- The operating conditions of the MasterPacT MTZ device.
- The criticality of the user application.

The MicroLogic Active control unit generates an event to inform the user that manufacturer maintenance needs to be planned to conform to the preventive maintenance schedule.

### ▲ WARNING

#### UNINTENDED EQUIPMENT OPERATION

Follow the recommendations for the maintenance given in the different chapters of this document, for each part of the device which is maintainable.

**Failure to follow these instructions can result in death, serious injury, or equipment damage.**

If the recommended maintenance plan is not done as required, the service life of electrical distribution equipment is reduced.

## Maintenance Programs

The following table summarizes maintenance operations for the three preventive maintenance programs:

Maintenance program	Maintenance description	Performed by
Routine end-user maintenance	Visual inspection and functional testing, replacement of inoperative accessories.	<ul style="list-style-type: none"> <li>• Trained and qualified end-user personnel</li> <li>• Trained and qualified maintenance services provider personnel</li> <li>• Schneider Electric Services representatives</li> </ul>
Intermediate end-user maintenance	Routine end-user maintenance, plus operational servicing and subassembly tests.	<ul style="list-style-type: none"> <li>• Trained and qualified maintenance services provider personnel</li> <li>• Schneider Electric Services representatives</li> </ul>
Manufacturer maintenance	Intermediate end-user maintenance, plus diagnostics and part replacements by Schneider Electric Services.	Schneider Electric Services representatives

## Favorable Environmental Conditions and Device Operating Conditions

Environmental conditions and device operating conditions are considered to be favorable **when all of the following conditions** are met:

Favorable environmental conditions and device operating conditions	
Temperature	Annual average ambient temperature outside the switchboard $T_a < 25\text{ }^\circ\text{C}$ (77 °F) (IEC 61439-1). Device installed in an air-conditioned room or in a ventilated switchboard.
Percent load	$< 50\%$ of $I_n$ (daily process 8/24 h or continuous process 24/24 h)
Relative humidity	$< 50\%$
Corrosive atmosphere	Device installed in category 3C1 environment, page 58 or in a closed room that creates favorable operating conditions (air is conditioned and purified).
Salt environment	None
Dust	Negligible. Device installed in a switchboard equipped with filters or a ventilated IP54 enclosure.
Vibration	None

## Normal Environmental Conditions and Device Operating Conditions

Environmental conditions and device operating conditions are considered to be normal **when all of the following conditions** are met:

Normal environmental conditions and device operating conditions	
Temperature	Annual average ambient temperature outside the switchboard $T_a < 25\text{ }^\circ\text{C}$ (77 °F) (IEC 61439-1)
Percent load	$< 80\%$ of $I_n$ (daily process 8/24 h or continuous process 24/24 h)
Harmonics	Harmonic current per phase $< 30\%$ of $I_n$
Relative humidity	$< 70\%$
Corrosive atmosphere	Device installed in environment category 3C2 or 3C3 (IEC 60721-3-3), page 58
Salt environment	No salt mist
Dust	Low level. Device installed in a switchboard equipped with filters or a ventilated IP54 enclosure.
Vibration	Permanent vibration $< 0.2\text{ g}$

## Severe Environmental Conditions and Device Operating Conditions

Environmental conditions and device operating conditions are considered to be severe **if any of the following conditions** are present:

Severe environmental conditions and device operating conditions	
Temperature	Annual average ambient temperature outside the switchboard $T_a$ between $35\text{ }^\circ\text{C}$ (95 °F) and $45\text{ }^\circ\text{C}$ (113 °F) (IEC 61439-1)
Percent load	$> 80\%$ of $I_n$ (daily process 8/24 h or continuous process 24/24 h)
Relative humidity	$> 80\%$
Corrosive atmosphere	Device installed in category 3C4 environment without any particular protection, page 58
Salt environment	Device installed less than 10 kilometers from the coast without any particular protection
Dust	High level. Device not installed inside an enclosure equipped with filters or a ventilated IP54 enclosure.
Vibration	Continuous vibrations between $0.2\text{ g}$ and $0.5\text{ g}$

For example, severe environmental conditions and device operating conditions prevail in marine and wind power applications.

## Criticality of User Application

The following table describes the three criticality levels of user application.

Criticality level	Description
Low	The loss of function will cause minimal curtailment of operations or may require minimal monetary investment to restore full operations. Normal contingency planning would cover the loss.
Moderate	The loss of function will have noticeable impact on the facility. It may have to suspend some operations briefly. Some monetary investments may be necessary to restore full operations. It may cause minor personal injury.
High	The loss of function will cause personal injury or substantial economic damage. Loss would not be disastrous, but the facility would have to suspend at least part of its operations immediately and temporarily. Reopening the facility would require significant monetary investments.

## Recommended Frequency for the Routine End-User Maintenance Program

The following table indicates the recommended frequency to perform the Routine end-user maintenance program according to operating conditions and criticality of the user application.

Operating conditions	Criticality of user application		
	Low	Moderate	High
Favorable	2 years	2 years	2 years
Normal	1 year	1 year	1 year
Severe	1 year	1 year	1 year

## Recommended Frequency for the Intermediate End-User Maintenance Program

The following table indicates the recommended frequency to perform the Intermediate end-user maintenance program according to operating conditions and criticality of the user application.

Operating conditions	Criticality of user application		
	Low	Moderate	High
Favorable	4 years	4 years	4 years
Normal	2 years	2 years	2 years
Severe	2 years	2 years	2 years

## Recommended Frequency for the Manufacturer Maintenance Program

The following table indicates the recommended frequency to perform the manufacturer maintenance program according to operating conditions and criticality of the user application.

Operating conditions	Criticality of user application		
	Low	Moderate	High
Favorable	6 years	5 years	4 years
Normal	5 years	4 years	3 years
Severe	4 years	3 years	2 years

A complete check-up is recommended when tripping occurs due to a short-time or instantaneous short-circuit.

# Maintenance After Prolonged Storage

## Storage Conditions

Devices must be stored in a dry, ventilated room, protected from rain, water, and chemical agents. They must be protected against dust, rubble, and paint.

If stored for an extended period, the relative humidity in the room must be maintained below 70 %.

Storage temperature:

- Devices without the MicroLogic Active control unit: -55 °C to +85 °C (-67 °F to +185 °F).
- Devices with the MicroLogic Active control unit: -25 °C to +85 °C (-13 °F to +185 °F).

Devices must be stored in the open (OFF) position with the charging spring discharged.

## Check-up and Maintenance After Prolonged Storage

After prolonged storage and if the storage conditions listed above were respected, the checks below must be carried out to ensure correct device operation:

Part or subassembly	Under two years of storage	Over two years of storage
Device mechanisms	Intermediate end-user program	Manufacturer maintenance program
MicroLogic Active control unit	Intermediate end-user program	Manufacturer maintenance program
Device and chassis locking	Intermediate end-user program	Manufacturer maintenance program
Chassis	Intermediate end-user program	Manufacturer maintenance program
Auxiliary circuits	–	Manufacturer maintenance program

In addition, if the devices were stored under severe conditions (high temperature, corrosive atmosphere):

- Check the surface condition of the metal parts (zinc) and the copper parts (silver coatings (Ag) on connection terminals or tinning (Sn)).
- Check the greasing for the device and chassis.
- Clean and regrease the clusters and disconnecting contacts.

# Maintenance Schedule

## Overview

The MicroLogic Active control unit provides information to help with scheduling preventive maintenance operations.

It monitors maintenance programs performed and generates an event to indicate that Manufacturer maintenance is due.

## Operating Principle

The MicroLogic Active control unit generates an event to indicate that Manufacturer maintenance is due.

Manufacturer maintenance schedule events are calculated from the assembly date of the circuit breaker.

## Predefined Events

The maintenance schedule function generates the following events:

Code	Event	History	Severity
0x1482 (5250)	<b>Sched. Manufact. maintenance within 3 months</b>	Diagnostic	Medium

## Recommended Actions

Code	Event	Recommended actions
0x1482 (5250)	<b>Sched. Manufact. maintenance within 3 months</b>	Plan to schedule the Manufacturer preventive maintenance program within three months. To plan, edit report and track maintenance intervention, you may use EcoStruxure Facility Expert app.

---

# Parts to be Maintained and Why

## What's in This Part

How to Maintain the Case .....	22
How to Maintain the Arc Chutes.....	24
How to Maintain the Main Contacts.....	25
How to Maintain Power Connections.....	26
How to Maintain the Chassis .....	27
How to Maintain the Charging Mechanism.....	29
How to Maintain MicroLogic Active Control Unit .....	30
How to Maintain the Communication System.....	32
How to Maintain Auxiliary Circuits.....	34
How to Maintain Mechanical Interlocking Systems .....	37

# How to Maintain the Case

## Functions



The case of the device:

- Insulates the main contacts
- Helps to protect the user against arcing effects
- Provides a support for:
  - Mechanism
  - Control unit
  - Auxiliaries
  - Power connection
- Withstands the thermal and electrodynamic stresses generated during short-circuits

## Degradation Factors

The factors which can cause degradation of the case are the following:

- Dusty or dirty environment
- Humidity
- High ambient temperature
- Shocks
- Stresses due to high short-circuit currents

## Potential Hazards

Performing regular maintenance on the case can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Arc flash	Death or serious injury	–
Insulation resistance of the case too low and impulse voltage	Electric shock	–
Disruptive discharge	–	Degradation of the breaking unit
High short-circuit current	–	Degradation of the breaking unit

## Preventive Action


The following table lists the preventive maintenance procedures to be performed to maintain the case of the device.

Maintenance program	Preventive action	Procedure
Routine end-user preventive maintenance	Check the general condition of the device.	Device NII_ZA_1
Manufacturer preventive maintenance	Measure the insulation resistance.	Contact your Schneider Electric Services representative.

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain the Arc Chutes

## Functions

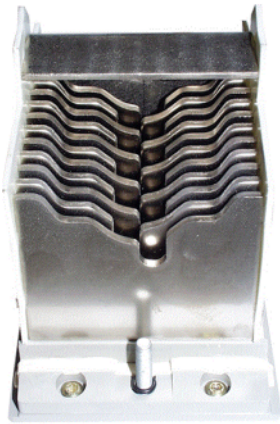

The arc chutes of the device:

- Are mounted on each arc chamber of the breaking unit
- Are composed of splitters and filters

The splitters of the arc chutes limit the stress exerted on the installation by:

- Helping to extinguish the arc
- Absorbing the arc energy under normal electrical operations and electric faults

The filters of the arc chutes filter the pressured gas expelled out of the arc chamber and cool it to a temperature at which it is no longer ionized and is therefore non-conductive.

## Degradation Factors

The factors which can cause degradation of the arc chutes are the following:

- Frequent switching operations at rated current
- Stresses due to high short-circuit currents

## Potential Hazards

Performing regular maintenance on the arc chutes can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Arc flash	Death or serious injury	–
Insulation resistance of the case too low and impulse voltage	Electric shock	–
High short-circuit current	–	Degradation of the breaking unit

## Preventive Action


The following table lists the preventive maintenance procedures to be performed to maintain the arc chutes of the device.

Maintenance program	Preventive action	Procedure
Intermediate end-user preventive maintenance	Check the condition of the breaking unit.	Breaking Unit NIII_ZA_1
	Check mounting of arc chutes and filter cleanliness.	Breaking Unit NIII_ZA_2

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain the Main Contacts

## Functions



The main contacts of the device:

- Are mounted in the arc chamber
- Are composed of the fixed and mobile contacts

The mobile contacts make (close) or break (open) the electrical circuit under normal conditions (at rated current  $I_n$ ) or fault conditions (overload and short-circuit).

- A. Fixed contact
- B. Mobile contact

## Degradation Factors

The factors which can cause degradation of the main contacts are the following:

- Frequent switching operations at rated current
- Stresses due to high short-circuit currents

## Potential Hazards

Performing regular maintenance on the main contacts can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Fire	Death or serious injury	–
Thermal dissipation due to high-resistance contact	–	Degradation of the breaking unit

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the main contacts of the device.

Maintenance program	Preventive action	Procedure
Intermediate end-user preventive maintenance	Check the condition of the breaking unit.	Breaking unit NIII_ZA_1
Manufacturer preventive maintenance	Measure the contact resistance for each pole.	Contact your Schneider Electric Services representative.

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain Power Connections

## Functions

<b>▲ WARNING</b>
<p><b>HAZARD OF HEAT GENERATION</b></p> <p>Power connections must never use other material than copper or aluminum.</p> <p><b>Failure to follow these instructions can result in death, serious injury, or equipment damage.</b></p>

Power connections are the links between devices and electrical distribution systems (for example, busbars, cables). Connection terminals are used to make the links.

## Degradation Factors

The factors which can cause degradation of the power connections are the following:

- Vibration
- Overheating
- Incorrect tightening torque
- Deteriorated washer

## Potential Hazards

Performing regular maintenance on the power connections can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Fire	Death or serious injury	–
Thermal dissipation due to insufficient tightening torque	–	Burning of the cable insulation

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the power connections of the device.

Maintenance program	Preventive action	Procedure
Intermediate end-user preventive maintenance	Check connection system.	Power Connections NIII_ZA_1

For more information, refer to Preventive Maintenance Programs, page 39.


# How to Maintain the Chassis

## Functions

The chassis mechanism is used to rack the device in and out.

The sliding connections between the chassis and device are made up of two parts: clusters and disconnecting contacts. Grease between the clusters and the disconnecting contacts facilitates the connection and avoids damaging the silver-coated surface by reducing the racking-in friction.

Chassis and system of racking in and out

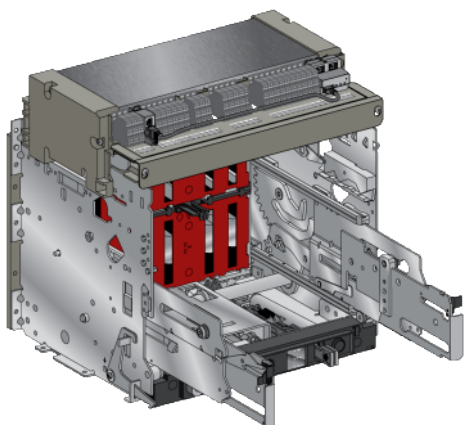

Clusters and disconnecting contacts



## Degradation Factors

The factors which can cause degradation of the chassis are the following:

- Dusty environment
- Shocks
- Corrosive atmosphere
- Idle for long periods of time
- Incorrect operation

## Potential Hazards

Performing regular maintenance on the chassis can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Safety shutter malfunction	Electric shock	–
Device remains jammed in connected position.	–	Jammed operation of the device in the chassis (racking-in and racking-out)

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the chassis.

Maintenance program	Preventive action	Procedure
Routine end-user preventive maintenance	Check device racking operation.	Chassis NII_ZA_1
Intermediate end-user preventive maintenance	Check operation of safety shutters.	Chassis NIII_ZA_2
	Clean chassis and check presence of grease on chassis.	Chassis NIII_ZA_3
	Check disconnecting contact clusters.	Chassis NIII_ZA_4
Manufacturer preventive maintenance	Check connection/disconnection torque.	Contact your Schneider Electric Services representative.
	Clean and regrease chassis of MasterPacT MTZ drawout devices.	

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain the Charging Mechanism

## Functions

The charging mechanism is used to close the main contacts.

## Degradation Factors

The factors which can cause degradation of the charging mechanism are the following:

- Dusty or dirty environment
- Shocks
- Corrosive atmosphere
- Idle for long periods of time

## Potential Hazards

Performing regular maintenance on the charging mechanism can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Charging mechanism is jammed.	–	Jammed mechanism

## Preventive Action


The following table lists the preventive maintenance procedures to be performed to maintain the charging mechanism.

Maintenance program	Preventive action	Procedure
Routine end-user preventive maintenance	Check the complete closing of the device poles.	Mechanism NII_ZA_1
	Operate the device manually and electrically.	Mechanism NII_ZA_2
	Charge the device electrically with MCH gear motor.	Mechanism NII_ZA_3
Intermediate end-user preventive maintenance	Check the MCH gear motor charging time at 0.85 Un.	Mechanism NIII_ZA_1
	Check the general condition of the mechanism.	Mechanism NIII_ZA_2
Manufacturer preventive maintenance	Check opening and closing forces.	Contact your Schneider Electric Services representative.
	Clean and regrease the mechanism.	

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain MicroLogic Active Control Unit

## Functions

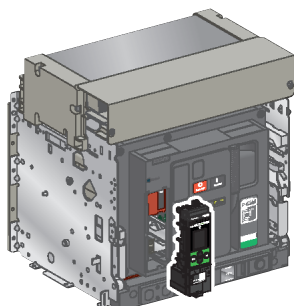

The control unit permanently monitors the electrical network and generates trip orders when electrical faults are detected.

Electronic component qualification data is usually quoted for a 10-year lifetime by the component suppliers according to the device mission profile. The control unit can operate more than 10 years, depending on the operating environmental conditions (for example, temperature, humidity, vibrations, mechanical shocks, corrosive atmosphere).

Schneider Electric recommends that the MicroLogic Active control unit, performer plug, sensor plug and the optional BCIM module are replaced:

- every 15 years in favorable or normal environmental conditions and device operating conditions, page 15.
- every 10 years in severe environmental conditions and device operating conditions, page 16.

## Firmware Update Policy

The MicroLogic Active control unit is the main component of the intelligent modular unit (IMU).

The primary reason for updating the firmware of a MicroLogic Active control unit is to obtain the latest MicroLogic Active features. If the latest MicroLogic Active features are not required, it is not mandatory to update the firmware of the MicroLogic Active control unit, the BCIM module, and the Enerlin'X devices of the IMU.

Use the latest version of EcoStruxure Power Commission software to update the firmware of the MicroLogic Active control unit.

After updating the firmware of one device, Schneider Electric recommends that you update the firmware of the other devices in the IMU to keep consistency and avoid discrepancies between devices. Before proceeding, check the compatibility of the other devices with the new firmware.

For more information about firmware update policy, refer to the following documents, page 7:

- DOCA0267•• *MasterPacT MTZ - MicroLogic Active Control Unit - Firmware Release Notes.*
- DOCA0395•• *Breaker Communication and Isolation Module (BCIM) for MicroLogic Active Control Unit - Firmware Release Notes.*

## Degradation Factors

The factors which can cause degradation of the control unit and electronic components are the following:

- Shocks
- Vibration
- Humidity
- High ambient temperature
- Corrosive atmosphere

## Potential Hazards

Performing regular maintenance on the control unit can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
High short-circuit current and no tripping order	–	Degradation of the breaking unit

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the control unit.

Maintenance program	Preventive action	Procedure
Routine end-user preventive maintenance	Check the general condition of the device.	Device NII_ZA_1
Intermediate end-user preventive maintenance	Check overcurrent protection.	Device NIII_ZA_4
Manufacturer preventive maintenance	Perform aging diagnostics to evaluate when to preventively replace the MicroLogic Active control unit.	Contact your Schneider Electric Services representative.

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain the Communication System


## Functions

The communication system allows data transmission between the device and the remote controller. It can be used to remotely operate (open/close) the device.

Maintenance, production, management, and other departments can use this function to manage energy and assets, and monitor the quality of the electrical network.

In MasterPacT MTZ circuit breakers, the device data can be accessed by using the ULP port module connected to a communication interface and an appropriate software tool such as EcoStruxure Power Commission software.

MasterPacT MTZ devices with communication interface:

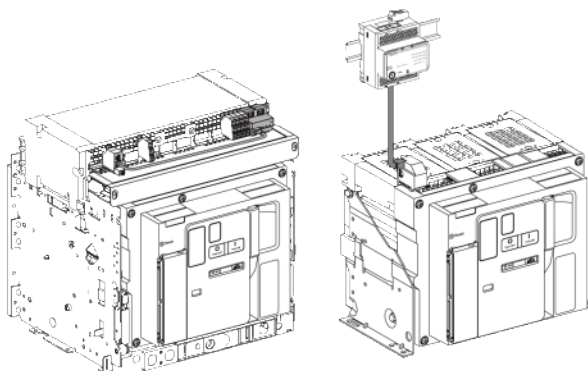

## Degradation Factors

The factors which can cause degradation of the communication system are the following:

- Vibration
- Electro-magnetic field disturbances
- Equipment and software breakdown
- Modification of communication system architecture

## Potential Hazards

Performing regular maintenance on the communication system can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Incorrect or no operation (critical to safety) as a result of misleading information	Death or serious injury	–
Communication loss	–	Inappropriate functioning of devices, communication interfaces or modules on communication network

Hazard	Consequence	
	Personal injury	Equipment damage
Incorrect decision taken as a result of misleading information (status, metering, health)	–	Inappropriate functioning of devices, communication interfaces or modules on communication network
Incorrect system management leading to financial losses	–	Inappropriate functioning of devices, communication interfaces or modules on communication network

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the communication system.

Maintenance program	Preventive action	Procedure
Manufacturer preventive maintenance	Check data transmission over the IFE Ethernet interface or EIFE embedded Ethernet interface.	Contact your Schneider Electric Services representative.

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain Auxiliary Circuits

## Functions


Auxiliary circuits are made of two parts, an electrical or mechanical accessory with the associated wiring:

- Voltage releases (XF, MX, MN)
- Gear motor (MCH)
- Indication contacts (OF, CE, CT, CD, SDE, PF)

Auxiliary wiring links devices and transmits the following information:

- Orders to the control devices
- Status-condition information

## Voltage Releases



The voltage releases (XF, MX, MN) can be standard, reinforced, or with diagnostic and communicating function (XF, MX) or with diagnostic function (MN).

The XF closing voltage release closes the circuit breaker instantaneously when powered if the spring mechanism is charged.

The MX opening voltage release opens the circuit breaker instantaneously when powered.


The MN undervoltage release instantaneously opens the circuit breaker when its supply voltage drops to a value between 35% and 70% of its rated voltage.

It is important to periodically check operation of the voltage releases at minimum values. Whether the auxiliary needs to be replaced depends on the operating conditions and environmental conditions.

It is recommended that you replace voltage releases:

- every 15 years in favorable or normal environmental conditions and device operating conditions, page 15.
- every 10 years in severe environmental conditions and device operating conditions, page 16.

## MCH Gear Motor

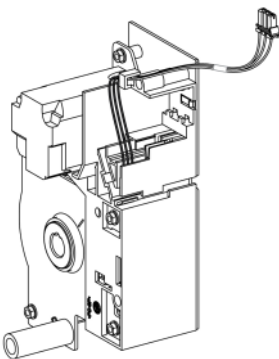

The MCH gear motor automatically recharges the operating mechanism springs as soon as the circuit breaker is closed.

The MCH gear motor makes it possible to close the device immediately after opening. The spring charging handle serves as a backup if the auxiliary voltage is interrupted.

Given the mechanical forces exerted to charge the mechanism, periodic checks on the operation of the MCH gear motor and the charging time are required to help ensure the device closing function.

With MasterPacT MTZ devices, the number of charging operations is recorded, giving information on the remaining useful life of the MCH gear motor.

It is recommended that you replace the MCH gear motor:

- every 15 years in favorable or normal environmental conditions and device operating conditions, page 15.

- every 10 years in severe environmental conditions and device operating conditions, page 16.

## Indication Contacts



Contacts indicate the following information:

- OF: position of the main contacts (opened or closed)
- CE, CT, CD: position of the device in the chassis (connected, test, or disconnected)
- SDE: trip due to an electrical fault
- PF: the device is ready to close

This information enables a remote operator to respond as necessary. Incorrect indications can result in erroneous device operation.

Improper contact performance can be caused by vibrations, corrosion, or abnormal temperature rises.

Preventive maintenance consists in regularly checking that contacts conduct or isolate correctly, depending on their position.

## Auxiliary Wiring



Auxiliary wiring is used to transmit the following information:

- Orders to the various control devices
- Status-condition information

Incorrect connections or damaged insulation can cause unintended opening or non-operation of the circuit breaker.

The auxiliary wiring must be regularly inspected and replaced as required, particularly in environments with vibrations, high ambient temperatures, or corrosive atmosphere.

## Degradation Factors

The factors which can cause degradation of the auxiliaries are the following:

- High ambient temperature
- Humidity
- Corrosive atmosphere
- Vibration

## Potential Hazards

Performing regular maintenance on the auxiliaries can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Loose wiring	Electric shock	–
Loss of local control (open/close), such as emergency stop	Death or serious injury	–
Loss of remote control (open/close)	–	Unwanted operation
Misleading information	–	Unwanted operation

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the control unit.

Maintenance program	Preventive action	Procedure
Routine end-user preventive maintenance	Check auxiliary wiring and insulation.	Auxiliaries NII_ZA_1
Intermediate end-user preventive maintenance	Check operation of indication contacts (OF, PF).	Auxiliaries NIII_ZA_1
	Check closing operation with XF closing voltage release at 0.85 Un.	Auxiliaries NIII_ZA_2
	Check opening operation with MX opening voltage release at 0.70 Un.	Auxiliaries NIII_ZA_3
	Check closing and opening operations with MN undervoltage release.	Auxiliaries NIII_ZA_4
	Check time delay of MNR delayed undervoltage release.	Auxiliaries NIII_ZA_5
Manufacturer preventive maintenance	Check opening time of MX opening voltage release.	Contact your Schneider Electric Services representative.
	Check closing time of XF closing voltage release.	
	Check opening time of MN undervoltage release.	
	Preventively replace the voltage releases XF, MX, MN.	

For more information, refer to Preventive Maintenance Programs, page 39.

# How to Maintain Mechanical Interlocking Systems

## Functions

A source changeover system, either manual or automatic (ATS), enhances the continuity of service of an electrical distribution system.


Mechanical interlocking between the devices in the source changeover system prevents the closing of two devices simultaneously.

The use of mechanical interlocking for source-changeover systems using cables or connecting rods is compulsory for Automatic Transfer Switch (ATS) applications.

A mechanical interlocking system is made of the following parts depending on the type of MasterPacT MTZ devices:

- An interlocking plate on the side of each MasterPacT MTZ device.
- A set of cables or connecting rods linking the MasterPacT MTZ devices.

The figure below illustrates a mechanical interlocking system by cable for source changeover between two MasterPacT MTZ2 devices:

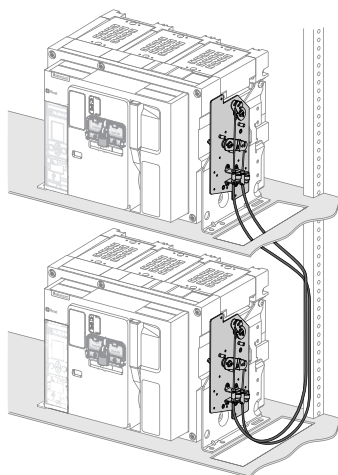

## Degradation Factors

The factors which can cause degradation of the mechanical interlocking system are the following:

- Dusty or dirty environment
- Vibration

## Potential Hazards

Performing regular maintenance on the mechanical interlocking system can help to avoid the potential hazards and consequences listed in the following table.

Hazard	Consequence	
	Personal injury	Equipment damage
Inappropriate or no operation of the source changeover system	Death or serious injury	–

## Preventive Action

The following table lists the preventive maintenance procedures to be performed to maintain the mechanical interlocking system.

Maintenance program	Preventive action	Procedure
Routine end-user preventive maintenance	Operate interlocking systems	Mechanical Interlocking NII_ZA_1
Manufacturer preventive maintenance	Operate mechanical interlocking by cable.	Contact your Schneider Electric Services representative.
	Operate mechanical interlocking by rod.	

For more information, refer to Preventive Maintenance Programs, page 39.

# Preventive Maintenance Programs

## What's in This Part

General Safety Instructions .....	40
Routine End-User Preventive Maintenance Program .....	41
Intermediate End-User Preventive Maintenance Program .....	43
Manufacturer Preventive Maintenance Program .....	45
Schneider Electric Expert Diagnostics Program .....	46

## General Safety Instructions

Read the following instructions carefully and make sure to follow them while performing a maintenance program.

### **DANGER**

#### **HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH**

- Apply appropriate personal protective equipment (PPE) and follow safe electrical work practices. See NFPA 70E or CSA Z462 or local equivalent.
- This equipment must be installed and serviced by qualified electrical personnel.
- Turn off all power supplying this equipment before performing maintenance inspections. Assume that all circuits are live until they are de-energized, tested, grounded, and tagged. Consider all sources of power, including the possibility of backfeeding and control power.
- Always use a properly rated voltage sensing device to confirm that power is off.
- Replace all devices, doors, and covers before turning on power to this equipment.
- Beware of potential hazards and carefully inspect the work area for tools and objects that may have been left inside the equipment.

**Failure to follow these instructions will result in death or serious injury.**

# Routine End-User Preventive Maintenance Program

## Definition

The Routine end-user preventive maintenance program can be carried out by:

- Trained and qualified end-user personnel.
- Trained and qualified maintenance services provider personnel.
- Schneider Electric Services representatives.

The Routine end-user preventive maintenance program comprises:

- Limited visual inspection.
- Function checks.
- Replacement by standard exchange of certain assemblies.

The Routine end-user preventive maintenance program must be performed every year in the case of normal operating conditions. Refer to the recommended frequency for the Routine end-user maintenance program for other cases, page 17.

## Procedures

The Routine end-user procedures are described in detail in DOCA0306•• *MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures*, page 7 .

Part	Procedure title	Procedure name
Device	Check the general condition of the device	Device NII_ZA_1
Mechanism	Check the complete closing of device poles	Mechanism NII_ZA_1
	Charge and operate the device manually	Mechanism NII_ZA_2
	Charge and operate the device electrically	Mechanism NII_ZA_3
Auxiliaries	Check auxiliary wiring and insulation	Auxiliaries NII_ZA_1
Control unit	Check device tripping and operation of SDE fault-trip indication contacts	Control Unit NII_ZA_1
	Check operation of Energy Reduction Maintenance Settings (ERMS)	Control Unit NII_ZA_3
Device locking	Operate device keylocks	Device Locking NII_ZA_1
	Operate device padlocks	Device Locking NII_ZA_2
Chassis	Check device racking operation	Chassis NII_ZA_1
	Check IBPO racking interlock between racking handle and opening pushbutton (MasterPacT MTZ2/MTZ3)	Chassis NII_ZA_2
Chassis locking	Operate chassis keylocking system	Chassis Locking NII_ZA_1
	Operate chassis padlocking system	Chassis Locking NII_ZA_2
Mechanical interlocking	Operate interlocking systems	Mechanical Interlocking NII_ZA_1

## Tools

Performing the procedures of the maintenance program requires the following:

- A standard toolbox with electrical tools and equipment for an electrician.
- Specific tools, detailed in the maintenance procedures. Refer to DOCA0306\*\* *MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures*, page 7.

## Time Required

The average total time required for experienced, trained, and qualified personnel to perform this maintenance program is as follows:

- 15 minutes for a fixed device with all accessories installed
- 20 minutes for a drawout device with all accessories installed

# Intermediate End-User Preventive Maintenance Program

## Definition

The Intermediate end-user preventive maintenance program can be carried out by:

- Trained and qualified maintenance services provider personnel.
- Schneider Electric Services representatives.

The Intermediate end-user preventive maintenance program includes the Routine end-user preventive maintenance program, page 41.

The Intermediate end-user preventive maintenance program comprises:

- Extended visual inspection.
- Extended function checks.
- Part and system servicing (cleaning, greasing).
- Part replacement (based on time intervals or number of units of use).

The Intermediate end-user preventive maintenance program must be performed every two years in the case of normal operating conditions. Refer to the recommended frequency for the Intermediate end-user maintenance program for other cases, page 17.

## Procedures

The Intermediate end-user procedures are described in detail in DOCA0306\*\* *MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures*, page 7 .

Part	Procedure title	Procedure name
Mechanism	Check the MCH gear motor charging time at 0.85 Un	Mechanism NIII_ZA_1
	Check the general condition of the mechanism	Mechanism NIII_ZA_2
	Check the number of device operating cycles	Mechanism NIII_ZA_3
Breaking unit (arc chutes + contacts)	Check the condition of the breaking unit	Breaking Unit NIII_ZA_1
	Check mounting of arc chutes and filter cleanliness	Breaking Unit NIII_ZA_2
Auxiliaries	Check operation of indication contacts (OF, PF)	Auxiliaries NIII_ZA_1
	Check closing operation with XF closing voltage release at 0.85 Un	Auxiliaries NIII_ZA_2
	Check opening operation with MX opening voltage release at 0.70 Un	Auxiliaries NIII_ZA_3
	Check closing and opening operations with MN undervoltage release	Auxiliaries NIII_ZA_4
	Check time delay of MNR delayed undervoltage release	Auxiliaries NIII_ZA_5
Control unit	Check microswitches OF/SDE/PF/CH	Control Unit NIII_ZA_1
	Save protection settings, reports, and event logs with EcoStruxure Power Commission software	Control Unit NIII_ZA_3
	Check overcurrent protection	Control Unit NIII_ZA_4
Chassis	Check operation of CD, CT, CE position contacts and EF auxiliary contacts	Chassis NIII_ZA_1
	Check operation of safety shutters	Chassis NIII_ZA_2
	Clean chassis and check presence of grease on chassis	Chassis NIII_ZA_3

Part	Procedure title	Procedure name
	Check disconnecting contact clusters	Chassis NIII_ZA_4
Power connections	Check connection system	Power Connections NIII_ZA_1

## Tools

Performing the procedures of the maintenance program requires the following:

- A standard toolbox with electrical tools and equipment for an electrician.
- Specific tools, detailed in the maintenance procedures. Refer to DOCA0306\*\* *MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures*, page 7.

## Time Required

In addition to the Routine end-user maintenance program, the average time required for experienced, trained, and qualified maintenance personnel to perform this maintenance program is as follows:

- 45 minutes for a fixed device with all accessories installed
- 1 hour for a drawout device with all accessories installed

# Manufacturer Preventive Maintenance Program

## Definition

The Manufacturer preventive maintenance program must be done exclusively by Schneider Electric Services representatives.

The Manufacturer preventive maintenance program includes the Routine and Intermediate end-user preventive maintenance programs, page 43.

The Manufacturer preventive maintenance program comprises:

- Complete function checks.
- Condition checks (test-based).
- Complete part and system servicing (cleaning, greasing).
- Control unit replacement (diagnostic-based).

The Manufacturer preventive maintenance program must be performed every five years in the case of normal operating conditions and user application with low criticality. Refer to the recommended frequency for the Manufacturer maintenance program for other cases, page 18.

## Procedures

Part	Procedure title
Device	Measure insulation resistance
Mechanism	Check opening and closing forces
	Clean and regrease the mechanism
Breaking unit	Measure the contact resistance for each pole
Auxiliaries	Check opening time of MX opening voltage release
	Check closing time of XF closing voltage release
	Check opening time of MN undervoltage release
	Preventively replace the XF, MX, MN voltage releases and MCH gear motor
Control unit	Preventively replace MicroLogic Active control unit and associated modules
Chassis	Check connection/disconnection torque
	Clean and regrease chassis of MasterPacT drawout devices
Communication system	Check data transmission over the IFE Ethernet interface or EIFE embedded Ethernet interface
Mechanical interlocking	Check mechanical interlocking by cable
	Check mechanical interlocking by rod

## Time Required

The average total time required for a Schneider Electric Services representative to perform this maintenance program including the Intermediate one, is as follows:

- From 1.5 hours to 2 hours depending on the frame size, for a fixed device with all accessories installed.
- From 2 hours to 3 hours depending on the frame size, for a drawout device with all accessories installed.

# Schneider Electric Expert Diagnostics Program

## Presentation

Schneider Electric offers an expert diagnostics program, used by Schneider Electric Services Representatives

## Performing Diagnostics of MasterPacT Devices with Schneider Electric

Schneider Electric offers a large portfolio of manufacturer diagnostic services for electrical distribution equipment.

Enhanced Manufacturer Maintenance by Schneider Electric is condition-based maintenance where inspection and/or testing, analysis, and the ensuing maintenance actions are conducted on site. Testing, analysis, and ensuing recommended maintenance actions for low voltage (LV) circuit breakers and switch-disconnectors, for example MasterPacT MTZ devices, are provided by the following diagnostics programs:

- ProDiag Trip Unit
- ProDiag Breaker
- ProDiag Clusters

The ProDiag diagnostics programs deliver a comprehensive report with data collected during testing, along with expert recommendations based on analytics. This enables you to anticipate downtime and improve the availability of your installation.

Contact your Schneider Electric Services representative for more information.

## ProDiag Trip Unit

Designed by Schneider Electric, ProDiag Trip Unit is used to perform diagnostics of circuit breaker control unit tripping performance.

Accurate tripping time operation in accordance with control unit settings defined for an electrical installation is now a strategic function for evaluating protection performance. Fault detection and tripping speed reaction stops short-circuits from creating high incident energy levels.

ProDiag Trip Unit can help to mitigate the risks of potential failure of LV circuit breaker control unit performance by:

- Detection of tripping time drifts.
- Verification of LV circuit breaker and control unit features according to electrical network characteristics (breaking capacity, discrimination).
- Analysis of the history of alarms and events.

Non-performing LV circuit breaker control unit causes unwanted effects such as:

- Unintended trips (power outage).
- Downstream industrial equipment inefficiencies.
- Breakdowns.
- Longer short-circuits (overheating and internal fires).
- Circuit breaker and switchgear destruction, or even complete destruction of the electrical room.

ProDiag Trip Unit helps the end user to discover and understand LV circuit breaker control unit performance and criticality. Diagnosis is conducted on de-energized LV circuit breaker and only by Schneider Electric Services representatives.



Regular diagnosis of LV circuit breaker control unit tripping performance is delivered with the Complete Manufacturer Maintenance program. This solution brings the end user the following benefits:

- Help ensure the protection of downstream LV electrical distribution equipment, goods, and people operating them.
- Enhance reliability, mitigating unintended shutdown risks and operating costs.
- Extend the equipment lifespan, optimizing the total cost of ownership.

## ProDiag Breaker

Designed by Schneider Electric, ProDiag Breaker diagnostics evaluate the performance of opening, closing, and spring charging operations.

A quick and reliable opening of LV circuit breaker is a strategic function for evaluating the complete operating chain. The fault detection rate and reaction speed stops short-circuits from creating high incident energy level.

ProDiag Breaker is used to mitigate the risk of LV circuit breaker electro-kinematic incident. ProDiag Breaker identifies the symptoms of undetected incident or degradation of the equipment that can cause unwanted effects like:

- Stress on internal moving parts.
- Accelerated wear of internal moving parts.
- Overheating and/or internal fires.
- Circuit breaker and switchgear destruction.
- Electrical room complete destruction.

ProDiag Breaker is conducted on de-energized LV circuit breaker and only by Schneider Electric Services representatives.

Regular diagnosis of electric and kinematic performance of LV circuit breakers is delivered with the Advanced Manufacturer Maintenance program. This solution brings the end user the following benefits:

- Alert in the early stages of above described phenomena not detected during regular preventive maintenance.
- Help ensure the protection of downstream LV electrical distribution equipment, goods, and people operating them.
- Enhance reliability, mitigating unexpected shutdown risks and operating costs.
- Extend the equipment lifespan, optimizing the total cost of ownership.

## ProDiag Clusters

Designed by Schneider Electric, ProDiag Clusters is used to diagnose early stages of connection cluster deterioration not detected during regular preventive

maintenance. This deterioration can result from one or more of the following factors:

- Severe environmental conditions
- User application with high criticality
- Accelerated aging process caused by racking-out and racking-in operations
- Electrical stress
- Uneven maintenance

# Device Aging

## What's in This Part

Causes of Aging.....	50
Influence of Temperature on Aging .....	51
Influence of Load on Aging.....	52
Influence of Relative Humidity on Aging .....	53
Influence of Salt Environment on Aging.....	54
Influence of Harmonics on Aging .....	55
Influence of Dust on Aging .....	56
Influence of Corrosive Atmosphere on Aging .....	57
Influence of Vibration on Aging .....	59
Influence of Operating Cycles on Aging.....	60
Influence of Interrupted Currents on Aging .....	61

# Causes of Aging

## Introduction

Switchboards and switchgear age whether they are in operation or not. Aging is due primarily to the influence of the environment and the operating conditions.

## Influence of the Environment

A device placed in a given environment is subjected to its effects. The main environmental factors that accelerate device aging are:

- Temperature
- Percent load
- Relative humidity
- Salt environment
- Current harmonics
- Dust
- Corrosive atmosphere
- Vibration
- Operating cycles
- Interrupted currents

The tables in this chapter summarize for each factor:

- Why it is harmful: influence
- How to identify it: appearance
- Impact on operation: consequences

# Influence of Temperature on Aging

## Ambient Temperature Outside the Switchboard

The ambient temperature around the switchboard affects the device temperature, which is itself affected by the percent load.

Major variations in temperature (greater than 30 °C (86 °F)) cause both mechanical stresses (thermal expansion) and condensation, both of which can accelerate aging.

Influence	Appearance	Consequences
Aging of plastic insulation. Deterioration of the mechanical characteristics of plastic parts (insulation, case) for which deterioration speed is increased with temperature rise.	Change in color	Breaking of parts leading to potential failure of functions
<ul style="list-style-type: none"> <li>Hardening of grease.</li> <li>Elimination of grease on disconnecting contact clusters.</li> </ul>	<ul style="list-style-type: none"> <li>Change in color and viscosity</li> <li>Caramel color of clusters</li> </ul>	<ul style="list-style-type: none"> <li>Device cannot be operated</li> <li>Increase of racking forces exerted on clusters</li> </ul>
Deterioration of insulating varnishes on coils.	Burning smell	Potential failure of coils (current transformers, MN, MX, or XF voltage releases, MCH gear motor, RES electrical remote reset)
Hardening of glues.	Visual	Loss of labels
Deterioration of electronic components.	Modified display of LCDs	<ul style="list-style-type: none"> <li>Interruption of display</li> <li>Nuisance tripping or no tripping</li> </ul>
Deterioration of opto-electronic devices and SCRs.	Not identifiable	Possible transmission of erroneous orders
Interruption of battery backup power.	Not identifiable	Trip-cause indication not displayed

## Recommendations

The maintenance and installation recommendations according to the annual average ambient temperature  $T_a$  are defined in the following table:

Annual average ambient temperature $T_a$	Description	Maintenance recommendations	Installation recommendations
< 25 °C (77 °F)	Optimum operating conditions	Implement the Intermediate program.	No particular recommendation
25 to 35 °C (77 to 95 °F)	A 10 °C (50 °F) increase in the ambient temperature is equivalent to a 5 % increase in the percent load.	Carry out more frequent periodic checks, page 15.	No particular recommendation
35 to 45 °C (95 to 113 °F)	A 20 °C (68 °F) increase in the ambient temperature is equivalent to a 10 % increase in the percent load.	Carry out more frequent periodic checks, page 15.	Install forced-air ventilation in the switchboard, or air conditioning for the electrical room.

**Example:** Influence of the ambient temperature on the service life for a 1,000 A device, with an 80 % load.

Annual average ambient temperature $T_a$	Typical service life of the device (electronic components excluded)
25 °C (77 °F)	30 years
35 °C (95 °F)	27 years
45 °C (113 °F)	25 years

# Influence of Load on Aging

## Percent Load (I/In)

The percent load affects the device temperature, which is itself affected by the ambient temperature.

Influence	Appearance	Consequences
Aging of plastic insulation	Change in color of insulation	Breaking of parts leading to potential failure of functions.
Aging of grease	Change in color and viscosity	Increase in mechanical friction.
Aging of electronic components	Modified display of LCDs	A 10 °C (50 °F) increase (that is, an 85 % load) reduces the service life of components by approximately half.
Deterioration of characteristics: <ul style="list-style-type: none"> <li>of steel springs when temperature &gt; 100 °C (212 °F)</li> <li>of stainless steel springs when temperature &gt; 200 °C (392 °F)</li> </ul>	Rupture	Non-operation of mechanisms.

## Recommendations

The maintenance and installation recommendations according to the value of percent load (I/In) are defined in the following table:

Percent load	Description	Maintenance recommendations	Installation recommendations
$I/In \leq 80 \%$ , 24/24 h	Maximum percent load taken into account in sizing the installation. At this percent load, temperature rise is reduced approximately 40 % with respect to a 100 % load.	Implement the Intermediate program.	Normal conditions
$I/In \leq 90 \%$ , 8/24 h	At this percent load, temperature rise is reduced only 20 %. Heating and cooling cycles impact on the mechanical junctions of the power circuit.	Carry out more frequent periodic checks, page 15.	Normal conditions
$I/In \leq 90 \%$ , 24/24 h	The thermal stress for continuous operation is three times higher than in the previous case, but the absence of thermal cycles slows aging of the electromechanical components.	Preventive maintenance is difficult due to the continuous process	Normal conditions
$I/In = 100 \%$ , 8/24 h	Between 90 % and 100 %, temperature rise is close to its maximum value. Heating and cooling cycles impact on the mechanical junctions of the power circuit, with major impact on aging.	<ul style="list-style-type: none"> <li>Carry out more frequent periodic checks, page 15.</li> <li>Inspect for condensation.</li> </ul>	<ul style="list-style-type: none"> <li>Provide ventilation for the switchboard.</li> <li>Install a device with a higher rating.</li> </ul>
$I/In = 100 \%$ , 24/24 h	Between 90 % and 100 %, temperature rise is close to its maximum value. This situation has a major impact on aging. It is not recommended.	<ul style="list-style-type: none"> <li>Preventive maintenance is difficult due to the continuous process.</li> <li>Plan more frequent periodic checks.</li> </ul>	<ul style="list-style-type: none"> <li>Spread the load over other outgoers.</li> <li>Install a device with a higher rating.</li> </ul>

# Influence of Relative Humidity on Aging

## Relative Humidity

Influence	Appearance	Consequences
Corrosion of metal surfaces that is accelerated when a pollutant is present (for example, corrosive gas, salt, chlorine).	Appearance of: <ul style="list-style-type: none"> <li>Red rust on iron</li> <li>White rust on zinc</li> <li>Blue deposit on copper</li> <li>Black deposit on silver</li> </ul>	<ul style="list-style-type: none"> <li>Increase in friction</li> <li>Potential risk of mechanical rupture resulting in non-operation of mechanisms</li> <li>Increase in contact resistance (clusters and main contacts)</li> </ul>
Deterioration of dielectric qualities of plastics.	White traces on case	Potential risk of a reduction in insulation
Deterioration of electronic components, in particular SMCs and silver-coated components.  This phenomenon is worsened by the presence of H <sub>2</sub> S corrosive gas (hydrogen sulphide).	<ul style="list-style-type: none"> <li>Not visible</li> <li>Appearance of dendrites on electronic boards</li> </ul>	Short-circuiting of circuits resulting in non-operation of control unit protection, measurement, indication and communication functions
Deterioration of electronic components, in particular non-varnished copper circuits.	<ul style="list-style-type: none"> <li>Not visible</li> <li>Erosion of copper tracks</li> <li>Oxidation of metal connectors of components and metal cases</li> <li>Oxidation of connectors of integrated-circuits mounted on supports</li> </ul>	<ul style="list-style-type: none"> <li>Potential failure due to short-circuit or open circuit on electronic components</li> <li>Rupture of component connectors along case</li> <li>Poor contact with integrated-circuit supports</li> </ul>
Degradation of opto-electronic components.	–	Potential failure of data transmission

## Recommendations

The maintenance and installation recommendations according to the relative humidity are defined in the following table:

Relative humidity	Description	Maintenance recommendations	Installation recommendations
≤ 70 %	Level of relative humidity generally found in continental and temperate zones. The level is generally lower in switchboards due to the internal temperature rise. No significant deterioration is noted at this level.	Preventive maintenance	No particular recommendation
70 % to 85 %	Level of relative humidity generally found in zones close to water. Possible appearance of condensation on cold parts and accelerated rusting.	<ul style="list-style-type: none"> <li>Carry out more frequent periodic checks, page 15.</li> <li>Measurement of insulation resistance (dielectric strength) is advised every five years.</li> </ul>	No particular recommendation
> 85 %	<ul style="list-style-type: none"> <li>Level of relative humidity generally found in tropical zones and certain factories (for example, paper mills).</li> <li>Increased possibility of condensation and rust resulting in difficulties to disconnect devices, possibility of non-opening or non-closing.</li> </ul>	<ul style="list-style-type: none"> <li>Carry out more frequent periodic checks, page 15.</li> <li>Inspect for rust on metal parts.</li> <li>Measurement of insulation is imperative every two years.</li> </ul>	Install heating resistors in the switchboard.

# Influence of Salt Environment on Aging

## Salt Environment

Influence	Appearance	Consequences
Corrosion of metal parts	Appearance of: <ul style="list-style-type: none"> <li>• White rust on zinc coatings</li> <li>• Red rust on steel</li> </ul>	<ul style="list-style-type: none"> <li>• Increase in friction</li> <li>• Freezing of mechanism</li> <li>• Broken springs</li> <li>• Blocking of cores of MX/XF/MN voltage releases</li> </ul>
Possibility of salt deposits on electronic circuits when thick salt mists occur.	Appearance of salt bridges on electronic boards	Potential failure of electronic systems due to short-circuiting of circuits, particularly non-varnished circuits.
Possibility of conducting salt deposits on the device when thick salt mists occur.	White deposit	Deterioration of device dielectric withstand resulting in possibility of phase-to-frame short-circuit and a phase-to-phase short-circuit if an overload occurs.

## Recommendations

The maintenance and installation recommendations according to the salt environment are defined in the following table:

Thresholds	Description	Maintenance recommendations	Installation recommendations
No salt mist	No influence	Implement the Intermediate program.	No particular recommendation
Moderate salt mist < 10 km (6.21 miles) from coast	Moderate aging of switchgear	Carry out more frequent periodic checks, page 15.	No particular recommendation
Significant salt mist < 1 km (0.621 miles) from coast	<ul style="list-style-type: none"> <li>• Rapid aging of exposed switchgear.</li> <li>• On average, service life is divided by a factor of three for devices not installed in a switchboard.</li> </ul>	<ul style="list-style-type: none"> <li>• Carry out more frequent periodic checks, page 15.</li> <li>• Test the dielectric withstand every two years.</li> </ul>	<ul style="list-style-type: none"> <li>• Install the switchgear in a switchboard or a room offering protection from the salt mist.</li> <li>• Increase the switchboard IP value (IP54 is advised).</li> </ul>

# Influence of Harmonics on Aging

## Harmonics

Influence	Appearance	Consequences
Increase in skin effect, proximity effect, iron loss, Foucault/Eddy currents	<ul style="list-style-type: none"> <li>Change in color of terminals, insulators, and grease</li> <li>Modified display of LCDs</li> </ul>	Harmonics cause temperature rise greater than that of the fundamental current
Possible overload of neutral if third-order harmonics and their multiples are present	Distorted waveform	<ul style="list-style-type: none"> <li>Erroneous current value</li> <li>Nuisance tripping if non-rms control units</li> </ul>

## Recommendations

The maintenance and installation recommendations according to the harmonics are defined in the following table:

THDi in % of In	Description	Maintenance recommendations	Installation recommendations
≤ 30 %	No notable influence on aging.	Implement the Intermediate program.	No particular recommendation
30 % to 50 %	At 40 % THDI, potential heat generation is approximately 10 % higher, corresponding to 5 % more current.	Carry out more frequent periodic checks, page 15.	Standard filtering with an inductor to reduce harmonics
> 50 %	–	Carry out more frequent periodic checks, page 15.	If necessary: <ul style="list-style-type: none"> <li>Oversize the neutral</li> <li>Oversize switchgear</li> <li>Filtering is mandatory</li> </ul>

# Influence of Dust on Aging

## Dust

Influence	Appearance	Consequences
Deposit on grease of mechanisms (device and chassis)	Change in color and texture of greases	<ul style="list-style-type: none"> <li>Premature wear of mechanisms because dust mixed with grease can be abrasive.</li> <li>Increase in mechanical friction and freezing of moving parts</li> <li>Possibility of device not moving on chassis</li> <li>Possibility of device non-opening or non-closing</li> </ul>
Deposit on grease of clusters	Change in color and texture of greases	<ul style="list-style-type: none"> <li>Increase in racking forces exerted.</li> <li>Increased contact resistance and temperature rise</li> </ul>
Deposit on displays	–	Screen data not legible
Deposit on insulation	–	<ul style="list-style-type: none"> <li>Reduced insulation resistance (depends on type of dust)</li> <li>This phenomenon is worsened by the presence of humidity.</li> </ul>
Deposit on device contacts	–	Increased contact resistance and temperature rise

## Recommendations

The maintenance and installation recommendations according to the dust levels are defined in the following table:

Dust deposit	Description	Maintenance recommendations	Installation recommendations
Low level	Quantity of dust generally deposited on and around devices in commercial buildings and on standard industrial premises	<ul style="list-style-type: none"> <li>Implement the Intermediate program.</li> <li>Use a vacuum cleaner to remove dust deposits.</li> </ul>	Switchboard with standard IP
Moderate level	Quantity of dust deposited on and around devices inside switchboards equipped with filters or a ventilated IP54 enclosure, and installed in dusty environments (for example, cement works, grain mills, incineration installations, plastic and steel mills, and mines)	Carry out more frequent periodic cleaning, page 27.	Make sure that the switchboard remains closed.
High level	Quantity of dust deposited on and around devices inside switchboards without filters or without ventilated IP54 enclosure, and installed in dusty environments (for example, cement works, grain mills, incineration installations, plastic and steel mills, and mines)	Carry out more frequent periodic cleaning, page 27.	It is mandatory to install the switchgear in special equipment offering protection against dust.

# Influence of Corrosive Atmosphere on Aging

## Corrosive Atmosphere

Corrosive atmosphere	Influence	Appearance	Consequences	Thresholds per class in ppm <sup>(1)</sup>
SO <sub>2</sub> Sulphur dioxide	Corrosion of silver, aluminum, and bare copper  Phenomenon accelerated by high temperature and relative humidity.	<ul style="list-style-type: none"> <li>Blackening of exposed silver surfaces</li> <li>Appearance of dendrites on electronic and power circuits</li> </ul>	<ul style="list-style-type: none"> <li>Increased resistance of disconnecting contacts exposed to air</li> <li>Excessive device temperature rise</li> <li>Short-circuiting of circuits resulting in non-operation of the control unit</li> </ul>	<ul style="list-style-type: none"> <li>3C1: 0.037</li> <li>3C2: 0.11</li> <li>3C3: 1.85</li> <li>3C4: 4.8</li> </ul>
H <sub>2</sub> S Hydrogen sulphide	Sulphurization of silver. Phenomenon accelerated by high temperatures.	<ul style="list-style-type: none"> <li>Major blackening of exposed silver surfaces</li> <li>Appearance of dendrites on electronic and power circuits</li> </ul>	<ul style="list-style-type: none"> <li>Increased resistance of disconnecting contacts exposed to air</li> <li>Excessive device temperature rise</li> <li>Short-circuiting of circuits resulting in non-operation of the control unit</li> </ul>	<ul style="list-style-type: none"> <li>3C1: 0.0071</li> <li>3C2: 0.071</li> <li>3C3: 2.1</li> <li>3C4: 9.9</li> </ul>
Cl <sub>2</sub> Chlorine	Corrosion of metal parts	<ul style="list-style-type: none"> <li>Oxidation</li> <li>Inter-granular corrosion of stainless steel</li> </ul>	<ul style="list-style-type: none"> <li>Increase in friction</li> <li>Possibility of mechanical rupture</li> <li>Breaking of stainless-steel springs</li> </ul>	<ul style="list-style-type: none"> <li>3C1: 0.034</li> <li>3C2: 0.034</li> <li>3C3: 0.1</li> <li>3C4: 0.2</li> </ul>
NH <sub>3</sub> Ammoniac	<ul style="list-style-type: none"> <li>Attacks polycarbonates</li> <li>Corrodes copper</li> </ul>	<ul style="list-style-type: none"> <li>Cracking of polycarbonates</li> <li>Blackening of copper</li> </ul>	<ul style="list-style-type: none"> <li>Possibility of rupture</li> <li>Increased temperature rise</li> </ul>	<ul style="list-style-type: none"> <li>3C1: 0.42</li> <li>3C2: 1.4</li> <li>3C3: 14</li> <li>3C4: 49</li> </ul>
NO <sub>2</sub> Nitrogen oxide	Corrosion of metal parts	Oxidation	Increased temperature rise	<ul style="list-style-type: none"> <li>3C1: 0.052</li> <li>3C2: 0.26</li> <li>3C3: 1.56</li> <li>3C4: 5.2</li> </ul>
Oily atmospheres	Attacks polycarbonates	Cracking of polycarbonates	<ul style="list-style-type: none"> <li>Possibility of rupture</li> <li>Increased temperature rise</li> </ul>	–

(1) ppm = parts per million in volume

## Recommendations

The maintenance and installation recommendations according to the environment categories as per IEC 60721-3 standard are defined in the following table:

Class	Zone	Presence of corrosive gases	Impact on device	Maintenance recommendations	Installation recommendations
3C1	Rural zones or urban zones with low industrial activity	Negligible	No impact on service life because concentrations are very low.	Implement the Intermediate program.	No particular recommendation
3C2	Urban zones with scattered industrial activity and heavy traffic	Low level	Moderate impact on service life.	Implement the Intermediate program.	No particular recommendation
3C3	Immediate vicinity of industrial pollution  <b>Example:</b> paper mills, water treatment, chemicals, synthetic fibers, smelting plants	Significant level	<ul style="list-style-type: none"> <li>Major impact on device service life, particularly concerning temperature rise.</li> <li>No impact on electronic components with varnished boards.</li> </ul>	Implement the Intermediate program.	No particular recommendation
3C4	Inside polluting industrial premises  <b>Example:</b> paper mills, water treatment, chemicals, synthetic fibers, smelting plants	High level	<ul style="list-style-type: none"> <li>Significantly reduced service life if no particular precautions are taken.</li> <li>For electronic systems, no impact on varnished boards and gold-plated contacts</li> </ul>	<ul style="list-style-type: none"> <li>Carry out more frequent periodic checks, page 15.</li> <li>Change the grease on the disconnecting contacts by Condat Pyratex EP2 fluorinated grease.</li> </ul>	<ul style="list-style-type: none"> <li>Install the switchgear in a room offering protection from the pollution</li> <li>Use fixed rather than drawout devices</li> </ul>

# Influence of Vibration on Aging

## Vibration

Influence	Appearance	Consequences
Premature deterioration of contact surfaces (clusters and main contacts)	Not identifiable	Increased device temperature rise
Loosening of bolted assemblies	Not identifiable	Increase in mechanical play
Wear of mechanical parts	Not identifiable	Broken springs. Increase in mechanical play between parts
Appearance of fretting corrosion on auxiliary connections	Not identifiable	Erroneous information or interruption of continuity in data or supply, excessive temperature rise
Breaking of connectors on large electronic components (for example, large capacitors)	Not identifiable	Potential failure of protection function

## Recommendations

The maintenance and installation recommendations according to the vibrations are defined in the following table:

Thresholds (g)	Description	Maintenance recommendations	Installation recommendations
≤ 0.2 g	Normal condition, no impact on service life	Implement the Intermediate program.	No particular recommendation
0.2 g to 0.5 g	Reduced service life	Carry out more frequent periodic checks, page 15.	No particular recommendation
0.5 g to 0.7 g	Significant increase in incidents	<ul style="list-style-type: none"> <li>Carry out more frequent periodic checks, page 15.</li> <li>Check in particular the tightness of connections.</li> </ul>	Install switchgear on a rubber mounting bushing
≥ 0.7 g	Forbidden for standard devices	–	Use special devices

# Influence of Operating Cycles on Aging

## Number of Operating Cycles

Influence	Consequences
The number of operating cycles depends directly on the electrical and mechanical endurance of the device.	Device service life depends on the daily number of operating cycles.

**Example:** Influence of operating cycles on the service life for a MasterPacT MTZ2 2000 A device.

Number of cycles	Service life <sup>(1)</sup>
30 cycles per month, or one cycle per day	27 years
60 cycles per month, or two cycles per day	13 years
120 cycles per month, or 4 cycles per day	6 years
(1) Service life is defined for endurance of 10,000 cycles and an interrupted current of less than 0.4 In	

# Influence of Interrupted Currents on Aging

## Interrupted Currents

Influence	Appearance	Consequences
Wear of fixed and moving contacts	Deterioration of contacts	Beyond the electrical-endurance limit, device temperature rise increases due to the greater contact resistance and a reduction in the pressure of contacts.
Wear of the arc chutes (insulating materials, separators)	Deterioration of insulation	Beyond the electrical-endurance limit, the insulation (input/output and between phases) is reduced, which results in a reduction of device suitability for isolation.  In this case, the safety of persons is not guaranteed.

## Recommendations

The maintenance and installation recommendations according to the interrupted currents are defined in the following table:

Thresholds	Description
$I/I_n \leq 0.4$	This level of interrupted current corresponds to the mechanical durability (see Mechanical endurance).
$I/I_n \leq 0.8$	This level of interrupted current corresponds to approximately 125 % of the electrical durability.
$I/I_n$	This level of interrupted current corresponds to the electrical durability at the specified voltage (see Electrical endurance).

# Appendices

## What's in This Part

Operating Limits for MasterPacT MTZ IEC Devices With MicroLogic Active Control Unit .....	63
Related Documents for MasterPacT MTZ IEC Devices With MicroLogic Active Control Unit.....	65

# Operating Limits for MasterPacT MTZ IEC Devices With MicroLogic Active Control Unit

## Operating Limits of MasterPacT MTZ1 Devices

The maximum number of opening/closing cycles with no load depends on the rating and performance levels of the MasterPacT MTZ1 devices.

Type of MasterPacT MTZ1	Maximum number of cycles with periodic preventive maintenance
MTZ1 H1, H2, L1	12,500
MTZ1 H3	10,000

## Operating Limits of MasterPacT MTZ1 Parts

These tables show the maximum possible number of operating cycles before the parts below must be replaced during the device service life.

Type of MasterPacT MTZ1	Maximum number of cycles before replacement of the part	
	Arc chute (at In)	Main contacts (at In) <sup>(1)</sup>
MTZ1 06–16 440 V H1, H2, H3	6,000	6,000
MTZ1 06–16 690 V H1, H2	3,000	3,000
MTZ1 06–10 440 V L1	3,000	3,000
MTZ1 06–10 690 V L1	2,000	2,000

(1) If any contacts are worn, all contacts must be changed. It means that the complete breaking block is replaced.

Device	Maximum number of cycles before replacement of the part			
	XF/MX/MN voltage releases	MCH gear motor	Connecting-rod springs, interlocking mechanisms	Interlocking cables
MasterPacT MTZ1	12,500	5,000	12,500	3,000

## Operating Limits of MasterPacT MTZ2/MTZ3 Devices

The maximum number of opening/closing cycles with no load depends on the rating and performance levels of the MasterPacT MTZ2/MTZ3 devices.

Type of MasterPacT MTZ2/MTZ3	Maximum number of cycles with periodic preventive maintenance
MTZ2 08–16 N1, H1, H2, L1	25,000
MTZ2 20 N1, H1, H2, H3, L1	20,000
MTZ2 25–40 H1, H2, H3	20,000
MTZ3 40–63 H1, H2	10,000

## Operating Limits of MasterPacT MTZ2/MTZ3 Parts

In order to reach the maximum possible number of operating cycles, the parts below must be replaced during the device service life.

Type of MasterPacT MTZ2/MTZ3	Maximum number of cycles before replacement of the part		
	Arc chute (at In)	Main contacts (at In) <sup>(1)</sup>	Connecting-rod springs, interlocking mechanisms
MTZ2 08–16 N1, H1, H2	10,000	10,000	12,500
MTZ2 08–16 16 L1	3,000		
MTZ2 20 440 V N1, H1, H2	8,000	8,000	10,000
MTZ2 20 690 V N1, H1, H2	6,000	6,000	
MTZ2 20 440 V H3	2,000	8,000	
MTZ2 20 690 V H3		6,000	
MTZ2 20 L1	3,000	10,000	
MTZ2 25–40 440 V H1, H2	5,000	5,000	
MTZ2 25–40 690 V H1, H2	2,500	2,500	
MTZ2 25–40 440 V H3	1,250	5,000	
MTZ2 25–40 690 V H3		2,500	
MTZ3 40–63 H1, H2	1,500	3,000	

(1) If any contacts are worn, all contacts must be changed. It means that the complete breaking block is replaced.

Device	Maximum number of cycles before replacement of the part		
	XF/MX/MN voltage releases	MCH gear motor	Interlocking cables
MasterPacT MTZ2/MTZ3	12,500	8,000	3,000

# Related Documents for MasterPacT MTZ IEC Devices With MicroLogic Active Control Unit

## Related Documents for MasterPacT MTZ1 IEC Devices With MicroLogic Active Control Unit

Document title	Reference number
<i>MasterPacT MTZ with MicroLogic Active Control Unit - Catalog</i>	LVPEd225010EN
<i>MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures</i>	DOCA0306EN DOCA0306ES DOCA0306ZH
<i>MasterPacT MTZ1 IEC Circuit Breakers with MicroLogic Active Control Unit - User Guide</i>	DOCA0284EN DOCA0284ES DOCA0284ZH
<i>MasterPacT MTZ1 - Fixed IEC Circuit Breaker with MicroLogic Active Control Unit - Instruction Sheet</i>	PKR4242702
<i>MasterPacT MTZ1 - Drawout IEC Circuit Breaker with MicroLogic Active Control Unit - Instruction Sheet</i>	PKR4242802
<i>MicroLogic Active - Breaker Communication and Isolation Module (BCIM) for MasterPacT Circuit Breakers - Instruction Sheet</i>	BRU4329402
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Position Contacts (Connected / Disconnected / Test) - Instruction Sheet</i>	NVE16135
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Keylock for OFF Position Lock or Disconnected Position Lock - Instruction Sheet</i>	NVE16834
<i>MasterPacT MTZ1/MTZ2/MTZ3 - EIFE Embedded Ethernet Interface for one MasterPacT MTZ Drawout Circuit Breaker - Kits and Spare Parts - Instruction Sheet</i>	NVE23550
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Auxiliary Terminals - Instruction Sheet</i>	NVE35463
<i>MasterPacT MTZ1/MTZ2/MTZ3 - VDC Mismatch Protection - Instruction Sheet</i>	NVE35465
<i>MasterPacT MTZ1/MTZ2/MTZ3 - PF Ready-To-Close Contact - Instruction Sheet</i>	NVE35466
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Clusters - Instruction Sheet</i>	NVE35467
<i>MasterPacT MTZ1 - Connectors - Instruction Sheet</i>	NVE35507
<i>MasterPacT MTZ1 - Interphase Barriers - Instruction Sheet</i>	NVE35508
<i>MasterPacT MTZ1 - Safety Shutters - Instruction Sheet</i>	NVE35509
<i>MasterPacT MTZ1 - Arc Chute - Instruction Sheet</i>	NVE35511
<i>MasterPacT MTZ1 - Arc Chute Cover - Instruction Sheet</i>	NVE35512
<i>MasterPacT MTZ1 - OF ON/OFF Indication Contacts - Instruction Sheet</i>	NVE35513
<i>MasterPacT MTZ1 - MCH Gear Motor - Instruction Sheet</i>	NVE35514
<i>MasterPacT MTZ1 - Auxiliary Terminal Shield for Drawout MasterPacT - Instruction Sheet</i>	NVE35515
<i>MasterPacT MTZ1 - CDM Operation Counter - Instruction Sheet</i>	NVE35516
<i>MasterPacT MTZ1 - Door Escutcheon - Instruction Sheet</i>	NVE35517
<i>MasterPacT MTZ1 - Transparent Cover for Drawout MasterPacT Door Escutcheon - Instruction Sheet</i>	NVE35518
<i>MasterPacT MTZ1 - Door Interlock - Instruction Sheet</i>	NVE35519
<i>MasterPacT MTZ1 - Racking Interlock - Instruction Sheet</i>	NVE35520
<i>MasterPacT MTZ1 - IPA Cable-Type Door Interlock - Instruction Sheet</i>	NVE35521
<i>MasterPacT MTZ1 - Mechanical Interlocking for Source Changeover (2 Sources / Cable) - Instruction Sheet</i>	NVE35522
<i>MasterPacT MTZ1 - Mechanical Interlocking for Source Changeover (2 Sources / Rods) - Instruction Sheet</i>	NVE35523
<i>MasterPacT MTZ1/MTZ2/MTZ3 - MN-MX-XF Voltage Releases - Instruction Sheet</i>	NVE40749
<i>MasterPacT MTZ1/MTZ2/MTZ3 - MN-MX-XF Communicating Voltage Releases with Diagnostic Function - Instruction Sheet</i>	NVE40766
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Wiring Kit for MN-MX-XF Communicating Voltage Releases with Diagnostic Function - Instruction Sheet</i>	NVE40768
<i>MasterPacT MTZ1 - Microswitches OF/SDE/PF/CH - Instruction Sheet</i>	NVE56767

Document title	Reference number
<i>MasterPacT MTZ1 - VSPD Disconnected Position Locking - Instruction Sheet</i>	NVE56768
<i>MasterPacT MTZ1 - VBP Lockable Pushbutton Cover - Instruction Sheet</i>	NVE56769
<i>MasterPacT MTZ1 - VCPO OFF-Position Locking and BPFE Support - Instruction Sheet</i>	NVE56770
<i>MasterPacT MTZ1 3P/4P - Front Cover - Instruction Sheet</i>	NVE56771
<i>MasterPacT MTZ1 - Spring Charging Handle - Instruction Sheet</i>	NVE56772
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Set of 2 Cables for Interlocking 2.5 m (8.2 ft) - Instruction Sheet</i>	NVE61729
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Set of 2 Rods for Interlocking - Instruction Sheet</i>	NVE61744
<i>MasterPacT MTZ1 - Retrofit Kit for NT Chassis to MasterPacT MTZ1 - Instruction Sheet</i>	QGH31933
<i>MasterPacT MTZ1 - Resistor for MCH 440-480 Vac - Instruction Sheet</i>	QGH31935
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Locating Bracket for MN-MX-XF Voltage Releases - Instruction Sheet</i>	QGH60497

## Related Documents for MasterPacT MTZ2/MTZ3 IEC Devices With MicroLogic Active Control Unit

Document title	Reference number
<i>MasterPacT MTZ with MicroLogic Active Control Unit - Catalog</i>	LVPED225010EN
<i>MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures</i>	DOCA0306EN DOCA0306ES DOCA0306ZH
<i>MasterPacT MTZ2/MTZ3 IEC Circuit Breakers with MicroLogic Active Control Unit - User Guide</i>	DOCA0285EN DOCA0285ES DOCA0285ZH
<i>MasterPacT MTZ2/MTZ3 - Fixed IEC Circuit Breaker with MicroLogic Active Control Unit - Instruction Sheet</i>	PKR4242002
<i>MasterPacT MTZ2/MTZ3 - Drawout IEC Circuit Breaker with MicroLogic Active Control Unit - Instruction Sheet</i>	PKR4243502
<i>MicroLogic Active - Breaker Communication and Isolation Module (BCIM) for MasterPacT Circuit Breakers - Instruction Sheet</i>	BRU4329402
<i>MasterPacT MTZ2 3P/4P - Front Cover - Instruction Sheet</i>	NVE16117
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Position Contacts (Connected / Disconnected / Test) - Instruction Sheet</i>	NVE16135
<i>MasterPacT MTZ2/MTZ3 - VSPD Disconnected Position Locking - Instruction Sheet</i>	NVE16142
<i>MasterPacT MTZ2/MTZ3 - VCPO OFF-Position Locking and BPFE Support - Instruction Sheet</i>	NVE16146
<i>MasterPacT MTZ2/MTZ3 - VBP Lockable Pushbutton Cover - Instruction Sheet</i>	NVE16147
<i>MasterPacT MTZ2/MTZ3 - Spring Charging Handle - Instruction Sheet</i>	NVE16150
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Keylock for OFF Position Lock or Disconnected Position Lock - Instruction Sheet</i>	NVE16834
<i>MasterPacT MTZ1/MTZ2/MTZ3 - EIFE Embedded Ethernet Interface for one MasterPacT MTZ Drawout Circuit Breaker - Kits and Spare Parts - Instruction Sheet</i>	NVE23550
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Auxiliary Terminals - Instruction Sheet</i>	NVE35463
<i>MasterPacT MTZ1/MTZ2/MTZ3 - VDC Mismatch Protection - Instruction Sheet</i>	NVE35465
<i>MasterPacT MTZ1/MTZ2/MTZ3 - PF Ready-To-Close Contact - Instruction Sheet</i>	NVE35466
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Clusters - Instruction Sheet</i>	NVE35467
<i>MasterPacT MTZ2/MTZ3 - Connectors - Instruction Sheet</i>	NVE35472
<i>MasterPacT MTZ2/MTZ3 - Interphase Barriers - Instruction Sheet</i>	NVE35473
<i>MasterPacT MTZ2 - Disconnectable Front Connections for Fixed MasterPacT - Instruction Sheet</i>	NVE35474
<i>MasterPacT MTZ2/MTZ3 - Safety Shutters - Instruction Sheet</i>	NVE35476
<i>MasterPacT MTZ2/MTZ3 - Shutter Locking Block - Instruction Sheet</i>	NVE35477
<i>MasterPacT MTZ2/MTZ3 - VIVC Front Face Shutter Position Indication and Locking - Instruction Sheet</i>	NVE35478

<b>Document title</b>	<b>Reference number</b>
<i>MasterPacT MTZ2/MTZ3 - Arc Chute - Instruction Sheet</i>	NVE35479
<i>MasterPacT MTZ2/MTZ3 - KMT Grounding Kit - Instruction Sheet</i>	NVE35480
<i>MasterPacT MTZ2/MTZ3 - OF ON/OFF Indication Contacts - Instruction Sheet</i>	NVE35481
<i>MasterPacT MTZ2/MTZ3 - EF Combined Connected/Closed Contact - Instruction Sheet</i>	NVE35482
<i>MasterPacT MTZ2/MTZ3 - MCH Gear Motor - Instruction Sheet</i>	NVE35483
<i>MasterPacT MTZ2/MTZ3 - Auxiliary Terminal Shield for Drawout MasterPacT - Instruction Sheet</i>	NVE35484
<i>MasterPacT MTZ2/MTZ3 - CDM Operation Counter - Instruction Sheet</i>	NVE35485
<i>MasterPacT MTZ2/MTZ3 - Mounting Brackets - Instruction Sheet</i>	NVE35486
<i>MasterPacT MTZ2/MTZ3 - Door Escutcheon - Instruction Sheet</i>	NVE35491
<i>MasterPacT MTZ2/MTZ3 - Transparent Cover for Drawout MasterPacT Door Escutcheon - Instruction Sheet</i>	NVE35492
<i>MasterPacT MTZ2/MTZ3 - Door Interlock - Instruction Sheet</i>	NVE35493
<i>MasterPacT MTZ2/MTZ3 - Racking Interlock - Instruction Sheet</i>	NVE35494
<i>MasterPacT MTZ2/MTZ3 - IPA Cable-Type Door Interlock - Instruction Sheet</i>	NVE35495
<i>MasterPacT MTZ2/MTZ3 - Mechanical Interlocking for Source Changeover (2 Sources / Cable) - Instruction Sheet</i>	NVE35496
<i>MasterPacT MTZ2/MTZ3 - Mechanical Interlocking for Source Changeover (2 Sources / Rods) - Instruction Sheet</i>	NVE35497
<i>MasterPacT MTZ2/MTZ3 - Mechanical Interlocking for 3 Sources - Instruction Sheet</i>	NVE35498
<i>MasterPacT MTZ2/MTZ3 - Mechanical Interlocking for 2 Sources and 1 Replacement - Instruction Sheet</i>	NVE35499
<i>MasterPacT MTZ2/MTZ3 - Mechanical Interlocking for 2 Sources and 1 Coupling - Instruction Sheet</i>	NVE35500
<i>MasterPacT MTZ2/MTZ3 - SDE2 Fault-Trip Indication Contact / RES Remote Reset - Instruction Sheet</i>	NVE35503
<i>MasterPacT MTZ1/MTZ2/MTZ3 - MN-MX-XF Voltage Releases - Instruction Sheet</i>	NVE40749
<i>MasterPacT MTZ1/MTZ2/MTZ3 - MN-MX-XF Communicating Voltage Releases with Diagnostic Function - Instruction Sheet</i>	NVE40766
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Wiring Kit for MN-MX-XF Communicating Voltage Releases with Diagnostic Function - Instruction Sheet</i>	NVE40768
<i>MasterPacT MTZ2/MTZ3 - Microswitches OF/SDE/PF/CH - Instruction Sheet</i>	NVE56766
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Set of 2 Cables for Interlocking 2.5 m (8.2 ft) - Instruction Sheet</i>	NVE61729
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Set of 2 Rods for Interlocking - Instruction Sheet</i>	NVE61744
<i>MasterPacT MTZ2/MTZ3 - Retrofit Kit for NW Chassis to MasterPacT MTZ2/MTZ3 - Instruction Sheet</i>	QGH31931
<i>MasterPacT MTZ2/MTZ3 - Fixed to Drawout Device Conversion Kit - Instruction Sheet</i>	QGH31938
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Locating Bracket for MN-MX-XF Voltage Releases - Instruction Sheet</i>	QGH60497

## Related Documents for MicroLogic Active Control Units

Document title	Reference number
<i>MasterPacT MTZ with MicroLogic Active Control Unit - Catalog</i>	LVPEd225010EN
<i>MasterPacT MTZ - MicroLogic Active Control Unit - User Guide</i>	DOCA0265EN DOCA0265ES DOCA0265ZH
<i>MasterPacT MTZ IEC Circuit Breakers with MicroLogic Active Control Unit - End-User Maintenance Procedures</i>	DOCA0306EN DOCA0306ES DOCA0306ZH
<i>MicroLogic Active - Spare Battery - Instruction Sheet</i>	PKR4244002
<i>MasterPacT / PowerPacT / ComPacT - LV848892SP ZSI Interface Module - Instruction Sheet</i>	NHA12883
<i>MasterPacT MTZ1/MTZ2/MTZ3 - MicroLogic Neutral Current Transformer Wiring - Instruction Sheet</i>	NHA13906
<i>MasterPacT MTZ1/MTZ2/MTZ3 - Neutral Current Transformer - Instruction Sheet</i>	NHA14388
<i>MasterPacT NT/NW/MTZ1/MTZ2/MTZ3, PowerPacT P/R, ComPacT NS630b-NS3200 - Ground-Fault Interface Module with Current Sensor - Instruction Sheet</i>	NHA92405
<i>EnerlinX EIFE – Embedded Ethernet Interface for One MasterPacT MTZ Drawout Circuit Breaker – Instruction Sheet</i>	NVE23550
<i>MasterPacT MTZ1/MTZ2/MTZ3 - MicroLogic Transparent Cover - Instruction Sheet</i>	NVE16151
<i>MicroLogic - Mobile Power Pack - Instruction Sheet</i>	NVE40737
<i>MasterPacT MTZ1 with MicroLogic Active Control Unit - Microswitches OF/SDE/PF/CH - Instruction Sheet</i>	PKR4250402
<i>MasterPacT MTZ2/MTZ3 with MicroLogic Active Control Unit - Microswitches OF/SDE/PF/CH - Instruction Sheet</i>	PKR4250302



Schneider Electric  
35 rue Joseph Monier  
92500 Rueil Malmaison  
France

[www.se.com](http://www.se.com)

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2026 Schneider Electric. All rights reserved.

DOCA0305EN-01